

State of Illinois  
Rod. R. Blagojevich, Governor



Illinois Environmental Protection Agency  
Douglas P. Scott, Director

# Annual Compliance Report for Public Drinking Water Supplies 2006



Illinois  
Environmental  
Protection  
Agency

August 2007

[www.epa.state.il.us](http://www.epa.state.il.us)

*Printed by the authority of  
the State of Illinois*  
IISG08115



## Annual Compliance Report, Calendar Year 2006 The Drinking Water Program: An Overview

### Introduction



The United States Environmental Protection Agency (USEPA) established the Public Water System Supervision (PWSS) Program under the authority of the 1974 Safe Drinking Water Act (SDWA). Under the SDWA and the subsequent amendments, USEPA sets national limits on contaminant levels in drinking water to ensure that the water is safe for human consumption. These limits are known as Maximum Contaminant Levels (MCLs)<sup>2</sup> and Maximum Residual Disinfectant Levels (MRDL's)<sup>3</sup>. For some regulations, EPA establishes treatment techniques (TT)<sup>4</sup> in lieu of an MCL to control unacceptable levels of contaminants in water. The Agency also regulates how

often public water systems (PWSs)<sup>1</sup> monitor their water for contaminants and report the monitoring results to the states or USEPA. Generally, the larger the population served by a water system, the larger the number of samples collected and the more frequent the monitoring and reporting (M/R)<sup>5</sup> requirements. In addition, USEPA requires Public Water Systems (PWSs) to monitor for unregulated contaminants to provide data for development of future regulations. Finally, USEPA requires PWSs to notify their consumers when they have violated these regulations. The 1996 Amendments to the SDWA require consumer notification to include a clear and understandable explanation of the nature of the violation, its potential adverse health effects, steps that the PWS is undertaking to correct the violation and the possibility of using alternative water supplies during the violation.

### Annual State PWS Report

The purpose of this annual compliance report is to satisfy the requirement of Section 1414(c)(3) of the 1996 Amendments to the Safe Drinking Water Act (SDWA). States with national primary

---

enforcement authority are to prepare, make readily available to the public, and submit to the Administrator of the USEPA by July 1 of each year, an annual report on violations occurring during the previous calendar year of national primary drinking water regulations by public water systems.

## Annual Compliance Report Background

Each quarter, the Illinois Environmental Protection Agency (Illinois EPA) submits data to the Federal Safe Drinking Water Information System (SDWIS/FED), an automated database maintained by USEPA. The data submitted include, but are not limited to, PWS inventory information, the incidences of violations of Maximum Contaminant Levels, Maximum Residual Disinfectant Levels, monitoring, and treatment technique violations; and information on enforcement activity related to these violations. This report provides the numbers of violations in each of six categories:



- Maximum Contaminant Level (MCL) violations
- Maximum Residual Disinfectant Level (MRDL) violations,
- Treatment Technique (TT) requirement violations,
- Significant violations of Monitoring and Reporting (M/R) requirement violations,
- Significant violations of the Consumer Notification requirements,
- And Violations of Variances and Exemptions.

Attached to this report as Appendix A is a listing for each contaminant regulated by the SDWA, the numbers of maximum contaminant level (MCL), maximum residual disinfectant level (MRDL), treatment technique (TT) and major monitoring and reporting (M/R) violations for each compliance period during calendar year 2006, the number of violations that were returned to compliance (RTC), and the number of systems incurring violations. Appendix B and Appendix C contain a detailed listing of public water systems with MCL, MRDL, or TT violations.

## Variances and Exemptions

A PWS can be granted a “variance” from a primary drinking water regulation if the characteristics of the raw water sources reasonably available to the PWS do not allow the system to meet the MCL. To obtain a variance, the system must agree to install the best available technology, treatment techniques, or other means of limiting drinking water contamination that the Administrator finds are available (taking costs into account), and the state must find that the variance will not result in an unreasonable risk to public




health. The variance shall be reviewed not less than every 5 years to determine if the system remains eligible for the variance. During 2006, Illinois did not grant any variances.

A water system may also petition the state for an “exemption”. An exemption is permission not to meet an MCL or a treatment technique under certain conditions for a period of time. An exemption may be granted to give a water system additional time to make complicated and expensive modifications and improvements to the water treatment process so that compliance may be achieved in the shortest period of time. During 2006, Illinois did not grant any exemptions.

## Public Water System Overview

In Illinois, oversight of PWSs is divided between the Illinois Environmental Protection Agency (Illinois EPA) and the Illinois Department of Public Health (Illinois DPH). Illinois EPA has been designated as the lead agency for primary enforcement authority and oversees the **community public water system (CWS)** program (these supplies that serve 15 or more year round service connections or 25 or more year round residents). During 2006, there were 1,789 CWS. Illinois DPH oversees the **non-community water systems**. Non-community systems include the **non-transient, non-community public water systems (NTNC)** that serve 25 or more of the same non-residents at least 180 days out of the year and include facilities such as day care centers, schools and factories. Illinois DPH also oversees the **transient non-community (TNC) public water systems** that serve 25 or more different nonresidents at least 60 days out of the year and include facilities such as campgrounds and highway rest areas. During 2006, there were 396 NTNC and 3,822 TNC. The remainder of this report will detail the CWS supplies and then, separately, address the non-community (NTNC/TNC) supplies.

## Community Public Water Supplies

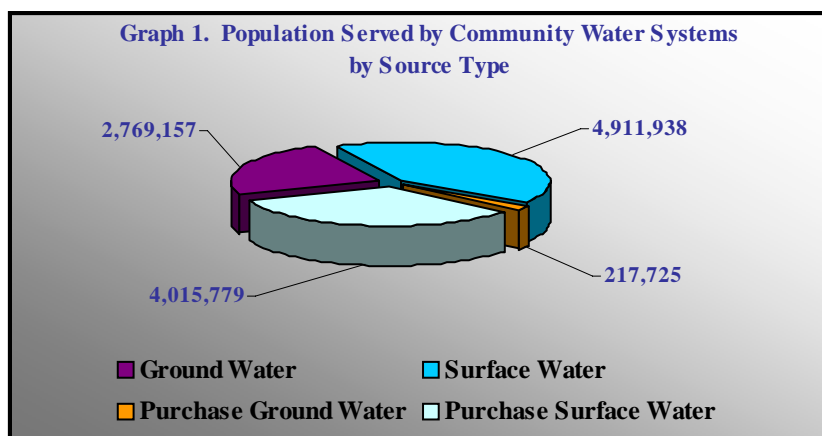

As previously mentioned, the Illinois EPA oversees the **CWS** program. A CWS is a PWS that serves 25 or more people year around and/or has 15 service connections. ◀ **Graph 1** depicts the breakdown of the 1,789 community water systems within Illinois with regard to their source of water. A total of 11,914,599 persons are served by those systems; 41 percent of that population is directly served from surface water systems.

Thirty-four percent of the population is served by purchased surface water, 2 percent by purchased ground water, and 23 percent by ground water systems. It is worth noting that although only 23 percent of the population is served by ground water; ground water systems comprise almost 58 percent (1,038 of the 1,789) of the total number of community water systems. The type of source water (ground, surface, or purchase) for a CWS will determine




monitoring, treatment, and operational requirements. For example, surface water systems are required to monitor turbidity, where ground water systems (that are not under the influence of surface water) are not. This requirement will impact compliance numbers as outlined later in this report.

## CWS - Environmental Indicators

The Illinois EPA Safe Drinking Water Goal is for every Illinois public water system to provide water that is consistently safe to drink. As a part of its partnership agreement with USEPA, Illinois EPA measures the progress of the drinking water program with environmental indicators consisting of the percentage of persons served by community water systems that have not incurred violations of any acute MCL, chronic MCL, acute treatment technique, chronic treatment technique or public education requirement during the year. The environmental objective of the Illinois EPA is to increase the percentage of population served by CWS that receive drinking water with no short-term (acute) or long-term (chronic) adverse health effects to over 95 percent by the year 2008. The progress towards this objective is summarized below.

## CWS - Environmental Indicator Progress

Safe drinking water should be free of contaminants that have the potential to cause either short term or long-term health effects. During calendar year 2006, the percentage of persons served by Illinois CWS that have been in effect for more than three years and that were compliant with all health requirements (MCL), treatment techniques (TT), or public education was **93.2** percent. Compliance efforts will continue to focus on minimizing the frequency and duration of excursions and the development of enforceable schedules for the implementation of corrective action plans to achieve sustained compliance.

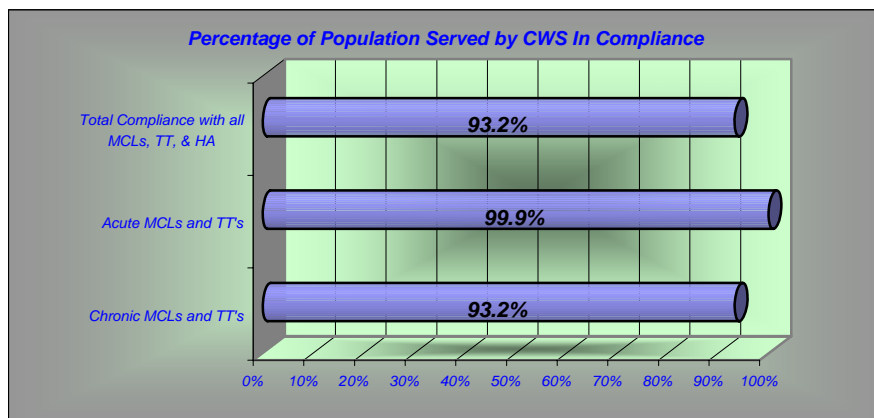

◀ Graph 2

### CWS Compliance Percentages

During calendar year 2006, the percentage of persons served by Illinois CWS that were compliant with all health requirements was 93.2 percent. This compliance percentage represents almost a one percentage point improvement from calendar year 2005 and reflects continued progress toward the goal of 95 percent. It is important that safe drinking water be free of contamination that has the potential to cause either short-term or long-term health effects.

## CWS - Acute vs. Chronic Indicators


The contaminants fall into two groups according to the health effects that they cause:

ACUTE	CHRONIC
<p>Acute effects occur within hours or days of the time that a person consumes a contaminant. People can suffer acute health effects from almost any contaminant if they are exposed to extraordinarily high levels (as in the case of a spill). In drinking water, microbes, such as bacteria and viruses, are the contaminants with the greatest chance of reaching levels high enough to cause acute health effects. Most people's bodies can fight off these microbial contaminants the way they fight off germs; and these acute contaminants typically don't have permanent effects. Nonetheless, when high enough levels occur, they can make people ill, and can be dangerous or deadly for a person whose immune system is already weak due to HIV/AIDS, chemotherapy, steroid use, or another reason.</p>	<p>Chronic effects occur after people consume a contaminant at levels over EPA's safety standards for many years. USEPA develops the standards for chronic MCLs on the basis that a person may have an adverse health effect after consuming two liters of water daily over a 70-year lifetime. The drinking water contaminants that can have chronic effects are chemicals (such as disinfection by-products, solvents, and pesticides), radionuclides (such as radium), and minerals (such as arsenic). Examples of the chronic effects of drinking water contaminants are cancer, liver or kidney problems, or reproductive difficulties.</p>


**Graph 3 (below)** shows that **99.9** percent of the population served by Illinois CWS received drinking water in compliance with acute (short-term) health requirements, and **93.2** percent were in compliance with chronic (long-term) health requirements. It is important to note that most non-compliance was short in duration, and the potential for health risk was minimized through prompt corrective action by the water supplies. Supplies with microbial problems (bacterial or turbidity non-compliance) are required to issue boil orders when the violation occurs. Community water systems with acute MCLs were limited to five water systems.

**Acute and Chronic Requirements (2006 data)**  
**Percent of CWS Population Served Compliant with Health Records**

ACUTE

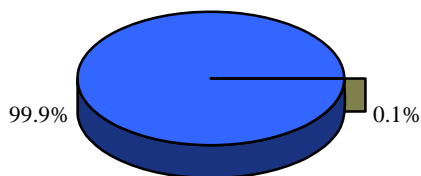

CHRONIC

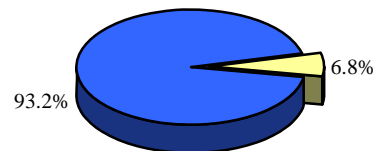

■ Compliant ■ Non-compliant

■ Compliant ■ Non-Compliant

## CWS - Lead And Copper Compliance


In 2006, 1,766 water supplies, or approximately **98.7** percent of community water supplies were below the lead action level. These water supplies serve **99.3** percent of the population. There were no treatment technique violations reported for the NTNC water systems overseen by the Illinois DPH.

### Lead and Copper Rule Compliance



Lead and copper are regulated by a Treatment Technique that requires systems to control the corrosiveness of their water. The lead action level (15 parts per billion of lead) when exceeded in more than ten percent of the water samples collected in consumers' homes, requires the water supply to implement optimal corrosion control treatment plans or procedures which would prevent anticipated adverse health effects and ensure that lead or copper is controlled in the drinking water.

▼ **Graph 4** illustrates the Percentage of **Community** Water Systems that were below the lead action level.

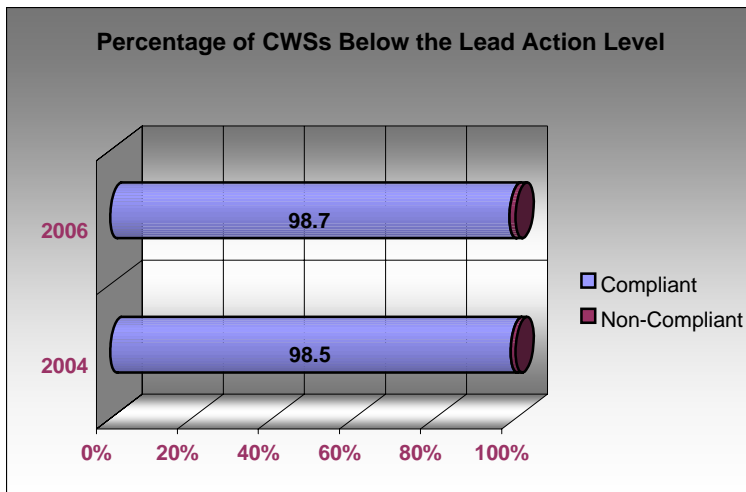

During the years 2004 to 2006, a 0.2 percent net decrease in lead action level exceedances was seen in CWS. Generally, non-compliance is for a short period of time due to the fact the treatment is adjusted to the required ranges. Over *99 percent* of the population served by CWS consumed water that was compliant with lead action level during 2006.




## CWS - Consumer Awareness

Every community water supplier must provide an annual report (sometimes called a Consumer Confidence Report or CCR) to its customers. The report provides information on local drinking water quality, including the water's source, the contaminants found in the water, and how consumers can get involved in protecting drinking water. If the consumers have been looking for specific information about their drinking water, this annual report will provide them with the information they need.

In connection with each violation described in the previous sections, public notification is required to be issued. Public notification provides a means to protect public health, build trust with consumers through open and honest sharing of information, and establishes an ongoing, positive relationship with the community. Public notice can also be used to help consumers

### *Community Systems in Compliance with Consumer Notification*

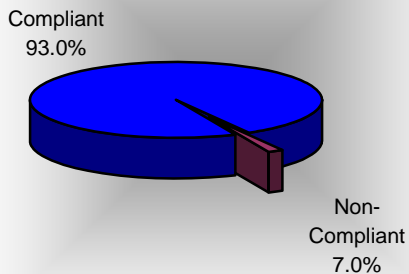

understand rate increases and support increased funding for drinking water treatment and protection. Properly done, the notices can work for the benefit of the public water supplier as well the public. In the event a problem occurs, educated consumers are more likely to understand the problem and support the actions a water utility must take. Many deadlines for public notice issuance depend upon prompt contact and discussion between the public water system and Illinois EPA. Efficient communication with prompt reporting is the cornerstone for compliance. **Graph 5 (left)** depicts the compliance rates for community water systems with regard to overall consumer notification during 2006. This includes failure to issue public notice and the CCR compliance rate.

## CWS – Monitoring and Reporting (M&R)

The USEPA has established contaminant-specific minimum testing schedules for public water systems. Water systems typically monitor for bacteria, protozoa and viruses, nitrate and nitrite, volatile organic compounds (e.g., benzene), synthetic organic compounds (e.g., pesticides), inorganics (e.g., arsenic), lead and copper, and radionuclides. Although failure to monitor does not necessarily suggest safety problems, conducting the required monitoring and reporting is critical to ensure that problems will be detected.

During 2006, 90.3 percent of total community supplies were compliant with monitoring and reporting requirements. This is a 3.2 percent increase above the 2005 figure (87.1).

## **IEPA Enforcement Strategy**

The Illinois EPA has enforcement authority over community water systems in Illinois. Illinois EPA has a standardized protocol for all enforcement matters to ensure unilateral, consistent treatment of enforcement cases. For any violation outlined in the previous pages, a failure to take corrective action could result in the water system being considered for enforcement under Section 31 of the Illinois Environmental Protection Act. Enforcement normally begins with the identification of a significant unresolved violation by technical staff. Information about the violator/violations is forwarded to the Compliance Group (composed of Section Managers). If the Compliance Group determines a Violation Notice (VN) is warranted, the VN recommendation is sent to the Agency's Compliance Management Panel (CMP) for review. After review by the CMP, the Compliance Assurance Section prepares and issues the VN. After the VN is sent, the violator will have a set time period (45 days or 60 days depending on whether a meeting is requested) to respond in writing with a proposed Compliance Commitment Agreement (CCA). Enforcement activities are suspended if the proposed CCA is accepted by the Agency. If at a later point in time, the violator does not follow the CCA agreement, enforcement may resume.

If the proposed CCA is not accepted or the violator fails to respond to the VN, the case is brought before the Enforcement Decision Group (EDG, composed of senior Agency management). EDG will determine the next course of action such as recommending a case for formal enforcement, which consists of referring the water system to the State's Attorney General or the USEPA for filing with a court to direct corrective actions and which may include imposition of penalties or fines.

## **CWS Violation Summary Table**

The following page summarizes the percentage of community water systems in compliance with all aspects of the drinking water compliance program. Radionuclide MCLs comprise the largest number of violations, and consequently, cause the largest number of water systems to be out of compliance. As these systems conclude construction, compliance numbers will improve. Those systems not making progress on reducing radium MCL levels are proceeding through the enforcement process previously outlined.

**Violations during Calendar Year 2006  
State of Illinois  
Community Water Systems**

<b>Total Number of Regulated Systems</b>	<b>1,789</b>
<b>Total Number of Systems in Violation</b>	<b>349</b>
<b>Total Number of Violations</b>	<b>1,441</b>

<b>Rule Subtotal by Violation Type – Community Water Systems</b>									
<b>Violation Category</b>	<b>MCLs</b>			<b>Treatment Techniques</b>			<b>Significant Monitoring/Notification</b>		
	Number of Violations	Number of Systems in Violation*	Compliance Rate	Number of Violations	Number of Systems in Violation*	Compliance Rate	Number of Violations	Number of Systems in Violation*	Compliance Rate
Radiological	239	63	96.5%	-	-	-	57	22	98.8%
IOCs	124	37	98.0%	-	-	-	3	3	99.9%
SOCs	5	2	99.9%	-	-	-	168	6	99.7%
VOCs	0	0	100%	-	-	-	164	4	99.8%
Nitrate / Nitrite	2	2	99.9%	-	-	-	16	16	99.2%
TCR	50	41	97.8%	-	-	-	114	72	96.0%
All SWTRs	-	-	-	84	12	99.4%	0	0	100%
Stage 1 DBPR	23	12	99.4%	6	2	99.9%	184	90	95.0%
Lead and Copper Rule	-	-	-	8	8	99.6%	22	22	98.8%
Consumer Awareness / Notification	-	-	-	-	-	-	172	127	93.0%
<b>Total PWSs</b>	<b>443</b>	<b>148</b>	<b>91.8%</b>	<b>98</b>	<b>21</b>	<b>98.9%</b>	<b>900</b>	<b>257</b>	<b>85.7%</b>


\*Note: Although a CWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF CWS IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

## Non-Community Public Water Systems

As stated previously, Illinois DPH oversees the non-community water system program. Non-community systems include the **non-transient, non-community public water systems (NTNC)** that serve 25 or more of the same nonresidents at least 180 days out of the year and include facilities such as day care centers, schools and factories. Illinois DPH also supervises the **transient non-community (TNC) public water systems** that serve 25 or more different nonresidents at least 60 days out of the year and include facilities such as campgrounds and highway rest areas.

Graph 7 ►

### Population Distribution Amongst Non-community Systems

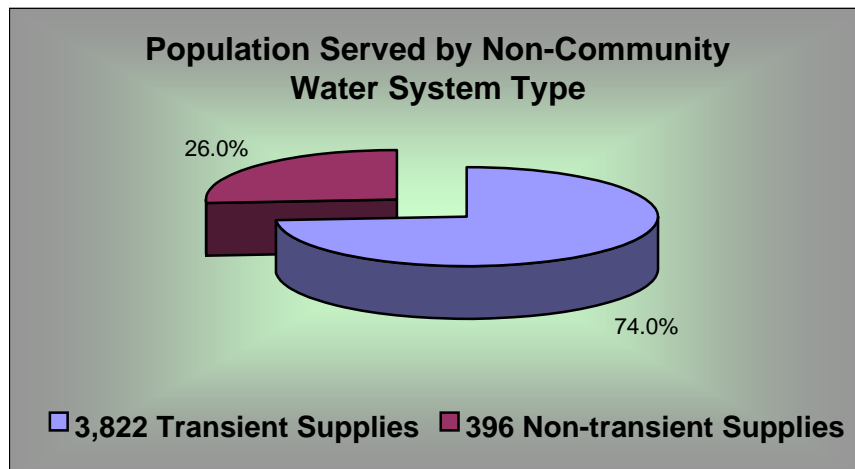

Graph 7 depicts how the 528,084 customers served by non-community water systems are distributed between the transient and non-transient systems. Transient supplies (campgrounds, rest areas, etc.) serve a population of 390,965 at 3,822 facilities. Non-transient systems serve 137,119 consumers at 396 systems.

Both NTNC and TNC are required to monitor contaminants like the CWS and issue public notification if in violation. However, TNC only monitor for nitrates, coliform bacteria, and are subject to some requirements of the surface water treatment rule (if they use surface water). NTNC monitors the same contaminants as CWS, but are not required to monitor radionuclides or issue/publish a consumer confidence report.

### Non-CWS Compliance Figures

During calendar year 2006, the percentage of persons served by Illinois **non-community** water systems that were compliant with all health requirements (MCL), treatment techniques (TT), or health advisories (HA) that have been in effect for more than three years was 96.6 percent.

The following page summarizes the percentage of non-community water systems in compliance with all aspects of drinking water compliance.

**Violations during Calendar Year 2006  
State of Illinois  
Non-Community Water Systems**

<b>Total Number of Regulated TNC and NTNC Systems</b>	<b>4218</b>
<b>Total Number of Systems in Violation</b>	<b>394</b>
<b>Total Number of Violations</b>	<b>3194</b>

<b>Rule Subtotal by Violation Type – Non-Community Water Systems</b>									
<b>Violation Category</b>	<b>MCLs</b>			<b>Treatment Techniques</b>			<b>Significant Monitoring/Notification</b>		
	Number of Violations	Number of Systems in Violation*	Compliance Rate	Number of Violations	Number of Systems in Violation*	Compliance Rate	Number of Violations	Number of Systems in Violation*	Compliance Rate
IOCs	0	0	100%	-	-	-	14	9	97.7%
SOCs	0	0	100%	-	-	-	751	29	92.7%
VOCs	1	1	99.7%	-	-	-	1932	57	85.6%
Nitrate / Nitrite	10	10	99.8%	-	-	-	3	3	99.0%
TCR	146	135	96.8%	-	-	-	222	173	95.9%
All SWTRs	-	-	-	0	0	100%	12	1	99.7%
Stage 1 DBPR	0	0	100%	-	-	-	14	7	98.2%
Lead/Copper**	-	-	-	0	0	100%	89	86	78.3%
Consumer Awareness / Notification	-	-	-	-	-	-	0	0	100%**
<b>Total PWSs</b>	<b>157</b>	<b>144</b>	<b>96.6%</b>	<b>0</b>	<b>0</b>	<b>100%</b>	<b>3037</b>	<b>287</b>	<b>93.2%</b>

\*Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

\*\*Public Notice for monitoring violations are not included in the compliance rate



## Common Terms & Definitions

### **<sup>1</sup>Public Water System (PWS)**

A Public Water System (PWS) is defined as a system that provides water via piping or other constructed conveyances for human consumption to at least 15 service connections or serves an average of at least 25 people for at least 60 days each year. There are three types of PWSs. PWSs can be community (such as towns), non-transient non-community (such as schools or factories), or transient non-community systems (such as rest stops or parks). For this report when the acronym “PWS” is used, it means systems of all types unless specified in greater detail.

### **<sup>2</sup>Maximum Contaminant Level (MCL)**

Under the Safe Drinking Water Act (SDWA), the EPA sets national limits on contaminant levels in drinking water to ensure that the water is safe for human consumption. These limits are known as Maximum Contaminant Levels (MCLs).

### **<sup>3</sup>Maximum Residual Disinfectant Level (MRDL)**

The EPA sets national limits on residual disinfectant levels in drinking water to reduce the risk of exposure to disinfection byproducts formed when public water systems add chemical disinfectant for either primary or residual treatment. These limits are known as Maximum Residual Disinfectant Levels (MRDLs).

### **<sup>4</sup>Treatment Techniques (TT)**

For some regulations, the EPA establishes treatment techniques (TTs) in lieu of an MCL to control unacceptable levels of certain contaminants. For example, treatment techniques have been established for viruses, some bacteria, and turbidity.

### **Return to Compliance**

As noted in the definition of monitoring violations, systems which monitor less frequently than quarterly can return to compliance. Some systems can return to compliance if they monitor for the missed contaminants or submit reports late. In this report, return to compliance rates were determined for inorganic contaminants; nitrate; nitrite; regulated volatile organic contaminants; synthetic organic contaminants; total trihalomethanes; five haloacetic acids (DBPs); and radiological contaminants, as a group.

### **<sup>5</sup>Significant Monitoring and Reporting (M/R) Violations**

A PWS is required to monitor and verify that the levels of contaminants present in the water do not exceed the MCL. If a PWS fails to have its water tested as required or fails to report test results correctly to the appropriate Agency, a monitoring violation occurs. For this report, significant monitoring violations are generally defined as any significant monitoring violation that occurred during the calendar year of the report. A significant monitoring violation, with rare exceptions, occurs when no samples were taken or no results were reported during a compliance period.

### **<sup>6</sup>Significant Consumer Notification Violations**

Every Community Water System is required to deliver to its customers a brief annual water quality report (CCR). This report is to include some educational material, and will provide information on the source water, the levels of any detected contaminants, and compliance with drinking water regulations. For this report, a significant public notification violation occurred if a community water system completely failed to provide its customers the required annual water quality report.

## **OBTAINING COPY OF 2006 PUBLIC WATER SYSTEMS REPORT**

As required by the Safe Drinking Water Act, the Illinois EPA has made the 2006 Public Water Systems report available to the public. Interested individuals can obtain a copy of the 2006 Annual Public Water Systems Report for Illinois by accessing:

**State Website:** <http://www.epa.state.il.us/water/compliance/drinking-water/compliance-report/index.html>

**Telephone:** (217) 785 0561

**Fax Number:** (217) 557 1407

**Address:** Illinois EPA  
Bureau of Water, Compliance Assurance Section  
1021 North Grand Ave  
PO Box 19276  
Springfield, IL 62794

**Contact Name:** Mike Crumly

## **Appendix A**

**The attached tables summarize the number of maximum contaminant level, treatment technique, and significant monitoring violations that occurred during calendar year 2006 for each contaminant regulated by the Safe Drinking Water Act (SDWA). Also identified is the number of public water supplies responsible for the violations and the number of violations that have returned to compliance.**

**Appendix A**  
**Illinois EPA 2006 Annual Compliance Report**  
**Calendar Year 2006**

**Community Water Supplies**

<b>Volatile Organic Chemicals (VOCs)</b>								
<b>Code</b>	<b>Name</b>	<b>MCL (mg/l)</b>	<b>MCLs</b>			<b>Monitoring</b>		
			<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
2977	1,1-Dichloroethylene	0.007	0	0	0	8	0	2
2981	1,1,1-Trichloroethane	0.2	0	0	0	8	0	2
2985	1,1,2-Trichloroethane	0.005	0	0	0	8	0	2
2980	1,2-Dichloroethane	0.005	0	0	0	8	0	2
2983	1,2-Dichloropropane	0.005	0	0	0	8	0	2
2378	1,2,4-Trichlorobenzene	0.07	0	0	0	8	0	2
2990	Benzene	0.005	0	0	0	8	0	2
2982	Carbon Tetrachloride	0.005	0	0	0	8	0	2
2380	Cis-1,2-Dichloroethylene	0.07	0	0	0	8	0	2
2964	Dichloromethane (Methylene Chloride)	0.005	0	0	0	9	0	3
2992	Ethylbenzene	0.7	0	0	0	8	0	2
2989	Monochlorobenzene (Chlorobenzene)	0.1	0	0	0	8	0	2
2968	o-Dichlorobenzene	0.6	0	0	0	8	0	2
2969	p-Dichlorobenzene	0.075	0	0	0	8	0	2
2996	Styrene	0.1	0	0	0	8	0	2
2987	Tetrachloroethylene	0.005	0	0	0	9	0	3
2991	Toluene	1	0	0	0	9	1	3
2979	Trans-1,2-Dichloroethylene	0.1	0	0	0	8	0	2
2984	Trichloroethylene	0.005	0	0	0	9	0	3
2955	Xylenes, Total	10	0	0	0	8	0	2
2976	Vinyl Chloride	0.002	0	0	0	0	0	0
<b>VOC Totals</b>			<b>0</b>	<b>0</b>	<b>0</b>	<b>164</b>	<b>1</b>	<b>4</b>

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

**Appendix A**  
**Illinois EPA 2006 Annual Compliance Report**  
**Calendar Year 2006**  
**Community Water Supplies**

Synthetic Organic Chemicals (SOCs)								
Code	Name	MCL (mg/l)	MCLs			Monitoring		
			# of Violations	# of RTC Violations	# of PWSs In Violation	# of Violations	# of RTC Violations	# of PWSs In Violation
2931	1,2 Dibromo-3-Chloropropane (DBCP)	0.0002	0	0	0	5	1	2
2105	2,4-D	0.07	0	0	0	5	1	2
2063	2,3,7,8-TCDD (Dioxin)	3x10-8	0	0	0	5	1	2
2110	2,4,5-TP (Silvex)	0.05	0	0	0	5	1	2
2051	Alachlor (Lasso)	0.002	0	0	0	6	2	2
2047	Aldicarb	NA	-	-	-	5	1	2
2044	Aldicarb Sulfone	NA	-	-	-	5	1	2
2043	Aldicarb Sulfoxide	NA	-	-	-	5	1	2
2050	Atrazine	0.003	3	0	1	5	1	2
2306	Benzo (A) Pyrene	0.0002	0	0	0	6	2	3
2010	BHC-gamma (Lindane)	0.0002	0	0	0	6	2	3
2046	Carbofuran	0.04	0	0	0	5	1	2
2959	Chlordane	0.002	0	0	0	6	2	3
2031	Dalapon	0.2	0	0	0	5	1	2
2035	Di(2-Ethylhexyl) Adipate	0.4	0	0	0	5	1	2
2039	Di(2-Ethylhexyl) Phthalate	0.006	0	0	0	6	2	3
2041	Dinoseb	0.007	0	0	0	5	1	2
2032	Diquat	0.02	0	0	0	5	1	2
2033	Endothall	0.1	0	0	0	5	1	2
2005	Endrin	0.002	0	0	0	6	2	3
2946	Ethylene Dibromide (EDB)	0.00005	0	0	0	5	1	2
2034	Glyphosate	0.7	0	0	0	0	0	0
2065	Heptachlor	0.0004	0	0	0	5	2	2
2067	Heptachlor Epoxide	0.0002	0	0	0	6	2	3
2274	Hexachlorobenzene (HCB)	0.001	0	0	0	6	2	3
2042	Hexachlorocyclopentadiene	0.05	0	0	0	6	2	3
2015	Methoxychlor	0.04	0	0	0	6	2	3
2036	Oxamyl (Vydate)	0.2	0	0	0	5	1	2
2326	Pentachlorophenol	0.001	0	0	0	5	1	2
2040	Picloram	0.5	0	0	0	5	1	2

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.



**Appendix A**  
**Illinois EPA 2006 Annual Compliance Report**  
**Calendar Year 2006**  
**Community Water Supplies**

SOCs continued								
Code	Name	MCL (mg/l)	MCLs			Monitoring		
			# of Violations	# of RTC Violations	# of PWSs In Violation	# of Violations	# of RTC Violations	# of PWSs In Violation
2037	Simazine	0.004	2	2	1	5	1	2
2383	Total Polychlorinated Biphenyls (PCB)	0.0005	0	0	0	6	2	3
2020	Toxaphene	0.003	0	0	0	6	2	3
<b>SOC Totals</b>			<b>5</b>	<b>2</b>	<b>2</b>	<b>168</b>	<b>44</b>	<b>6</b>

Code	Name	MCL (mg/l)	Treatment Technique			Monitoring		
			# of Violations	# of RTC Violations	# of PWSs In Violation	# of Violations	# of RTC Violations	# of PWSs In Violation
2257	Epichlorohydrin	TT	0	0	0	0	0	0
2265	Acrylamide	TT	0	0	0	0	0	0
<b>Totals</b>			<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

**Appendix A**  
**Illinois EPA 2006 Annual Compliance Report**  
**Calendar Year 2006**  
**Community Water Supplies**

<b>Inorganic Chemicals (IOCs)</b>								
<b>Code</b>	<b>Name</b>	<b>MCL (mg/l)</b>	<b>MCLs</b>			<b>Monitoring</b>		
			<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
1074	Antimony, Total	0.006	0	0	0	0	0	0
1005	Arsenic	0.05	123	42	36	2	1	2
1010	Barium	2	1	1	1	1	1	1
1075	Beryllium, Total	0.004	0	0	0	0	0	0
1015	Cadmium	0.005	0	0	0	0	0	0
1020	Chromium	0.1	0	0	0	0	0	0
1024	Cyanide	0.2	0	0	0	0	0	0
1025	Fluoride	4	0	0	0	0	0	0
1035	Mercury	0.002	0	0	0	0	0	0
1040	Nitrate	10	1	1	1	16	13	16
1038	Total Nitrite & Nitrate	10	0	0	0	0	0	0
1041	Nitrite	1	1	1	1	0	0	0
1045	Selenium	0.05	0	0	0	0	0	0
1085	Thallium, Total	0.002	0	0	0	0	0	0
1094	Asbestos	7 MFL	0	0	0	0	0	0
<b>IOC Totals</b>			<b>126</b>	<b>45</b>	<b>39</b>	<b>19</b>	<b>15</b>	<b>19</b>

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

**Appendix A**  
**Illinois EPA 2006 Annual Compliance Report**  
**Calendar Year 2006**  
**Community Water Supplies**

<b>Radionuclide Contaminants (RAD)</b>								
<b>Code</b>	<b>Name</b>	<b>MCL</b>	<b>MCLs</b>			<b>Monitoring</b>		
			<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
4000 & 4109	Gross Alpha Adjusted Gross Alpha	15 pCi/L	45	23	18	20	16	16
4010	Radium-226 & Radium-228	5 pCi/L	194	72	62	24	20	20
4006	Uranium	30 pCi/L	0	0	0	13	8	9
4100	Gross Beta	4/mrem/yr	0	0	0	0	0	0
<b>RAD Totals</b>			<b>239</b>	<b>95</b>	<b>63</b>	<b>57</b>	<b>44</b>	<b>22</b>

<b>Coliform (TCR)</b>							
<b>Violation Type</b>	<b>Violation Name</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation*</b>			
21	MCL, Acute	4	4	4			
22	MCL, Monthly	46	46	41			
23, 25	Monitoring Routine & Repeat Major	114	90	72			
		<b>MCLs</b>			<b>Monitoring</b>		
		<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
<b>TCR Totals</b>		<b>50</b>	<b>50</b>	<b>41</b>	<b>114</b>	<b>90</b>	<b>72</b>

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.







**Appendix A**  
**Illinois EPA 2006 Annual Compliance Report**  
**Calendar Year 2006**  
**Community Water Supplies**

<b>Lead and Copper Rule (LCR)</b>							
<b>Violation Type</b>	<b>Violation Name</b>	<b># of Violations</b>		<b># of RTC Violations</b>	<b># of PWSs In Violation*</b>		
51	Monitoring, Initial Tap Sampling for Pb/Cu	7		7	7		
52	Monitoring, Follow-up & Routine Tap Sampling for Pb/Cu	15		13	15		
58	Treatment Installation	1		1	1		
65	Public Education	7		7	7		
		<b>Monitoring</b>			<b>Treatment Technique</b>		
		<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
<b>LCR Totals</b>		<b>22</b>	<b>20</b>	<b>22</b>	<b>8</b>	<b>8</b>	<b>8</b>

<b>Consumer Notification</b>						
<b>Violation Type</b>	<b>Violation Name</b>	<b># of Violations</b>		<b># of RTC Violations</b>	<b># of PWSs In Violation*</b>	
71	CCR, Significant Reporting	29		25	29	
75	Public Notice Rule Reporting	143		127	107	
<b>TOTAL</b>		<b>172</b>		<b>152</b>	<b>127</b>	

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

**Appendix A**  
**Illinois EPA 2006 Annual Compliance Report**  
**Calendar Year 2006**  
**Non - Community Water Supplies**

Volatile Organic Chemicals (VOCs)								
Code	Name	MCL (mg/l)	MCLs			Monitoring		
			# of Violations	# of RTC Violations	# of PWSs In Violation	# of Violations	# of RTC Violations	# of PWSs In Violation
2977	1,1-Dichloroethylene	0.007	0	0	0	92	61	57
2981	1,1,1-Trichloroethane	0.2	0	0	0	92	61	57
2985	1,1,2-Trichloroethane	0.005	0	0	0	92	61	57
2980	1,2-Dichloroethane	0.005	0	0	0	92	61	57
2983	1,2-Dichloropropane	0.005	0	0	0	92	61	57
2378	1,2,4-Trichlorobenzene	0.07	0	0	0	92	61	57
2990	Benzene	0.005	0	0	0	92	61	57
2982	Carbon Tetrachloride	0.005	0	0	0	92	61	57
2380	Cis-1,2-Dichloroethylene	0.07	0	0	0	92	61	57
2964	Dichloromethane (Methylene Chloride)	0.005	0	0	0	92	61	57
2992	Ethylbenzene	0.7	0	0	0	92	61	57
2989	Monochlorobenzene (Chlorobenzene)	0.1	0	0	0	92	61	57
2968	o-Dichlorobenzene	0.6	0	0	0	92	61	57
2969	p-Dichlorobenzene	0.075	0	0	0	92	61	57
2996	Styrene	0.1	0	0	0	92	61	57
2987	Tetrachloroethylene	0.005	0	0	0	92	61	57
2991	Toluene	1	0	0	0	92	61	57
2979	Trans-1,2-Dichloroethylene	0.1	0	0	0	92	61	57
2984	Trichloroethylene	0.005	1	0	1	92	61	57
2955	Xylenes, Total	10	0	0	0	92	61	57
2976	Vinyl Chloride	0.002	0	0	0	92	61	57
<b>VOC Totals</b>			<b>1</b>	<b>0</b>	<b>1</b>	<b>1932</b>	<b>1281</b>	<b>57</b>

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

**Appendix A**  
**Illinois EPA 2006 Annual Compliance Report**  
**Calendar Year 2006**  
**Non - Community Water Supplies**

Synthetic Organic Chemicals (SOCs)								
Code	Name	MCL (mg/l)	MCLs			Monitoring		
			# of Violations	# of RTC Violations	# of PWSs In Violation	# of Violations	# of RTC Violations	# of PWSs In Violation
2931	1,2 Dibromo-3-Chloropropane (DBCP)	0.0002	0	0	0	36	14	28
2105	2,4-D	0.07	0	0	0	36	14	28
2063	2,3,7,8-TCDD (Dioxin)	3x10-8	0	0	0	0	0	0
2110	2,4,5-TP (Silvex)	0.05	0	0	0	36	14	28
2051	Alachlor (Lasso)	0.002	0	0	0	36	14	28
2047	Aldicarb	NA	-	-	-	0	0	0
2044	Aldicarb Sulfone	NA	-	-	-	0	0	0
2043	Aldicarb Sulfoxide	NA	-	-	-	0	0	0
2050	Atrazine	0.003	0	0	0	36	14	28
2306	Benzo (A) Pyrene	0.0002	0	0	0	15	3	15
2010	BHC-gamma (Lindane)	0.0002	0	0	0	36	14	28
2046	Carbofuran	0.04	0	0	0	36	14	28
2959	Chlordane	0.002	0	0	0	36	14	28
2031	Dalapon	0.2	0	0	0	15	3	15
2035	Di(2-Ethylhexyl) Adipate	0.4	0	0	0	15	3	15
2039	Di(2-Ethylhexyl) Phthalate	0.006	0	0	0	15	3	15
2041	Dinoseb	0.007	0	0	0	15	3	15
2032	Diquat	0.02	0	0	0	15	3	15
2033	Endothall	0.1	0	0	0	15	3	15
2005	Endrin	0.002	0	0	0	15	3	15
2946	Ethylene Dibromide (EDB)	0.00005	0	0	0	36	14	28
2034	Glyphosate	0.7	0	0	0	15	3	15
2065	Heptachlor	0.0004	0	0	0	36	14	28
2067	Heptachlor Epoxide	0.0002	0	0	0	36	14	28
2274	Hexachlorobenzene (HCB)	0.001	0	0	0	15	3	15
2042	Hexachlorocyclopentadiene	0.05	0	0	0	15	3	15
2015	Methoxychlor	0.04	0	0	0	36	14	28
2036	Oxamyl (Vydate)	0.2	0	0	0	15	3	15
2326	Pentachlorophenol	0.001	0	0	0	36	14	28
2040	Picloram	0.5	0	0	0	15	3	15

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

**Appendix A**  
**Illinois EPA 2006 Annual Compliance Report**  
**Calendar Year 2006**  
**Non - Community Water Supplies**

SOCs continued								
Code	Name	MCL (mg/l)	MCLs			Monitoring		
			# of Violations	# of RTC Violations	# of PWSs In Violation	# of Violations	# of RTC Violations	# of PWSs In Violation
2037	Simazine	0.004	0	0	0	15	3	15
2383	Total Polychlorinated Biphenyls (PCB)	0.0005	0	0	0	37	14	29
2020	Toxaphene	0.003	0	0	0	36	14	28
<b>SOC Totals</b>			<b>0</b>	<b>0</b>	<b>0</b>	<b>751</b>	<b>252</b>	<b>29</b>

Code	Name	MCL (mg/l)	Treatment Technique			Monitoring		
			# of Violations	# of RTC Violations	# of PWSs In Violation	# of Violations	# of RTC Violations	# of PWSs In Violation
2257	Epichlorohydrin	TT	0	0	0	0	0	0
2265	Acrylamide	TT	0	0	0	0	0	0
<b>Totals</b>			<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

**Appendix A**  
**Illinois EPA 2006 Annual Compliance Report**  
**Calendar Year 2006**  
**Non - Community Water Supplies**

<b>Inorganic Chemicals (IOCs)</b>								
<b>Code</b>	<b>Name</b>	<b>MCL (mg/l)</b>	<b>MCLs</b>			<b>Monitoring</b>		
			<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
1074	Antimony, Total	0.006	0	0	0	0	0	0
1005	Arsenic	0.05	0	0	0	10	8	8
1010	Barium	2	0	0	0	0	0	0
1075	Beryllium, Total	0.004	0	0	0	0	0	0
1015	Cadmium	0.005	0	0	0	4	4	1
1020	Chromium	0.1	0	0	0	0	0	0
1024	Cyanide	0.2	0	0	0	0	0	0
1025	Fluoride	4	0	0	0	0	0	0
1035	Mercury	0.002	0	0	0	0	0	0
1040	Nitrate	10	8	6	8	3	1	3
1038	Total Nitrite & Nitrate	10	0	0	0	0	0	0
1041	Nitrite	1	2	2	2	0	0	0
1045	Selenium	0.05	0	0	0	0	0	0
1085	Thallium, Total	0.002	0	0	0	0	0	0
1094	Asbestos	7 MFL	0	0	0	0	0	0
<b>IOC Totals</b>			<b>10</b>	<b>8</b>	<b>10</b>	<b>17</b>	<b>13</b>	<b>12</b>

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.



**Appendix A**  
**Illinois EPA 2006 Annual Compliance Report**  
**Calendar Year 2006**  
**Non - Community Water Supplies**

<b>Coliform (TCR)</b>							
<b>Violation Type</b>	<b>Violation Name</b>	<b># of Violations</b>		<b># of RTC Violations</b>	<b># of PWSs In Violation*</b>		
21	MCL, Acute	26		12	26		
22	MCL, Monthly	120		98	112		
23, 25	Monitoring Routine & Repeat Major	222		192	173		
		<b>MCLs</b>			<b>Monitoring</b>		
		<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
<b>TCR Totals</b>		<b>146</b>	<b>110</b>	<b>135</b>	<b>222</b>	<b>192</b>	<b>173</b>

<b>Lead and Copper Rule (LCR)</b>							
<b>Violation Type</b>	<b>Violation Name</b>	<b># of Violations</b>		<b># of RTC Violations</b>	<b># of PWSs In Violation*</b>		
51	Monitoring, Initial Tap Sampling for Pb/Cu	8		0	8		
52	Monitoring, Follow-up & Routine Tap Sampling for Pb/Cu	81		35	78		
58	Treatment Installation	0		0	0		
65	Public Education	0		0	0		
		<b>Monitoring</b>			<b>Treatment Technique</b>		
		<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
<b>LCR Totals</b>		<b>89</b>	<b>35</b>	<b>86</b>	<b>0</b>	<b>0</b>	<b>0</b>

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.



**Appendix A**  
**Illinois EPA 2006 Annual Compliance Report**  
**Calendar Year 2006**  
**Non - Community Water Supplies**

Stage 1 Disinfectants and Disinfection Byproducts Rule (Stage 1 DBPR)										
Violation Type	Contam Code	Violation Name	# of Violations	# of RTC Violations	# of PWSs In Violation*					
12 and 37	0400	Qualified Operator Failure or Failure to Profile/Consult TT	0	0	0					
46	2920	Inadequate DBP Precursor Removal Treatment Technique	0	0	0					
02	1011	Bromate MCL	0	0	0					
02	1009	Chlorite MCL	0	0	0					
02	2456	Total Haloacetic Acids (HAA) MCL	0	0	0					
02	2950	Total Trihalomethanes (TTHM) MCL	0	0	0					
11	0999	Chlorine Maximum Residual Disinfectant Level (MRDL)	0	0	0					
11	1006	Chloramine MRDL	0	0	0					
11	1008	Chlorine Dioxide MRDL	0	0	0					
11	1008	Chlorine Dioxide Monitoring	0	0	0					
13	1008	Chlorine Dioxide MRDL Acute	0	0	0					
27	0400	No DBPR Monitoring Plan	0	0	0					
27	0999	Chlorine Monitoring	0	0	0					
27	1004	Bromide Monitoring	0	0	0					
27	1006	Chloramine Residual Monitoring	0	0	0					
27	1008	Chlorine Dioxide Residual Monitoring	0	0	0					
27	1009	Chlorite Monitoring	0	0	0					
27	1011	Bromate Monitoring	3	3	2					
27	2456	Total Haloacetic Acids (HAA) Monitoring	5	3	5					
27	2920	TOC Monitoring	2	2	1					
27	2950	Total Trihalomethanes (TTHM) Monitoring	4	2	4					
		<b>MCLs/MRDL</b>		<b>Monitoring</b>			<b>Treatment Technique</b>			
		# of Violations	# of RTC Violations	# of PWSs In Violation	# of Violations	# of RTC Violations	# of PWSs In Violation	# of Violations	# of RTC Violations	# of PWSs In Violation
<b>Stage 1 DBPR Totals</b>		<b>0</b>	<b>0</b>	<b>0</b>	<b>14</b>	<b>10</b>	<b>7</b>	<b>0</b>	<b>0</b>	<b>0</b>

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

**Appendix A**  
**Illinois EPA 2006 Annual Compliance Report**  
**Calendar Year 2006**  
**Community Water Supplies**

<b>2006 State Summary – Community Water Supplies (CWS)</b>										
<b>Rule Group</b>	<b>Chemical Sub-Group</b>	<b>MCLs</b>			<b>Monitoring/Notification</b>			<b>Treatment Technique</b>		
		<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
CHEM	VOC	0	0	0	164	1	4			
	SOC	5	2	2	168	44	6			
	IOC	124	43	37	3	2	3			
	NO2/NO3	2	2	2	16	13	16			
	RAD	239	95	63	57	44	22			
<b>CHEM Subtotal</b>		370	142	103	408	105	45			
<b>TCR Subtotal</b>		50	50	41	114	90	72			
<b>Stage 1 DBPR Subtotal</b>		23	18	12	184	149	90	6	6	2
<b>All SWTRs Subtotal</b>					0	0	0	84	36	12
<b>LCR Subtotal</b>					22	20	22	8	8	8
<b>Consumer Notification Subtotal</b>					172	152	127			
<b>TOTAL</b>		<b>443</b>	<b>210</b>	<b>148</b>	<b>900</b>	<b>515</b>	<b>257</b>	<b>98</b>	<b>50</b>	<b>21</b>
<b>Total Number of CWSs</b>				<b>Grand Total Number CWS Violations (MCL, Monitoring, and Treatment Technique)</b>				<b>Grand Total of CWSs in Violation (MCL, Monitoring, and Treatment Technique)</b>		
<b>1,789</b>				<b>1,441</b>				<b>349</b>		

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

**Appendix A**  
**Illinois EPA 2006 Annual Compliance Report**  
**Calendar Year 2006**  
**Non - Community Water Supplies**

<b>2006 State Summary – Non-Community Water Supplies (CWS)</b>										
<b>Rule Group</b>	<b>Chemical Sub-Group</b>	<b>MCLs</b>			<b>Monitoring/Notification</b>			<b>Treatment Technique</b>		
		<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
CHEM	VOC	1	0	1	1932	1281	57			
	SOC	0	0	0	751	252	29			
	IOC	0	0	0	14	12	9			
	NO2/NO3	10	8	10	3	1	3			
<b>CHEM Subtotal</b>		11	8	11	2700	1546	98			
<b>TCR Subtotal</b>		146	110	135	222	192	173			
<b>Stage 1 DBPR Subtotal</b>		0	0	0	14	10	7	0	0	0
<b>All SWTRs Subtotal</b>					12	0	1	0	0	0
<b>LCR Subtotal</b>					89	35	86	0	0	0
<b>Consumer Notification Subtotal</b>					0	0	0			
<b>TOTAL</b>		<b>157</b>	<b>118</b>	<b>144</b>	<b>3037</b>	<b>1783</b>	<b>287</b>	<b>0</b>	<b>0</b>	<b>0</b>
<b>Total Number of CWSs</b>				<b>Grand Total Number CWS Violations (MCL, Monitoring, and Treatment Technique)</b>				<b>Grand Total of CWSs in Violation (MCL, Monitoring, and Treatment Technique)</b>		
<b>4,218</b>				<b>3,194</b>				<b>394</b>		

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

## **Appendix B**

**The attached report identifies all public water supplies with maximum contaminant level and treatment technique violations in contaminant order.**

# *Appendix B*

## *Illinois EPA 2006 Annual Compliance*

### *Maximum Contaminant Level and Treatment Technique Violations*

#### *Listing by Contaminant*

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1190050 ALHAMBRA	<b>Arsenic MCL</b>	Returned to Compliance
IL1830050 ALVAN	<b>Arsenic MCL</b>	Returned to Compliance
IL0755150 BELMONT ACRES MWC	<b>Arsenic MCL</b>	Enforcement in process
IL1015300 BIRDS PINKSTAFF WATER DISTRICT	<b>Arsenic MCL</b>	Enforcement in process
IL0195865 CHAMPVIEW ESTATES	<b>Arsenic MCL</b>	Returned to Compliance
IL0450100 CHRISMAN	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0390050 CLINTON	<b>Arsenic MCL</b>	Returned to Compliance
IL1130400 COOKSVILLE	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL1130450 DANVERS	<b>Arsenic MCL</b>	Returned to Compliance
IL1470200 DE LAND	<b>Arsenic MCL</b>	Returned to Compliance
IL0390100 DE WITT	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0195945 FOUNTAIN VALLEY MHP	<b>Arsenic MCL</b>	Enforcement in process
IL0735600 GENESEO HILLS SUBDIVISION	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0990200 GRAND RIDGE	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0735220 HAZELWOOD HEIGHTS SUBDIVISION	<b>Arsenic MCL</b>	Returned to Compliance
IL0730080 HICKORY HILLS 2ND ADDITION WATER ASSN	<b>Arsenic MCL</b>	Returned to Compliance
IL0390200 KENNEY	<b>Arsenic MCL</b>	Returned to Compliance
IL1130750 LE ROY	<b>Arsenic MCL</b>	Returned to Compliance
IL0735280 LYNWOOD 3RD ADDITION	<b>Arsenic MCL</b>	Enforcement in process
IL1550200 MAGNOLIA	<b>Arsenic MCL</b>	Returned to Compliance
IL1150300 MAROA	<b>Arsenic MCL</b>	Returned to Compliance

# Appendix B

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Contaminant

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1250350 MASON CITY	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL1130850 MC LEAN	<b>Arsenic MCL</b>	Returned to Compliance
IL1795345 MORTON MOBILE HOME PARK	<b>Arsenic MCL</b>	Enforcement in process
IL0110800 OHIO	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0590300 RIDGWAY	<b>Arsenic MCL</b>	Returned to Compliance
IL1830800 ROSSVILLE	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0735500 RUSTIC ACRES WATER ASSOCIATION	<b>Arsenic MCL</b>	Enforcement in process
IL0115525 THE GROVE MHP	<b>Arsenic MCL</b>	Enforcement in process
IL2035225 TIMBERLINE MHP	<b>Arsenic MCL</b>	Enforcement in process
IL0991150 TONICA	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0195925 TRIANGLE MHP	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0370600 WATERMAN	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0750900 WATSEKA	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0390300 WAYNESVILLE	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0735120 WOLF RIDGE WELL CORPORATION	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL1570250 EVANSVILLE	<b>Atrazine MCL</b>	Under compliance commitment agreement/schedule
IL0314120 BARTLETT	<b>Barium MCL</b>	Returned to Compliance
IL1730100 FINDLAY	<b>Bromate MCL</b>	Returned to Compliance
IL3020636 BERTS AT OAKHILL	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL3124370 BLACKWELL F P (DW-18)	<b>Coliform (Acute) MCL</b>	Returned to Compliance



# Appendix B

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Contaminant

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL0450050 BROCTON	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL3102574 CAMP PINE 1047	<b>Coliform (Acute) MCL</b>	Enforcement in Process
IL3004903 CONDITS RANCH WEST WELL	<b>Coliform (Acute) MCL</b>	Enforcement in Process
IL3017038 CROWS NEST CAMPGROUND	<b>Coliform (Acute) MCL</b>	Enforcement in Process
IL0570500 FARMINGTON	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL3102665 FULLERTON WDS E GR2 3134	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL3117176 GIPPERS II	<b>Coliform (Acute) MCL</b>	Enforcement in Process
IL3133546 HARMS WAY	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL3062588 HARRISON ELEMENTARY SCHOOL	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL3126532 KOUNTRY KORNER (126532)	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL3006940 MARSHALL CO SPORTSMENS CLUB (6940)	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL1617665 PARADISE MANOR MHP	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL3149575 ST PAUL MISSIONARY CHURCH	<b>Coliform (Acute) MCL</b>	Enforcement in Process
IL3110023 STREATOR BAPTIST CAMP - OFFICE WELL	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL3022020 TYLER CREEK FOREST PRESERVE	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL3049031 3M CORDOVA PLANT	<b>Coliform MCL</b>	Enforcement in Process
IL1110050 ALGONQUIN	<b>Coliform MCL</b>	Returned to Compliance
IL3086132 ALLENDALE CONSERVATION CLUB (86132)	<b>Coliform MCL</b>	Returned to Compliance
IL3130526 ALPINE CHAPEL	<b>Coliform MCL</b>	Returned to Compliance
IL3148106 ALTO VINEYARD	<b>Coliform MCL</b>	Enforcement in Process
IL3002030 ANCIENT OAKS YOUTH CAMP	<b>Coliform MCL</b>	Enforcement in Process
IL3134056 ANTIOCH CONG OF JEHOVAHS WITN	<b>Coliform MCL</b>	Returned to Compliance

# *Appendix B*

## *Illinois EPA 2006 Annual Compliance*

### *Maximum Contaminant Level and Treatment Technique Violations*

#### *Listing by Contaminant*

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3000471 ANTIOCH MOTEL	<b>Coliform MCL</b>	Returned to Compliance
IL0850050 APPLE RIVER	<b>Coliform MCL</b>	Returned to Compliance
IL3005587 ARMSTRONG TWP HS	<b>Coliform MCL</b>	Returned to Compliance
IL0170100 ASHLAND	<b>Coliform MCL</b>	Returned to Compliance
IL3139485 AURORA WEST FOREST PRESERVE	<b>Coliform MCL</b>	Returned to Compliance
IL1090050 BARDOLPH	<b>Coliform MCL</b>	Returned to Compliance
IL3137802 BARELLOS ITALIAN BEEF	<b>Coliform MCL</b>	Returned to Compliance
IL3026807 BEACH PARK MARATHON	<b>Coliform MCL</b>	Returned to Compliance
IL3020636 BERTS AT OAKHILL	<b>Coliform MCL</b>	Returned to Compliance
IL3139618 BIG HOLLOW SCHOOL	<b>Coliform MCL</b>	Returned to Compliance
IL1015300 BIRDS PINKSTAFF WATER DISTRICT	<b>Coliform MCL</b>	Returned to Compliance
IL3134635 BLACK MARINE INC CAMPGROUND	<b>Coliform MCL</b>	Enforcement in Process
IL3066571 BLACKJACKS GW DAKOTAS CLUB	<b>Coliform MCL</b>	Returned to Compliance
IL3004648 BLANCHARD ISLAND PUA	<b>Coliform MCL</b>	Returned to Compliance
IL0895125 BREAZEALE MHP	<b>Coliform MCL</b>	Returned to Compliance
IL3142570 BRIMFIELD EVANGELICAL FREE CHURCH	<b>Coliform MCL</b>	Returned to Compliance
IL0450050 BROCTON	<b>Coliform MCL</b>	Returned to Compliance
IL3126060 BUBS PUB & GRUB/BILL HANUSA	<b>Coliform MCL</b>	Returned to Compliance
IL3010371 BULL HEADS INN (EAST WELL)	<b>Coliform MCL</b>	Returned to Compliance
IL3015404 BURNIDGE FOREST PRESERVE	<b>Coliform MCL</b>	Returned to Compliance
IL3001875 CAMP AKITA/A FRAME WELL	<b>Coliform MCL</b>	Returned to Compliance
IL3002105 CAMP TAPAWINGO	<b>Coliform MCL</b>	Returned to Compliance

# *Appendix B*

## *Illinois EPA 2006 Annual Compliance*

### *Maximum Contaminant Level and Treatment Technique Violations*

#### *Listing by Contaminant*

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3039735 CARMEL MONTESSORI ACADEMY	<b>Coliform MCL</b>	Returned to Compliance
IL3097634 CHAIN O LAKES/PIKE MARSH #8	<b>Coliform MCL</b>	Returned to Compliance
IL3108670 CHAMPAIGN MARATHON (108670)	<b>Coliform MCL</b>	Returned to Compliance
IL0195865 CHAMPVIEW ESTATES	<b>Coliform MCL</b>	Returned to Compliance
IL3063560 CHRIS COACH HOUSE TAP	<b>Coliform MCL</b>	Returned to Compliance
IL3148536 CHRIST ALIVE COMMUNITY CHURCH (148536)	<b>Coliform MCL</b>	Returned to Compliance
IL3115386 CLARK CPD MILL CREEK CAMPGROUN	<b>Coliform MCL</b>	Returned to Compliance
IL3134403 COMLARA PARK SHOWERHOUSE	<b>Coliform MCL</b>	Returned to Compliance
IL3147512 COMMUNITY BIBLE CHURCH	<b>Coliform MCL</b>	Returned to Compliance
IL3149252 COUNTRYSIDE PRIVATE SCHOOL	<b>Coliform MCL</b>	Enforcement in Process
IL1975105 CRISWELL COURT MHP	<b>Coliform MCL</b>	Returned to Compliance
IL3109876 CUSTERS KEG	<b>Coliform MCL</b>	Returned to Compliance
IL3123679 DAYTON TAP	<b>Coliform MCL</b>	Returned to Compliance
IL0390100 DE WITT	<b>Coliform MCL</b>	Returned to Compliance
IL3115048 DINGERS TAP	<b>Coliform MCL</b>	Returned to Compliance
IL3048678 DUCKYS LAGOON	<b>Coliform MCL</b>	Returned to Compliance
IL3094474 ELGIN COUNTRY CLUB HALFWAY HS	<b>Coliform MCL</b>	Enforcement in Process
IL3114843 ELIZA KOUNTRY KAFE	<b>Coliform MCL</b>	Returned to Compliance
IL3150094 EMMANUEL BAPTIST CHURCH	<b>Coliform MCL</b>	Returned to Compliance
IL3140210 ENVIROFIL OF ILLINOIS	<b>Coliform MCL</b>	Returned to Compliance
IL3055483 EXCEL FOUNDRY & MACHINE	<b>Coliform MCL</b>	Enforcement in Process
IL1615350 FAIRACRES ASSOCIATION	<b>Coliform MCL</b>	Returned to Compliance

# *Appendix B*

## *Illinois EPA 2006 Annual Compliance*

### *Maximum Contaminant Level and Treatment Technique Violations*

#### *Listing by Contaminant*

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3121103 FAITH BAPTIST CHURCH (121103)	<b>Coliform MCL</b>	Returned to Compliance
IL3122796 FAITH BAPTIST CHURCH (122796)	<b>Coliform MCL</b>	Enforcement in Process
IL0570500 FARMINGTON	<b>Coliform MCL</b>	Returned to Compliance
IL3029611 FOX RANCH TAVERN	<b>Coliform MCL</b>	Returned to Compliance
IL3032441 FULTON COUNTY CAMPING&REC AREA	<b>Coliform MCL</b>	Enforcement in Process
IL3073056 GLENWOOD FOREST PRESERVE	<b>Coliform MCL</b>	Returned to Compliance
IL1090250 GOOD HOPE	<b>Coliform MCL</b>	Returned to Compliance
IL3121533 GOODRICH JOHN DEERE EQUIPMENT	<b>Coliform MCL</b>	Returned to Compliance
IL3109660 GRACE LUTHERAN/SUE FOSDAL	<b>Coliform MCL</b>	Returned to Compliance
IL1035165 GREEN ACRES MHP	<b>Coliform MCL</b>	Returned to Compliance
IL1610300 HAMPTON	<b>Coliform MCL</b>	Returned to Compliance
IL3008342 HARDING GRADE SCHOOL	<b>Coliform MCL</b>	Returned to Compliance
IL3133546 HARMS WAY	<b>Coliform MCL</b>	Returned to Compliance
IL1190500 HARTFORD	<b>Coliform MCL</b>	Returned to Compliance
IL3130690 HARVARD SPORTSMAN CLUB	<b>Coliform MCL</b>	Returned to Compliance
IL1230050 HENRY	<b>Coliform MCL</b>	Returned to Compliance
IL3064287 HERITAGE HOUSE	<b>Coliform MCL</b>	Enforcement in Process
IL1795495 HIATTS HIDEAWAY MHP	<b>Coliform MCL</b>	Returned to Compliance
IL3121632 HILL & DELL OIL COMPANIES	<b>Coliform MCL</b>	Returned to Compliance
IL3009498 HILLS COUNTRY STORE	<b>Coliform MCL</b>	Returned to Compliance
IL3049049 HILLSDALE INN STEAK HOUSE	<b>Coliform MCL</b>	Returned to Compliance
IL3126565 HIS REST BED & BREAKFAST	<b>Coliform MCL</b>	Returned to Compliance
IL3133330 INDIAN SPRINGS GOLF CLUB	<b>Coliform MCL</b>	Returned to Compliance

# Appendix B

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Contaminant

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3057406 INDIAN SPRINGS RECREATION ASSN	<b>Coliform MCL</b>	Returned to Compliance
IL3093914 JUBILEE COLLEGE STATE HISTORIC	<b>Coliform MCL</b>	Returned to Compliance
IL0730650 KEWANEE	<b>Coliform MCL</b>	Returned to Compliance
IL3149120 KICKAPOO CREEK WINERY	<b>Coliform MCL</b>	Returned to Compliance
IL1995200 LAKE OF EGYPT PWD	<b>Coliform MCL</b>	Returned to Compliance
IL3068791 LEARNING TREE CHILD DEVEL CNTR	<b>Coliform MCL</b>	Returned to Compliance
IL0430551 LISLE	<b>Coliform MCL</b>	Returned to Compliance
IL3136192 LITTLE JOHN CONSERVATION CLUB	<b>Coliform MCL</b>	Enforcement in Process
IL3117085 LONDON PROPERTY LLC	<b>Coliform MCL</b>	Returned to Compliance
IL3126409 M P I & ASSOCIATES	<b>Coliform MCL</b>	Enforcement in Process
IL3150391 MAXEY CHAPEL UNITED METHODIST CHURCH	<b>Coliform MCL</b>	Returned to Compliance
IL0311830 MAYWOOD	<b>Coliform MCL</b>	Returned to Compliance
IL3057240 MC HENRY EARLY LEARNING CENTER	<b>Coliform MCL</b>	Returned to Compliance
IL3032979 MCDUCKS	<b>Coliform MCL</b>	Returned to Compliance
IL3100768 MEADOWLARK GOLF COURSE	<b>Coliform MCL</b>	Enforcement in Process
IL3113431 MIDDLE FORK RIVER FOREST PRESV	<b>Coliform MCL</b>	Returned to Compliance
IL3022657 MOBIL GAS FOOD MART #18	<b>Coliform MCL</b>	Returned to Compliance
IL3073049 MONTESSORI ACADEMY	<b>Coliform MCL</b>	Enforcement in Process
IL3148429 MONTESSORI ACADEMY GLEN ELLYN	<b>Coliform MCL</b>	Returned to Compliance
IL1790500 MORTON	<b>Coliform MCL</b>	Returned to Compliance
IL3134338 MOST HOLY MORTH OF GOD/MONASTE	<b>Coliform MCL</b>	Returned to Compliance
IL1910350 MOUNT ERIE	<b>Coliform MCL</b>	Returned to Compliance

# *Appendix B*

## *Illinois EPA 2006 Annual Compliance*

### *Maximum Contaminant Level and Treatment Technique Violations*

#### *Listing by Contaminant*

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL0110700 NEPONSET	<b>Coliform MCL</b>	Returned to Compliance
IL0995250 OAKLANE SBDV	<b>Coliform MCL</b>	Returned to Compliance
IL3005595 OAKWOOD JR HIGH SCHOOL	<b>Coliform MCL</b>	Returned to Compliance
IL0430010 OBT SERVICE CORPORATION	<b>Coliform MCL</b>	Returned to Compliance
IL3147587 OPEN HEARTS FOURSQUARE CHURCH	<b>Coliform MCL</b>	Returned to Compliance
IL1617665 PARADISE MANOR MHP	<b>Coliform MCL</b>	Returned to Compliance
IL1434750 PEORIA HEIGHTS	<b>Coliform MCL</b>	Returned to Compliance
IL3127761 PETER RABBIT DAY CARE SCOOOL	<b>Coliform MCL</b>	Returned to Compliance
IL3115808 PETES FAMOUS HOT DOGS	<b>Coliform MCL</b>	Returned to Compliance
IL0971180 PINE VIEW APARTMENTS	<b>Coliform MCL</b>	Returned to Compliance
IL3137018 PLEASANT VALLEY LAKES/RDHOUSE	<b>Coliform MCL</b>	Returned to Compliance
IL3005397 PONTIAC CHRISTIAN SCHOOL	<b>Coliform MCL</b>	Returned to Compliance
IL3005256 PRAIRIEVIEW JR. HIGH SCHOOL	<b>Coliform MCL</b>	Returned to Compliance
IL1890450 RADOM	<b>Coliform MCL</b>	Returned to Compliance
IL3139303 RANDALL OAKS PARK COMM SHELTER	<b>Coliform MCL</b>	Returned to Compliance
IL3076604 RED OAK NATURE CENTER	<b>Coliform MCL</b>	Returned to Compliance
IL2030550 ROANOKE	<b>Coliform MCL</b>	Returned to Compliance
IL0312700 ROBBINS	<b>Coliform MCL</b>	Returned to Compliance
IL3005413 ROOKS CREEK ELEMENTARY SCHOOL	<b>Coliform MCL</b>	Returned to Compliance
IL0971550 ROUND LAKE BEACH	<b>Coliform MCL</b>	Returned to Compliance
IL3037606 SCOOBYS RED HOTS	<b>Coliform MCL</b>	Returned to Compliance
IL3126821 SHERIDAN ROD & GUN	<b>Coliform MCL</b>	Enforcement in Process
IL1615750 SILVIS HEIGHTS WATER CORP	<b>Coliform MCL</b>	Returned to Compliance

# ***Appendix B***

## *Illinois EPA 2006 Annual Compliance*

### *Maximum Contaminant Level and Treatment Technique Violations*

#### *Listing by Contaminant*

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3150029 SIM PRODUCTS	<b>Coliform MCL</b>	Returned to Compliance
IL3064451 SNAP ON TOOLS	<b>Coliform MCL</b>	Returned to Compliance
IL3117226 SNOOKERS	<b>Coliform MCL</b>	Returned to Compliance
IL0275250 ST ROSE PWD	<b>Coliform MCL</b>	Returned to Compliance
IL3113480 SUN -N- FUN SWIM & GOLF CLUB	<b>Coliform MCL</b>	Returned to Compliance
IL3137422 SUNRISE RESTAURANT	<b>Coliform MCL</b>	Returned to Compliance
IL3009613 SUTTERS COUNTRY KITCHEN	<b>Coliform MCL</b>	Enforcement in Process
IL1315200 SWEDONA WATER ASSOCIATION	<b>Coliform MCL</b>	Returned to Compliance
IL3037150 TASSOS RESTAURANT	<b>Coliform MCL</b>	Returned to Compliance
IL0971210 TERRACE OAK APARTMENTS	<b>Coliform MCL</b>	Returned to Compliance
IL3133355 TESKES PET AND GARDEN CENTER	<b>Coliform MCL</b>	Returned to Compliance
IL3048884 THE MUTINY PUB	<b>Coliform MCL</b>	Enforcement in Process
IL3123612 THE WEDRON OFFICE	<b>Coliform MCL</b>	Returned to Compliance
IL3038331 TRAFFIC CONTROL AND PROTECTION	<b>Coliform MCL</b>	Returned to Compliance
IL0270500 TRENTON	<b>Coliform MCL</b>	Returned to Compliance
IL3104000 USFS JOHNSON CREEK RECREATION AREA	<b>Coliform MCL</b>	Enforcement in Process
IL3129361 VAN PATTON WOODS HAND PUMP #10	<b>Coliform MCL</b>	Returned to Compliance
IL3129353 VAN PATTON WOODS HAND PUMP #9	<b>Coliform MCL</b>	Enforcement in Process
IL3129395 VAN PATTON WOODS HANDPUMP #4	<b>Coliform MCL</b>	Enforcement in Process
IL3005777 VICTORY BAPTIST CHURCH	<b>Coliform MCL</b>	Returned to Compliance
IL3015206 WAA-KEE-SHA PARK	<b>Coliform MCL</b>	Returned to Compliance
IL3060285 WALNUT GR UNITED METHODIST CHU	<b>Coliform MCL</b>	Enforcement in Process

# Appendix B

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Contaminant

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3041459 WARRENVILLE TOWN TAP LIQUOR	<b>Coliform MCL</b>	Returned to Compliance
IL3129619 WASTE MANAGEMENT NORTH	<b>Coliform MCL</b>	Returned to Compliance
IL0750900 WATSEKA	<b>Coliform MCL</b>	Returned to Compliance
IL3140830 WAYNE PRINTING COMPANY	<b>Coliform MCL</b>	Returned to Compliance
IL3135962 WCFP LINCOLN HWY MOKENA PUMP 2	<b>Coliform MCL</b>	Returned to Compliance
IL3149229 WESTERN ILLINOIS NATURE GROUP	<b>Coliform MCL</b>	Returned to Compliance
IL3000851 WHITE OAKS CAMPGROUND	<b>Coliform MCL</b>	Returned to Compliance
IL3119768 WINDMILLS GOLF COURSE	<b>Coliform MCL</b>	Returned to Compliance
IL1770550 WINSLOW	<b>Coliform MCL</b>	Returned to Compliance
IL3056499 WOLF CREEK GOLF COURSE	<b>Coliform MCL</b>	Returned to Compliance
IL3014282 WOLFCREEK COUNTRY CLUB	<b>Coliform MCL</b>	Returned to Compliance
IL3115287 WOODFORD COUNTY IZAAK WALTON	<b>Coliform MCL</b>	Enforcement in Process
IL1977210 AQUA ILLINOIS-OAKVIEW	<b>Combined Radium MCL</b>	Purchase water
IL1035100 AQUA ILLINOIS-WOODHAVEN	<b>Combined Radium MCL</b>	Returned to Compliance
IL0314120 BARTLETT	<b>Combined Radium MCL</b>	Returned to Compliance
IL0894130 BATAVIA	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL0710050 BIGGSVILLE	<b>Combined Radium MCL</b>	Enforcement in process
IL0895125 BREAZEALE MHP	<b>Combined Radium MCL</b>	Inactive
IL0570200 BRYANT	<b>Combined Radium MCL</b>	Enforcement in process
IL0110150 BUREAU JUNCTION	<b>Combined Radium MCL</b>	Returned to Compliance
IL1610100 CARBON CLIFF	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL1970070 CHANNAHON EAST	<b>Combined Radium MCL</b>	Purchase water
IL0370051 CORTLAND	<b>Combined Radium MCL</b>	Enforcement in process



# Appendix B

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Contaminant

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1030200 DIXON	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL1435150 EDELSTEIN WATER COOP	<b>Combined Radium MCL</b>	Enforcement in process
IL0890300 ELBURN	<b>Combined Radium MCL</b>	Returned to Compliance
IL0975736 ELM OAK MUTUAL WATER SYSTEM	<b>Combined Radium MCL</b>	Enforcement in process
IL0995110 FOUR LAKES SUBDIVISION	<b>Combined Radium MCL</b>	Returned to Compliance
IL0990060 FOUR STAR CAMPGROUND	<b>Combined Radium MCL</b>	Enforcement in process
IL2015495 GEM SUBURBAN MHP	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL0890350 GENEVA	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL1430350 GLASFORD	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL0890450 HAMPSHIRE	<b>Combined Radium MCL</b>	Returned to Compliance
IL1030300 HARMON	<b>Combined Radium MCL</b>	Returned to Compliance
IL0995300 IL PRAIRIE ESTATE SBDV WATER ASSOCIATION	<b>Combined Radium MCL</b>	Returned to Compliance
IL1970450 JOLIET	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL1977930 JOLIET CORRECTIONAL CENTER	<b>Combined Radium MCL</b>	Returned to Compliance
IL1430450 KINGSTON MINES	<b>Combined Radium MCL</b>	Enforcement in process
IL0630450 KINSMAN	<b>Combined Radium MCL</b>	Returned to Compliance
IL1870050 KIRKWOOD	<b>Combined Radium MCL</b>	Returned to Compliance
IL0970850 LAKE ZURICH	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL1870100 LITTLE YORK	<b>Combined Radium MCL</b>	Returned to Compliance
IL2010150 LOVES PARK	<b>Combined Radium MCL</b>	Returned to Compliance
IL0995336 LYNNWOOD WATER CORPORATION	<b>Combined Radium MCL</b>	Enforcement in process

# Appendix B

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Contaminant

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1970550 MANHATTAN	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL0990500 MARSEILLES	<b>Combined Radium MCL</b>	Returned to Compliance
IL0990550 MENDOTA	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL0935140 MORGAN CREEK	<b>Combined Radium MCL</b>	Returned to Compliance
IL1410350 MOUNT MORRIS	<b>Combined Radium MCL</b>	Enforcement in process
IL0990600 NAPLATE	<b>Combined Radium MCL</b>	Enforcement in process
IL0110700 NEPONSET	<b>Combined Radium MCL</b>	Enforcement in process
IL0890600 NORTH AURORA	<b>Combined Radium MCL</b>	Enforcement in process
IL0990650 NORTH UTICA	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL0930150 OSWEGO	<b>Combined Radium MCL</b>	Returned to Compliance
IL0630060 PRAIRIE OAKS ESTS HOMEOWNERS ASSN	<b>Combined Radium MCL</b>	Returned to Compliance
IL0971100 PROVIDENCE AT PAINTED LAKES	<b>Combined Radium MCL</b>	Returned to Compliance
IL0990900 RANSOM	<b>Combined Radium MCL</b>	Enforcement in process
IL0914780 REDDICK	<b>Combined Radium MCL</b>	Enforcement in process
IL1970850 ROCKDALE	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL2010300 ROCKFORD	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL2010350 ROCKTON	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL0890040 SILVER GLEN ESTS	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL1610700 SILVIS	<b>Combined Radium MCL</b>	Returned to Compliance
IL1550300 STANDARD	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL0310080 SUNSET MHP	<b>Combined Radium MCL</b>	Returned to Compliance

# Appendix B

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Contaminant

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL0370550 SYCAMORE	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL1775255 TIMBER RIDGE MOBILE ESTATES	<b>Combined Radium MCL</b>	Returned to Compliance
IL1110900 UNION	<b>Combined Radium MCL</b>	Returned to Compliance
IL2015160 UTL INC-COVENTRY CREEK SUBDIVISION	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL0855050 UTL INC-GALENA TERRITORY UTILITES	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL1310450 VIOLA	<b>Combined Radium MCL</b>	Returned to Compliance
IL0995425 WILDLIFE MHP	<b>Combined Radium MCL</b>	Enforcement in process
IL0970080 WYNSTONE WATER COMPANY	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL0930250 YORKVILLE	<b>Combined Radium MCL</b>	Returned to Compliance
IL3132670 ALIBI	<b>E. Coli (Acute) MCL</b>	Returned to Compliance
IL3134106 AURORA ATHLETIC CLUB	<b>E. Coli (Acute) MCL</b>	Enforcement in Process
IL3108852 BAD GIRLS	<b>E. Coli (Acute) MCL</b>	Enforcement in Process
IL3102863 BONANZA CAMPGROUND #2	<b>E. Coli (Acute) MCL</b>	Enforcement in Process
IL3073890 CHE CHE PIN QUA GR 1 3083	<b>E. Coli (Acute) MCL</b>	Enforcement in Process
IL3148536 CHRIST ALIVE COMMUNITY CHURCH (148536)	<b>E. Coli (Acute) MCL</b>	Returned to Compliance
IL3121707 DAKOTAS BAR & GRILL	<b>E. Coli (Acute) MCL</b>	Enforcement in Process
IL3121061 DEER GROVE EAST HP 1004	<b>E. Coli (Acute) MCL</b>	Enforcement in Process
IL3042440 KNIGHTS OF COLUMBUS (42440)	<b>E. Coli (Acute) MCL</b>	Enforcement in Process
IL3117622 MI CASA	<b>E. Coli (Acute) MCL</b>	Enforcement in Process
IL3106278 MISSISSIPPI PALISADES ST PARK (106278)	<b>E. Coli (Acute) MCL</b>	Enforcement in Process
IL3148114 THE GLASS DOOR	<b>E. Coli (Acute) MCL</b>	Returned to Compliance
IL0270050 ALBERS	<b>Failure to install OCCT</b>	Returned to Compliance

# Appendix B

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Contaminant

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1610300 HAMPTON	<b>Fecal Coliform MCL</b>	Returned to Compliance
IL1977210 AQUA ILLINOIS-OAKVIEW	<b>Gross Alpha MCL</b>	Returned to Compliance
IL0894130 BATAVIA	<b>Gross Alpha MCL</b>	Returned to Compliance
IL0710050 BIGGSVILLE	<b>Gross Alpha MCL</b>	Enforcement in process
IL1030200 DIXON	<b>Gross Alpha MCL</b>	Returned to Compliance
IL1435150 EDELSTEIN WATER COOP	<b>Gross Alpha MCL</b>	Enforcement in process
IL1971150 FOSSIL ROCK RECREATION AREA	<b>Gross Alpha MCL</b>	Under compliance commitment agreement/schedule
IL0890350 GENEVA	<b>Gross Alpha MCL</b>	Under compliance commitment agreement/schedule
IL1430350 GLASFORD	<b>Gross Alpha MCL</b>	Under compliance commitment agreement/schedule
IL1030300 HARMON	<b>Gross Alpha MCL</b>	Returned to Compliance
IL0995300 IL PRAIRIE ESTATE SBDV WATER ASSOCIATION	<b>Gross Alpha MCL</b>	Returned to Compliance
IL1970450 JOLIET	<b>Gross Alpha MCL</b>	Returned to Compliance
IL1430450 KINGSTON MINES	<b>Gross Alpha MCL</b>	Enforcement in process
IL1870100 LITTLE YORK	<b>Gross Alpha MCL</b>	Returned to Compliance
IL0110700 NEPONSET	<b>Gross Alpha MCL</b>	Enforcement in process
IL2010300 ROCKFORD	<b>Gross Alpha MCL</b>	Returned to Compliance
IL1610700 SILVIS	<b>Gross Alpha MCL</b>	Returned to Compliance
IL1550300 STANDARD	<b>Gross Alpha MCL</b>	Under compliance commitment agreement/schedule
IL0930250 YORKVILLE	<b>Gross Alpha MCL</b>	Returned to Compliance
IL0610150 GREENFIELD	<b>Inadequate DBP Precursor Removal TT</b>	Returned to Compliance
IL1175150 PALMYRA-MODESTO WATER COMMISSION	<b>Inadequate DBP Precursor Removal TT</b>	Returned to Compliance
IL1370040 APPLE CREEK WATER COOP	<b>Insufficient Inactivation TT</b>	Purchase Water

# Appendix B

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Contaminant

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1610250 EAST MOLINE	<b>Insufficient Inactivation TT</b>	Returned to Compliance
IL0670500 NAUVOO	<b>Insufficient Inactivation TT</b>	Returned to Compliance
IL0350150 NEOGA	<b>Insufficient Inactivation TT</b>	Under compliance commitment agreement/schedule
IL1670800 NEW BERLIN	<b>Insufficient Inactivation TT</b>	Under compliance commitment agreement/schedule
IL1175150 PALMYRA-MODESTO WATER COMMISSION	<b>Insufficient Inactivation TT</b>	Returned to Compliance
IL1370450 WAVERLY	<b>Insufficient Inactivation TT</b>	Under compliance commitment agreement/schedule
IL0410050 ARCOLA	<b>Lead Public Education TT</b>	Returned to Compliance
IL1070050 ATLANTA	<b>Lead Public Education TT</b>	Returned to Compliance
IL1990200 COLP	<b>Lead Public Education TT</b>	Returned to Compliance
IL0530350 ROBERTS	<b>Lead Public Education TT</b>	Returned to Compliance
IL1190120 SUNNY SHORES MHP	<b>Lead Public Education TT</b>	Returned to Compliance
IL0971170 UNIVERSITY ST MARY OF THE LAKE	<b>Lead Public Education TT</b>	Returned to Compliance
IL0975370 UTL INC-DEL-MAR WATER COMPANY	<b>Lead Public Education TT</b>	Returned to Compliance
IL1090050 BARDOLPH	<b>Monthly Combined Filter Effluent TT</b>	Returned to Compliance
IL1090200 COLCHESTER	<b>Monthly Combined Filter Effluent TT</b>	Returned to Compliance
IL1090350 MACOMB	<b>Monthly Combined Filter Effluent TT</b>	Returned to Compliance
IL0350150 NEOGA	<b>Monthly Combined Filter Effluent TT</b>	Returned to Compliance
IL1171050 STAUNTON	<b>Monthly Combined Filter Effluent TT</b>	Returned to Compliance
IL1095510 WESTERN ILLINOIS UNIVERSITY	<b>Monthly Combined Filter Effluent TT</b>	Returned to Compliance
IL3138784 BETHEL BAPTIST CHURCH	<b>Nitrate MCL</b>	Returned to Compliance

# Appendix B

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Contaminant

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3085803 CAMP HAUBERG (85803) SOUTH WELL	<b>Nitrate MCL</b>	Returned to Compliance
IL3055483 EXCEL FOUNDRY & MACHINE	<b>Nitrate MCL</b>	Returned to Compliance
IL3110304 FIN AND FEATHER CAMPING RESORT (110304)	<b>Nitrate MCL</b>	Enforcement in Process
IL3136614 MISS NETTIES DOUBLE J	<b>Nitrate MCL</b>	Returned to Compliance
IL3001164 PEORIA SPORTSMENS CLUB	<b>Nitrate MCL</b>	Enforcement in Process
IL0275250 ST ROSE PWD	<b>Nitrate MCL</b>	Returned to Compliance
IL3060285 WALNUT GR UNITED METHODIST CHU	<b>Nitrate MCL</b>	Returned to Compliance
IL3149567 WESTERN ILLINOIS BOAT CLUB	<b>Nitrate MCL</b>	Returned to Compliance
IL3124024 CATLIN IGA R/O UNIT	<b>Nitrite MCL</b>	Returned to Compliance
IL1470250 HAMMOND	<b>Nitrite MCL</b>	Returned to Compliance
IL3146696 MOBIL SUPER PANTRY CLINTON	<b>Nitrite MCL</b>	Returned to Compliance
IL1210400 PATOKA	<b>Simazine MCL</b>	Returned to Compliance
IL0270050 ALBERS	<b>Total Haloacetic Acids MCL</b>	Under compliance commitment agreement/schedule
IL1815150 ALTO PASS WATER DISTRICT	<b>Total Haloacetic Acids MCL</b>	Under compliance commitment agreement/schedule
IL1170150 CARLINVILLE	<b>Total Haloacetic Acids MCL</b>	Returned to Compliance
IL1170040 CENTRAL MACOUPIN COUNTY RWD	<b>Total Haloacetic Acids MCL</b>	Returned to Compliance
IL1210400 PATOKA	<b>Total Haloacetic Acids MCL</b>	Returned to Compliance
IL0510100 BROWNSTOWN	<b>Total Trihalomethane MCL</b>	Returned to Compliance
IL1170040 CENTRAL MACOUPIN COUNTY RWD	<b>Total Trihalomethane MCL</b>	Returned to Compliance
IL1670550 ILLIOPOLIS	<b>Total Trihalomethane MCL</b>	Returned to Compliance
IL1170550 MEDORA	<b>Total Trihalomethane MCL</b>	Returned to Compliance
IL0054720 PANAMA	<b>Total Trihalomethane MCL</b>	Returned to Compliance

# *Appendix B*

## *Illinois EPA 2006 Annual Compliance*

### *Maximum Contaminant Level and Treatment Technique Violations*

#### *Listing by Contaminant*

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL0515500 VANDALIA CORRECTIONAL CENTER	<b>Total Trihalomethane MCL</b>	Under compliance commitment agreement/schedule
IL0670650 WARSAW	<b>Total Trihalomethane MCL</b>	Returned to Compliance
IL3138776 MATHEWS COMPANY	<b>Trichloroethylene MCL</b>	Enforcement in Process

## **Appendix C**

**The attached report identifies all public water supplies with maximum contaminant level and treatment technique violations in system name alpha order.**



# Appendix C

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Water Supply

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3049031 <b>3M CORDOVA PLANT</b>	Coliform MCL	Enforcement in Process
IL0270050 <b>ALBERS</b>	Failure to install OCCT	Returned to Compliance
IL0270050 <b>ALBERS</b>	Total Haloacetic Acids MCL	Under compliance commitment agreement/schedule
IL1110050 <b>ALGONQUIN</b>	Coliform MCL	Returned to Compliance
IL1190050 <b>ALHAMBRA</b>	Arsenic MCL	Returned to Compliance
IL3132670 <b>ALIBI</b>	E. Coli (Acute) MCL	Returned to Compliance
IL3086132 <b>ALLENDALE CONSERVATION CLUB (86132)</b>	Coliform MCL	Returned to Compliance
IL3130526 <b>ALPINE CHAPEL</b>	Coliform MCL	Returned to Compliance
IL1815150 <b>ALTO PASS WATER DISTRICT</b>	Total Haloacetic Acids MCL	Under compliance commitment agreement/schedule
IL3148106 <b>ALTO VINEYARD</b>	Coliform MCL	Enforcement in Process
IL1830050 <b>ALVAN</b>	Arsenic MCL	Returned to Compliance
IL3002030 <b>ANCIENT OAKS YOUTH CAMP</b>	Coliform MCL	Enforcement in Process
IL3134056 <b>ANTIOCH CONG OF JEHOVAHS WITN</b>	Coliform MCL	Returned to Compliance
IL3000471 <b>ANTIOCH MOTEL</b>	Coliform MCL	Returned to Compliance
IL1370040 <b>APPLE CREEK WATER COOP</b>	Insufficient Inactivation TT	Purchase Water
IL0850050 <b>APPLE RIVER</b>	Coliform MCL	Returned to Compliance
IL1977210 <b>AQUA ILLINOIS-OAKVIEW</b>	Combined Radium MCL	Purchase water
IL1977210 <b>AQUA ILLINOIS-OAKVIEW</b>	Gross Alpha MCL	Returned to Compliance
IL1035100 <b>AQUA ILLINOIS-WOODHAVEN</b>	Combined Radium MCL	Returned to Compliance
IL0410050 <b>ARCOLA</b>	Lead Public Education TT	Returned to Compliance
IL3005587 <b>ARMSTRONG TWP HS</b>	Coliform MCL	Returned to Compliance
IL0170100 <b>ASHLAND</b>	Coliform MCL	Returned to Compliance

# Appendix C

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Water Supply

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1070050 <b>ATLANTA</b>	Lead Public Education TT	Returned to Compliance
IL3134106 <b>AURORA ATHLETIC CLUB</b>	E. Coli (Acute) MCL	Enforcement in Process
IL3139485 <b>AURORA WEST FOREST PRESERVE</b>	Coliform MCL	Returned to Compliance
IL3108852 <b>BAD GIRLS</b>	E. Coli (Acute) MCL	Enforcement in Process
IL1090050 <b>BARDOLPH</b>	Coliform MCL	Returned to Compliance
IL1090050 <b>BARDOLPH</b>	Monthly Combined Filter Effluent TT	Returned to Compliance
IL3137802 <b>BARELLOS ITALIAN BEEF</b>	Coliform MCL	Returned to Compliance
IL0314120 <b>BARTLETT</b>	Barium MCL	Returned to Compliance
IL0314120 <b>BARTLETT</b>	Combined Radium MCL	Returned to Compliance
IL0894130 <b>BATAVIA</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL0894130 <b>BATAVIA</b>	Gross Alpha MCL	Returned to Compliance
IL3026807 <b>BEACH PARK MARATHON</b>	Coliform MCL	Returned to Compliance
IL0755150 <b>BELMONT ACRES MWC</b>	Arsenic MCL	Enforcement in process
IL3020636 <b>BERTS AT OAKHILL</b>	Coliform (Acute) MCL	Returned to Compliance
IL3020636 <b>BERTS AT OAKHILL</b>	Coliform MCL	Returned to Compliance
IL3138784 <b>BETHEL BAPTIST CHURCH (138784)</b>	Nitrate MCL	Returned to Compliance
IL3139618 <b>BIG HOLLOW SCHOOL</b>	Coliform MCL	Returned to Compliance
IL0710050 <b>BIGGSVILLE</b>	Combined Radium MCL	Enforcement in process
IL0710050 <b>BIGGSVILLE</b>	Gross Alpha MCL	Enforcement in process
IL1015300 <b>BIRDS PINKSTAFF WATER DISTRICT</b>	Arsenic MCL	Enforcement in process
IL1015300 <b>BIRDS PINKSTAFF WATER DISTRICT</b>	Coliform MCL	Returned to Compliance

# Appendix C

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Water Supply

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3134635 <b>BLACK MARINE INC CAMPGROUND</b>	Coliform MCL	Enforcement in Process
IL3066571 <b>BLACKJACKS GW DAKOTAS CLUB</b>	Coliform MCL	Returned to Compliance
IL3124370 <b>BLACKWELL F P (DW-18)</b>	Coliform (Acute) MCL	Returned to Compliance
IL3004648 <b>BLANCHARD ISLAND PUA</b>	Coliform MCL	Returned to Compliance
IL3102863 <b>BONANZA CAMPGROUND #2</b>	E. Coli (Acute) MCL	Enforcement in Process
IL0895125 <b>BREAZEALE MHP</b>	Coliform MCL	Returned to Compliance
IL0895125 <b>BREAZEALE MHP</b>	Combined Radium MCL	Inactive
IL3142570 <b>BRIMFIELD EVANGELICAL FREE CHURCH</b>	Coliform MCL	Returned to Compliance
IL0450050 <b>BROCTON</b>	Coliform (Acute) MCL	Returned to Compliance
IL0450050 <b>BROCTON</b>	Coliform MCL	Returned to Compliance
IL0510100 <b>BROWNSTOWN</b>	Total Trihalomethane MCL	Returned to Compliance
IL0570200 <b>BRYANT</b>	Combined Radium MCL	Enforcement in process
IL3126060 <b>BUBS PUB &amp; GRUB/BILL HANUSA</b>	Coliform MCL	Returned to Compliance
IL3010371 <b>BULL HEADS INN (EAST WELL)</b>	Coliform MCL	Returned to Compliance
IL0110150 <b>BUREAU JUNCTION</b>	Combined Radium MCL	Returned to Compliance
IL3015404 <b>BURNIDGE FOREST PRESERVE</b>	Coliform MCL	Returned to Compliance
IL3001875 <b>CAMP AKITA/A FRAME WELL</b>	Coliform MCL	Returned to Compliance
IL3085803 <b>CAMP HAUBERG (85803) SOUTH WELL</b>	Nitrate MCL	Returned to Compliance
IL3102574 <b>CAMP PINE</b> <b>1047</b>	Coliform (Acute) MCL	Enforcement in Process
IL3002105 <b>CAMP TAPAWINGO</b>	Coliform MCL	Returned to Compliance

# Appendix C

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Water Supply

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1610100 <b>CARBON CLIFF</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL1170150 <b>CARLINVILLE</b>	Total Haloacetic Acids MCL	Returned to Compliance
IL3039735 <b>CARMEL MONTESSORI ACADEMY</b>	Coliform MCL	Returned to Compliance
IL3124024 <b>CATLIN IGA R/O UNIT</b>	Nitrite MCL	Returned to Compliance
IL1170040 <b>CENTRAL MACOUPIN COUNTY RWD</b>	Total Haloacetic Acids MCL	Returned to Compliance
IL1170040 <b>CENTRAL MACOUPIN COUNTY RWD</b>	Total Trihalomethane MCL	Returned to Compliance
IL3097634 <b>CHAIN O LAKES/PIKE MARSH #8</b>	Coliform MCL	Returned to Compliance
IL3108670 <b>CHAMPAIGN MARATHON (108670)</b>	Coliform MCL	Returned to Compliance
IL0195865 <b>CHAMPVIEW ESTATES</b>	Arsenic MCL	Returned to Compliance
IL0195865 <b>CHAMPVIEW ESTATES</b>	Coliform MCL	Returned to Compliance
IL1970070 <b>CHANNAHON EAST</b>	Combined Radium MCL	Purchase water
IL3073890 <b>CHE CHE PIN QUA GR 1 3083</b>	E. Coli (Acute) MCL	Enforcement in Process
IL3063560 <b>CHRIS COACH HOUSE TAP</b>	Coliform MCL	Returned to Compliance
IL0450100 <b>CHRISMAN</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL3148536 <b>CHRIST ALIVE COMMUNITY CHURCH (148536)</b>	Coliform MCL	Returned to Compliance
IL3148536 <b>CHRIST ALIVE COMMUNITY CHURCH (148536)</b>	E. Coli (Acute) MCL	Returned to Compliance
IL3115386 <b>CLARK CPD MILL CREEK CAMPGROUN</b>	Coliform MCL	Returned to Compliance
IL0390050 <b>CLINTON</b>	Arsenic MCL	Returned to Compliance
IL1090200 <b>COLCHESTER</b>	Monthly Combined Filter Effluent TT	Returned to Compliance

Tuesday, July 31, 2007

Page 4 of 18

# Appendix C

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Water Supply

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1990200 <b>COLP</b>	Lead Public Education TT	Returned to Compliance
IL3134403 <b>COMLARA PARK SHOWERHOUSE</b>	Coliform MCL	Returned to Compliance
IL3147512 <b>COMMUNITY BIBLE CHURCH</b>	Coliform MCL	Returned to Compliance
IL3004903 <b>CONDITS RANCH WEST WELL</b>	Coliform (Acute) MCL	Enforcement in Process
IL1130400 <b>COOKSVILLE</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL0370051 <b>CORTLAND</b>	Combined Radium MCL	Enforcement in process
IL3149252 <b>COUNTRYSIDE PRIVATE SCHOOL</b>	Coliform MCL	Enforcement in Process
IL1975105 <b>CRISWELL COURT MHP</b>	Coliform MCL	Returned to Compliance
IL3017038 <b>CROWS NEST CAMPGROUND</b>	Coliform (Acute) MCL	Enforcement in Process
IL3109876 <b>CUSTERS KEG</b>	Coliform MCL	Returned to Compliance
IL3121707 <b>DAKOTAS BAR &amp; GRILL</b>	E. Coli (Acute) MCL	Enforcement in Process
IL1130450 <b>DANVERS</b>	Arsenic MCL	Returned to Compliance
IL3123679 <b>DAYTON TAP</b>	Coliform MCL	Returned to Compliance
IL1470200 <b>DE LAND</b>	Arsenic MCL	Returned to Compliance
IL0390100 <b>DE WITT</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL0390100 <b>DE WITT</b>	Coliform MCL	Returned to Compliance
IL3121061 <b>DEER GROVE EAST HP 1004</b>	E. Coli (Acute) MCL	Enforcement in Process
IL3115048 <b>DINGERS TAP</b>	Coliform MCL	Returned to Compliance
IL1030200 <b>DIXON</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL1030200 <b>DIXON</b>	Gross Alpha MCL	Returned to Compliance
IL3048678 <b>DUCKYS LAGOON</b>	Coliform MCL	Returned to Compliance
IL1610250 <b>EAST MOLINE</b>	Insufficient Inactivation TT	Returned to Compliance

# Appendix C

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Water Supply

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1435150 <b>EDELSTEIN WATER COOP</b>	Combined Radium MCL	Enforcement in process
IL1435150 <b>EDELSTEIN WATER COOP</b>	Gross Alpha MCL	Enforcement in process
IL0890300 <b>ELBURN</b>	Combined Radium MCL	Returned to Compliance
IL3094474 <b>ELGIN COUNTRY CLUB HALFWAY HS</b>	Coliform MCL	Enforcement in Process
IL3114843 <b>ELIZA KOUNTRY KAFE</b>	Coliform MCL	Returned to Compliance
IL0975736 <b>ELM OAK MUTUAL WATER SYSTEM</b>	Combined Radium MCL	Enforcement in process
IL3150094 <b>EMMANUEL BAPTIST CHURCH</b>	Coliform MCL	Returned to Compliance
IL3140210 <b>ENVIROFIL OF ILLINOIS</b>	Coliform MCL	Returned to Compliance
IL1570250 <b>EVANSVILLE</b>	Atrazine MCL	Under compliance commitment agreement/schedule
IL3055483 <b>EXCEL FOUNDRY &amp; MACHINE</b>	Coliform MCL	Enforcement in Process
IL3055483 <b>EXCEL FOUNDRY &amp; MACHINE</b>	Nitrate MCL	Returned to Compliance
IL1615350 <b>FAIRACRES ASSOCIATION</b>	Coliform MCL	Returned to Compliance
IL3121103 <b>FAITH BAPTIST CHURCH (121103)</b>	Coliform MCL	Returned to Compliance
IL3122796 <b>FAITH BAPTIST CHURCH (122796)</b>	Coliform MCL	Enforcement in Process
IL0570500 <b>FARMINGTON</b>	Coliform (Acute) MCL	Returned to Compliance
IL0570500 <b>FARMINGTON</b>	Coliform MCL	Returned to Compliance
IL3110304 <b>FIN AND FEATHER CAMPING RESORT (110304)</b>	Nitrate MCL	Enforcement in Process
IL1730100 <b>FINDLAY</b>	Bromate MCL	Returned to Compliance
IL1971150 <b>FOSSIL ROCK RECREATION AREA</b>	Gross Alpha MCL	Under compliance commitment agreement/schedule
IL0195945 <b>FOUNTAIN VALLEY MHP</b>	Arsenic MCL	Enforcement in process

# Appendix C

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Water Supply

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL0995110 <b>FOUR LAKES SUBDIVISION</b>	Combined Radium MCL	Returned to Compliance
IL0990060 <b>FOUR STAR CAMPGROUND</b>	Combined Radium MCL	Enforcement in process
IL3029611 <b>FOX RANCH TAVERN</b>	Coliform MCL	Returned to Compliance
IL3102665 <b>FULLERTON WDS E GR2 3134</b>	Coliform (Acute) MCL	Returned to Compliance
IL3032441 <b>FULTON COUNTY CAMPING&amp;REC AREA</b>	Coliform MCL	Enforcement in Process
IL2015495 <b>GEM SUBURBAN MHP</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL0735600 <b>GENESEO HILLS SUBDIVISION</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL0890350 <b>GENEVA</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL0890350 <b>GENEVA</b>	Gross Alpha MCL	Under compliance commitment agreement/schedule
IL3117176 <b>GIPPERS II</b>	Coliform (Acute) MCL	Enforcement in Process
IL1430350 <b>GLASFORD</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL1430350 <b>GLASFORD</b>	Gross Alpha MCL	Under compliance commitment agreement/schedule
IL3073056 <b>GLENWOOD FOREST PRESERVE</b>	Coliform MCL	Returned to Compliance
IL1090250 <b>GOOD HOPE</b>	Coliform MCL	Returned to Compliance
IL3121533 <b>GOODRICH JOHN DEERE EQUIPMENT</b>	Coliform MCL	Returned to Compliance
IL3109660 <b>GRACE LUTHERAN/SUE FOSDAL</b>	Coliform MCL	Returned to Compliance
IL0990200 <b>GRAND RIDGE</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL1035165 <b>GREEN ACRES MHP</b>	Coliform MCL	Returned to Compliance
IL0610150 <b>GREENFIELD</b>	Inadequate DBP Precursor Removal TT	Returned to Compliance

# Appendix C

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Water Supply

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1470250 <b>HAMMOND</b>	Nitrite MCL	Returned to Compliance
IL0890450 <b>HAMPSHIRE</b>	Combined Radium MCL	Returned to Compliance
IL1610300 <b>HAMPTON</b>	Coliform MCL	Returned to Compliance
IL1610300 <b>HAMPTON</b>	Fecal Coliform MCL	Returned to Compliance
IL3008342 <b>HARDING GRADE SCHOOL</b>	Coliform MCL	Returned to Compliance
IL1030300 <b>HARMON</b>	Combined Radium MCL	Returned to Compliance
IL1030300 <b>HARMON</b>	Gross Alpha MCL	Returned to Compliance
IL3133546 <b>HARMS WAY</b>	Coliform (Acute) MCL	Returned to Compliance
IL3133546 <b>HARMS WAY</b>	Coliform MCL	Returned to Compliance
IL3062588 <b>HARRISON ELEMENTARY SCHOOL</b>	Coliform (Acute) MCL	Returned to Compliance
IL1190500 <b>HARTFORD</b>	Coliform MCL	Returned to Compliance
IL3130690 <b>HARVARD SPORTSMAN CLUB</b>	Coliform MCL	Returned to Compliance
IL0735220 <b>HAZELWOOD HEIGHTS SUBDIVISION</b>	Arsenic MCL	Returned to Compliance
IL1230050 <b>HENRY</b>	Coliform MCL	Returned to Compliance
IL3064287 <b>HERITAGE HOUSE</b>	Coliform MCL	Enforcement in Process
IL1795495 <b>HIATTS HIDEAWAY MHP</b>	Coliform MCL	Returned to Compliance
IL0730080 <b>HICKORY HILLS 2ND ADDITION WATER ASSN</b>	Arsenic MCL	Returned to Compliance
IL3121632 <b>HILL &amp; DELL OIL COMPANIES</b>	Coliform MCL	Returned to Compliance
IL3009498 <b>HILLS COUNTRY STORE</b>	Coliform MCL	Returned to Compliance
IL3049049 <b>HILLSDALE INN STEAK HOUSE</b>	Coliform MCL	Returned to Compliance
IL3126565 <b>HIS REST BED &amp; BREAKFAST</b>	Coliform MCL	Returned to Compliance



# Appendix C

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Water Supply

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL0995300 <b>IL PRAIRIE ESTATE SBDV WATER ASSOCIATION</b>	Combined Radium MCL	Returned to Compliance
IL0995300 <b>IL PRAIRIE ESTATE SBDV WATER ASSOCIATION</b>	Gross Alpha MCL	Returned to Compliance
IL1670550 <b>ILLIOPOLIS</b>	Total Trihalomethane MCL	Returned to Compliance
IL3133330 <b>INDIAN SPRINGS GOLF CLUB</b>	Coliform MCL	Returned to Compliance
IL3057406 <b>INDIAN SPRINGS RECREATION ASSN</b>	Coliform MCL	Returned to Compliance
IL1970450 <b>JOLIET</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL1970450 <b>JOLIET</b>	Gross Alpha MCL	Returned to Compliance
IL1977930 <b>JOLIET CORRECTIONAL CENTER</b>	Combined Radium MCL	Returned to Compliance
IL3093914 <b>JUBILEE COLLEGE STATE HISTORIC</b>	Coliform MCL	Returned to Compliance
IL0390200 <b>KENNEY</b>	Arsenic MCL	Returned to Compliance
IL0730650 <b>KEWANEE</b>	Coliform MCL	Returned to Compliance
IL3149120 <b>KICKAPOO CREEK WINERY</b>	Coliform MCL	Returned to Compliance
IL1430450 <b>KINGSTON MINES</b>	Combined Radium MCL	Enforcement in process
IL1430450 <b>KINGSTON MINES</b>	Gross Alpha MCL	Enforcement in process
IL0630450 <b>KINSMAN</b>	Combined Radium MCL	Returned to Compliance
IL1870050 <b>KIRKWOOD</b>	Combined Radium MCL	Returned to Compliance
IL3042440 <b>KNIGHTS OF COLUMBUS (42440)</b>	E. Coli (Acute) MCL	Enforcement in Process
IL3126532 <b>KOUNTRY KORNER (126532)</b>	Coliform (Acute) MCL	Returned to Compliance
IL1995200 <b>LAKE OF EGYPT PWD</b>	Coliform MCL	Returned to Compliance
IL0970850 <b>LAKE ZURICH</b>	Combined Radium MCL	Under compliance commitment agreement/schedule

# Appendix C

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Water Supply

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1130750 LE ROY	Arsenic MCL	Returned to Compliance
IL3068791 LEARNING TREE CHILD DEVEL CNTR	Coliform MCL	Returned to Compliance
IL0430551 LISLE	Coliform MCL	Returned to Compliance
IL3136192 LITTLE JOHN CONSERVATION CLUB	Coliform MCL	Enforcement in Process
IL1870100 LITTLE YORK	Combined Radium MCL	Returned to Compliance
IL1870100 LITTLE YORK	Gross Alpha MCL	Returned to Compliance
IL3117085 LONDON PROPERTY LLC	Coliform MCL	Returned to Compliance
IL2010150 LOVES PARK	Combined Radium MCL	Returned to Compliance
IL0995336 LYNNWOOD WATER CORPORATION	Combined Radium MCL	Enforcement in process
IL0735280 LYNWOOD 3RD ADDITION	Arsenic MCL	Enforcement in process
IL3126409 M P I & ASSOCIATES	Coliform MCL	Enforcement in Process
IL1090350 MACOMB	Monthly Combined Filter Effluent TT	Returned to Compliance
IL1550200 MAGNOLIA	Arsenic MCL	Returned to Compliance
IL1970550 MANHATTAN	Combined Radium MCL	Under compliance commitment agreement/schedule
IL1150300 MAROA	Arsenic MCL	Returned to Compliance
IL0990500 MARSEILLES	Combined Radium MCL	Returned to Compliance
IL3006940 MARSHALL CO SPORTSMENS CLUB (6940)	Coliform (Acute) MCL	Returned to Compliance
IL1250350 MASON CITY	Arsenic MCL	Under compliance commitment agreement/schedule
IL3138776 MATHEWS COMPANY	Trichloroethylene MCL	Enforcement in Process
IL3150391 MAXEY CHAPEL UNITED METHODIST CHURCH	Coliform MCL	Returned to Compliance
IL0311830 MAYWOOD	Coliform MCL	Returned to Compliance

# Appendix C

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Water Supply

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3057240 <b>MC HENRY EARLY LEARNING CENTER</b>	Coliform MCL	Returned to Compliance
IL1130850 <b>MC LEAN</b>	Arsenic MCL	Returned to Compliance
IL3032979 <b>MCDUCKS</b>	Coliform MCL	Returned to Compliance
IL3100768 <b>MEADOWLARK GOLF COURSE</b>	Coliform MCL	Enforcement in Process
IL1170550 <b>MEDORA</b>	Total Trihalomethane MCL	Returned to Compliance
IL0990550 <b>MENDOTA</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL3117622 <b>MI CASA</b>	E. Coli (Acute) MCL	Enforcement in Process
IL3113431 <b>MIDDLE FORK RIVER FOREST PRESV</b>	Coliform MCL	Returned to Compliance
IL3136614 <b>MISS NETTIES DOUBLE J</b>	Nitrate MCL	Returned to Compliance
IL3106278 <b>MISSISSIPPI PALISADES ST PARK (106278)</b>	E. Coli (Acute) MCL	Enforcement in Process
IL3022657 <b>MOBIL GAS FOOD MART #18</b>	Coliform MCL	Returned to Compliance
IL3146696 <b>MOBIL SUPER PANTRY CLINTON</b>	Nitrite MCL	Returned to Compliance
IL3073049 <b>MONTESSORI ACADEMY</b>	Coliform MCL	Enforcement in Process
IL3148429 <b>MONTESSORI ACADEMY GLEN ELLYN</b>	Coliform MCL	Returned to Compliance
IL0935140 <b>MORGAN CREEK</b>	Combined Radium MCL	Returned to Compliance
IL1790500 <b>MORTON</b>	Coliform MCL	Returned to Compliance
IL1795345 <b>MORTON MOBILE HOME PARK</b>	Arsenic MCL	Enforcement in process
IL3134338 <b>MOST HOLY MORTH OF GOD/MONASTE</b>	Coliform MCL	Returned to Compliance
IL1910350 <b>MOUNT ERIE</b>	Coliform MCL	Returned to Compliance
IL1410350 <b>MOUNT MORRIS</b>	Combined Radium MCL	Enforcement in process

# Appendix C

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Water Supply

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL0990600 <b>NAPLATE</b>	Combined Radium MCL	Enforcement in process
IL0670500 <b>NAUVOO</b>	Insufficient Inactivation TT	Returned to Compliance
IL0350150 <b>NEOGA</b>	Insufficient Inactivation TT	Under compliance commitment agreement/schedule
IL0350150 <b>NEOGA</b>	Monthly Combined Filter Effluent TT	Returned to Compliance
IL0110700 <b>NEPONSET</b>	Coliform MCL	Returned to Compliance
IL0110700 <b>NEPONSET</b>	Combined Radium MCL	Enforcement in process
IL0110700 <b>NEPONSET</b>	Gross Alpha MCL	Enforcement in process
IL1670800 <b>NEW BERLIN</b>	Insufficient Inactivation TT	Under compliance commitment agreement/schedule
IL0890600 <b>NORTH AURORA</b>	Combined Radium MCL	Enforcement in process
IL0990650 <b>NORTH UTICA</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL0995250 <b>OAKLANE SBDV</b>	Coliform MCL	Returned to Compliance
IL3005595 <b>OAKWOOD JR HIGH SCHOOL</b>	Coliform MCL	Returned to Compliance
IL0430010 <b>OBT SERVICE CORPORATION</b>	Coliform MCL	Returned to Compliance
IL0110800 <b>OHIO</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL3147587 <b>OPEN HEARTS FOURSQUARE CHURCH</b>	Coliform MCL	Returned to Compliance
IL0930150 <b>OSWEGO</b>	Combined Radium MCL	Returned to Compliance
IL1175150 <b>PALMYRA-MODESTO WATER COMMISSION</b>	Inadequate DBP Precursor Removal TT	Returned to Compliance
IL1175150 <b>PALMYRA-MODESTO WATER COMMISSION</b>	Insufficient Inactivation TT	Returned to Compliance
IL0054720 <b>PANAMA</b>	Total Trihalomethane MCL	Returned to Compliance
IL1617665 <b>PARADISE MANOR MHP</b>	Coliform (Acute) MCL	Returned to Compliance
IL1617665 <b>PARADISE MANOR MHP</b>	Coliform MCL	Returned to Compliance

# Appendix C

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Water Supply

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1210400 <b>PATOKA</b>	Simazine MCL	Returned to Compliance
IL1210400 <b>PATOKA</b>	Total Haloacetic Acids MCL	Returned to Compliance
IL1434750 <b>PEORIA HEIGHTS</b>	Coliform MCL	Returned to Compliance
IL3001164 <b>PEORIA SPORTSMENS CLUB</b>	Nitrate MCL	Enforcement in Process
IL3127761 <b>PETER RABBIT DAY CARE SCOOOL</b>	Coliform MCL	Returned to Compliance
IL3115808 <b>PETES FAMOUS HOT DOGS</b>	Coliform MCL	Returned to Compliance
IL0971180 <b>PINE VIEW APARTMENTS</b>	Coliform MCL	Returned to Compliance
IL3137018 <b>PLEASANT VALLEY LAKES/RDHOUSE</b>	Coliform MCL	Returned to Compliance
IL3005397 <b>PONTIAC CHRISTIAN SCHOOL</b>	Coliform MCL	Returned to Compliance
IL0630060 <b>PRAIRIE OAKS ESTS HOMEOWNERS ASSN</b>	Combined Radium MCL	Returned to Compliance
IL3005256 <b>PRAIRIEVIEW JR. HIGH SCHOOL</b>	Coliform MCL	Returned to Compliance
IL0971100 <b>PROVIDENCE AT PAINTED LAKES</b>	Combined Radium MCL	Returned to Compliance
IL1890450 <b>RADOM</b>	Coliform MCL	Returned to Compliance
IL3139303 <b>RANDALL OAKS PARK COMM SHELTER</b>	Coliform MCL	Returned to Compliance
IL0990900 <b>RANSOM</b>	Combined Radium MCL	Enforcement in process
IL3076604 <b>RED OAK NATURE CENTER</b>	Coliform MCL	Returned to Compliance
IL0914780 <b>REDDICK</b>	Combined Radium MCL	Enforcement in process
IL0590300 <b>RIDGWAY</b>	Arsenic MCL	Returned to Compliance
IL2030550 <b>ROANOKE</b>	Coliform MCL	Returned to Compliance
IL0312700 <b>ROBBINS</b>	Coliform MCL	Returned to Compliance
IL0530350 <b>ROBERTS</b>	Lead Public Education TT	Returned to Compliance

# Appendix C

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Water Supply

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1970850 <b>ROCKDALE</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL2010300 <b>ROCKFORD</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL2010300 <b>ROCKFORD</b>	Gross Alpha MCL	Returned to Compliance
IL2010350 <b>ROCKTON</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL3005413 <b>ROOKS CREEK ELEMENTARY SCHOOL</b>	Coliform MCL	Returned to Compliance
IL1830800 <b>ROSSVILLE</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL0971550 <b>ROUND LAKE BEACH</b>	Coliform MCL	Returned to Compliance
IL0735500 <b>RUSTIC ACRES WATER ASSOCIATION</b>	Arsenic MCL	Enforcement in process
IL3037606 <b>SCOOBYS RED HOTS</b>	Coliform MCL	Returned to Compliance
IL3126821 <b>SHERIDAN ROD &amp; GUN</b>	Coliform MCL	Enforcement in Process
IL0890040 <b>SILVER GLEN ESTS</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL1610700 <b>SILVIS</b>	Combined Radium MCL	Returned to Compliance
IL1610700 <b>SILVIS</b>	Gross Alpha MCL	Returned to Compliance
IL1615750 <b>SILVIS HEIGHTS WATER CORP</b>	Coliform MCL	Returned to Compliance
IL3150029 <b>SIM PRODUCTS</b>	Coliform MCL	Returned to Compliance
IL3064451 <b>SNAP ON TOOLS</b>	Coliform MCL	Returned to Compliance
IL3117226 <b>SNOOKERS</b>	Coliform MCL	Returned to Compliance
IL3149575 <b>ST PAUL MISSIONARY CHURCH</b>	Coliform (Acute) MCL	Enforcement in Process
IL0275250 <b>ST ROSE PWD</b>	Coliform MCL	Returned to Compliance
IL0275250 <b>ST ROSE PWD</b>	Nitrate MCL	Returned to Compliance

# Appendix C

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Water Supply

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1550300 <b>STANDARD</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL1550300 <b>STANDARD</b>	Gross Alpha MCL	Under compliance commitment agreement/schedule
IL1171050 <b>STAUNTON</b>	Monthly Combined Filter Effluent TT	Returned to Compliance
IL3110023 <b>STREATOR BAPTIST CAMP - OFFICE WELL</b>	Coliform (Acute) MCL	Returned to Compliance
IL3113480 <b>SUN -N- FUN SWIM &amp; GOLF CLUB</b>	Coliform MCL	Returned to Compliance
IL1190120 <b>SUNNY SHORES MHP</b>	Lead Public Education TT	Returned to Compliance
IL3137422 <b>SUNRISE RESTAURANT</b>	Coliform MCL	Returned to Compliance
IL0310080 <b>SUNSET MHP</b>	Combined Radium MCL	Returned to Compliance
IL3009613 <b>SUTTERS COUNTRY KITCHEN</b>	Coliform MCL	Enforcement in Process
IL1315200 <b>SWEDONA WATER ASSOCIATION</b>	Coliform MCL	Returned to Compliance
IL0370550 <b>SYCAMORE</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL3037150 <b>TASSOS RESTAURANT</b>	Coliform MCL	Returned to Compliance
IL0971210 <b>TERRACE OAK APARTMENTS</b>	Coliform MCL	Returned to Compliance
IL3133355 <b>TESKES PET AND GARDEN CENTER</b>	Coliform MCL	Returned to Compliance
IL3148114 <b>THE GLASS DOOR</b>	E. Coli (Acute) MCL	Returned to Compliance
IL0115525 <b>THE GROVE MHP</b>	Arsenic MCL	Enforcement in process
IL3048884 <b>THE MUTINY PUB</b>	Coliform MCL	Enforcement in Process
IL3123612 <b>THE WEDRON OFFICE</b>	Coliform MCL	Returned to Compliance
IL1775255 <b>TIMBER RIDGE MOBILE ESTATES</b>	Combined Radium MCL	Returned to Compliance
IL2035225 <b>TIMBERLINE MHP</b>	Arsenic MCL	Enforcement in process

# Appendix C

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Water Supply

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL0991150 <b>TONICA</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL3038331 <b>TRAFFIC CONTROL AND PROTECTION</b>	Coliform MCL	Returned to Compliance
IL0270500 <b>TRENTON</b>	Coliform MCL	Returned to Compliance
IL0195925 <b>TRIANGLE MHP</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL3022020 <b>TYLER CREEK FOREST PRESERVE</b>	Coliform (Acute) MCL	Returned to Compliance
IL1110900 <b>UNION</b>	Combined Radium MCL	Returned to Compliance
IL0971170 <b>UNIVERSITY ST MARY OF THE LAKE</b>	Lead Public Education TT	Returned to Compliance
IL3104000 <b>USFS JOHNSON CREEK RECREATION AREA</b>	Coliform MCL	Enforcement in Process
IL2015160 <b>UTL INC-COVENTRY CREEK SUBDIVISION</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL0975370 <b>UTL INC-DEL-MAR WATER COMPANY</b>	Lead Public Education TT	Returned to Compliance
IL0855050 <b>UTL INC-GALENA TERRITORY UTILITES</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL3129361 <b>VAN PATTON WOODS HAND PUMP #10</b>	Coliform MCL	Returned to Compliance
IL3129353 <b>VAN PATTON WOODS HAND PUMP #9</b>	Coliform MCL	Enforcement in Process
IL3129395 <b>VAN PATTON WOODS HANDPUMP #4</b>	Coliform MCL	Enforcement in Process
IL0515500 <b>VANDALIA CORRECTIONAL CENTER</b>	Total Trihalomethane MCL	Under compliance commitment agreement/schedule
IL3005777 <b>VICTORY BAPTIST CHURCH</b>	Coliform MCL	Returned to Compliance
IL1310450 <b>VIOLA</b>	Combined Radium MCL	Returned to Compliance
IL3015206 <b>WAA-KEE-SHA PARK</b>	Coliform MCL	Returned to Compliance

Tuesday, July 31, 2007

Page 16 of 18



# Appendix C

## Illinois EPA 2006 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Water Supply

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3060285 <b>WALNUT GR UNITED METHODIST CHU</b>	Coliform MCL	Enforcement in Process
IL3060285 <b>WALNUT GR UNITED METHODIST CHU</b>	Nitrate MCL	Returned to Compliance
IL3041459 <b>WARRENVILLE TOWN TAP LIQUOR</b>	Coliform MCL	Returned to Compliance
IL0670650 <b>WARSAW</b>	Total Trihalomethane MCL	Returned to Compliance
IL3129619 <b>WASTE MANAGEMENT NORTH</b>	Coliform MCL	Returned to Compliance
IL0370600 <b>WATERMAN</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL0750900 <b>WATSEKA</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL0750900 <b>WATSEKA</b>	Coliform MCL	Returned to Compliance
IL1370450 <b>WAVERLY</b>	Insufficient Inactivation TT	Under compliance commitment agreement/schedule
IL3140830 <b>WAYNE PRINTING COMPANY</b>	Coliform MCL	Returned to Compliance
IL0390300 <b>WAYNESVILLE</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL3135962 <b>WCFP LINCOLN HWY MOKENA PUMP 2</b>	Coliform MCL	Returned to Compliance
IL3149567 <b>WESTERN ILLINOIS BOAT CLUB</b>	Nitrate MCL	Returned to Compliance
IL3149229 <b>WESTERN ILLINOIS NATURE GROUP</b>	Coliform MCL	Returned to Compliance
IL1095510 <b>WESTERN ILLINOIS UNIVERSITY</b>	Monthly Combined Filter Effluent TT	Returned to Compliance
IL3000851 <b>WHITE OAKS CAMPGROUND</b>	Coliform MCL	Returned to Compliance
IL0995425 <b>WILDLIFE MHP</b>	Combined Radium MCL	Enforcement in process
IL3119768 <b>WINDMILLS GOLF COURSE</b>	Coliform MCL	Returned to Compliance
IL1770550 <b>WINSLOW</b>	Coliform MCL	Returned to Compliance

# *Appendix C*

## *Illinois EPA 2006 Annual Compliance*

### *Maximum Contaminant Level and Treatment Technique Violations*

#### *Listing by Water Supply*

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3056499 <b>WOLF CREEK GOLF COURSE</b>	Coliform MCL	Returned to Compliance
IL0735120 <b>WOLF RIDGE WELL CORPORATION</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL3014282 <b>WOLFCREEK COUNTRY CLUB</b>	Coliform MCL	Returned to Compliance
IL3115287 <b>WOODFORD COUNTY IZAAK WALTON</b>	Coliform MCL	Enforcement in Process
IL0970080 <b>WYNSTONE WATER COMPANY</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL0930250 <b>YORKVILLE</b>	Combined Radium MCL	Returned to Compliance
IL0930250 <b>YORKVILLE</b>	Gross Alpha MCL	Returned to Compliance

