

State of Illinois  
Rod. R. Blagojevich, Governor

Illinois Environmental Protection Agency  
Douglas P. Scott, Director



# Annual Compliance Report for Public Drinking Water Supplies 2007



Illinois  
Environmental  
Protection  
Agency

July 2008

[www.epa.state.il.us](http://www.epa.state.il.us)

## Annual Compliance Report, Calendar Year 2007 The Drinking Water Program: An Overview

### Introduction



The United States Environmental Protection Agency (USEPA) established the Public Water System Supervision (PWSS) Program under the authority of the 1974 Safe Drinking Water Act (SDWA). Under the SDWA and the subsequent amendments, USEPA sets national limits on contaminant levels in drinking water to ensure that the water is safe for human consumption. These limits are known as Maximum Contaminant Levels (MCLs)<sup>2</sup> and Maximum Residual Disinfectant Levels (MRDL's)<sup>3</sup>. For some regulations, EPA establishes treatment techniques (TT)<sup>4</sup> in lieu of an MCL to control unacceptable levels of contaminants in water. The Agency also regulates how

often public water systems (PWSs)<sup>1</sup> monitor their water for contaminants and report the monitoring results to the states or USEPA. Generally, the larger the population served by a water system, the larger the number of samples collected and the more frequent the monitoring and reporting (M/R)<sup>5</sup> requirements. In addition, USEPA requires Public Water Systems (PWSs) to monitor for unregulated contaminants to provide data for development of future regulations. Finally, USEPA requires PWSs to notify their consumers when they have violated these regulations. The 1996 Amendments to the SDWA require consumer notification to include a clear and understandable explanation of the nature of the violation, its potential adverse health effects, steps that the PWS is undertaking to correct the violation and the possibility of using alternative water supplies during the violation.

### Annual State PWS Report

The purpose of this annual compliance report is to satisfy the requirement of Section 1414(c)(3) of the 1996 Amendments to the Safe Drinking Water Act (SDWA). States with national primary

---

enforcement authority are to prepare, make readily available to the public, and submit to the Administrator of the USEPA by July 1 of each year, an annual report on violations occurring during the previous calendar year of national primary drinking water regulations by public water systems.

## Annual Compliance Report Background

Each quarter, the Illinois Environmental Protection Agency (Illinois EPA) submits data to the Federal Safe Drinking Water Information System (SDWIS/FED), an automated database maintained by USEPA. The data submitted include, but are not limited to, PWS inventory information, the incidences of violations of Maximum Contaminant Levels, Maximum Residual Disinfectant Levels, monitoring, and treatment technique violations; and information on enforcement activity related to these violations. This report provides the numbers of violations in each of six categories:



- Maximum Contaminant Level (MCL) violations
- Maximum Residual Disinfectant Level (MRDL) violations,
- Treatment Technique (TT) requirement violations,
- Significant violations of Monitoring and Reporting (M/R) requirement violations,
- Significant violations of the Consumer Notification requirements,
- And Violations of Variances and Exemptions.

Attached to this report as Appendix A is a listing for each contaminant regulated by the SDWA, the numbers of maximum contaminant level (MCL), maximum residual disinfectant level (MRDL), treatment technique (TT) and major monitoring and reporting (M/R) violations for each compliance period during calendar year 2007, the number of violations that were returned to compliance (RTC), and the number of systems incurring violations. Appendix B and Appendix C contain a detailed listing of public water systems with MCL, MRDL, or TT violations.

## Variances and Exemptions

A PWS can be granted a “variance” from a primary drinking water regulation if the characteristics of the raw water sources reasonably available to the PWS do not allow the system to meet the MCL. To obtain a variance, the system must agree to install the best available technology, treatment techniques, or other means of limiting drinking water contamination that the Administrator finds are available (taking costs into account), and the state must find that the variance will not result in an unreasonable risk to public






health. The variance shall be reviewed not less than every 5 years to determine if the system remains eligible for the variance. During 2007, Illinois did not grant any variances.

A water system may also petition the state for an “exemption”. An exemption is permission not to meet an MCL or a treatment technique under certain conditions for a period of time. An exemption may be granted to give a water system additional time to make complicated and expensive modifications and improvements to the water treatment process so that compliance may be achieved in the shortest period of time. During 2007, Illinois did not grant any exemptions.

## Public Water System Overview

In Illinois, oversight of PWSs is divided between the Illinois Environmental Protection Agency (Illinois EPA) and the Illinois Department of Public Health (Illinois DPH). Illinois EPA has been designated as the lead agency for primary enforcement authority and oversees the **community public water system (CWS)** program (these supplies that serve 15 or more year round service connections or 25 or more year round residents). During 2007, there were 1,787 CWS. Illinois DPH oversees the **non-community water systems**. Non-community systems include the **non-transient, non-community public water systems (NTNC)** that serve 25 or more of the same non-residents at least 180 days out of the year and include facilities such as day care centers, schools and factories. Illinois DPH also oversees the **transient non-community (TNC) public water systems** that serve 25 or more different nonresidents at least 60 days out of the year and include facilities such as campgrounds and highway rest areas. During 2007, there were 402 NTNC and 3,730 TNC. The remainder of this report will detail the CWS supplies and then, separately, address the non-community (NTNC/TNC) supplies.

## Community Public Water Supplies

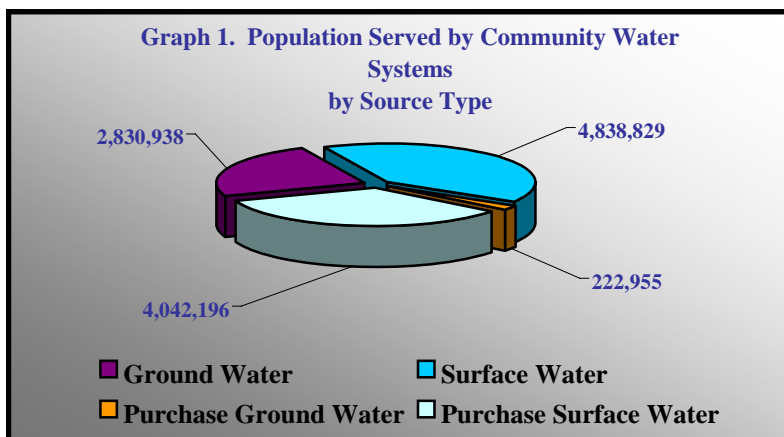

As previously mentioned, the Illinois EPA oversees the **CWS** program. A CWS is a PWS that serves 25 or more people year around and/or has 15 service connections.

◀ **Graph 1** depicts the breakdown of the 1,787 community water systems within Illinois with regard to their source of water. A total of 11,934,918 persons are served by those systems; 41 percent of that population is directly served from surface water systems. Thirty-four percent of the population is served

by purchased surface water, 2 percent by purchased ground water, and 23 percent by ground water systems. It is worth noting that although only 23 percent of the population is served by ground water; ground water systems comprise almost 58 percent (1,032 of the 1,787) of the total number of community water systems. The type of source water (ground, surface, or purchase) for a CWS will determine monitoring, treatment, and operational requirements. For


example, surface water systems are required to monitor turbidity, where ground water systems (that are not under the influence of surface water) are not. This requirement will impact compliance numbers as outlined later in this report.

## CWS - Environmental Indicators

The Illinois EPA Safe Drinking Water Goal is for every Illinois public water system to provide water that is consistently safe to drink. As a part of its partnership agreement with USEPA, Illinois EPA measures the progress of the drinking water program with environmental indicators consisting of the percentage of persons served by community water systems that have not incurred violations of any acute MCL, chronic MCL, acute treatment technique, chronic treatment technique or public education requirement during the year. The environmental objective of the Illinois EPA is to increase the percentage of population served by CWS that receive drinking water with no short-term (acute) or long-term (chronic) adverse health effects to over 95 percent by the year 2008. The progress towards this objective is summarized below.

## CWS - Environmental Indicator Progress

Safe drinking water should be free of contaminants that have the potential to cause either short term or long-term health effects. During calendar year 2007, the percentage of persons served by Illinois CWS that have been in effect for more than three years and that were compliant with all health requirements (MCL), treatment techniques (TT), or public education was **93.9** percent. Compliance efforts will continue to focus on minimizing the frequency and duration of excursions and the development of enforceable schedules for the implementation of corrective action plans to achieve sustained compliance.

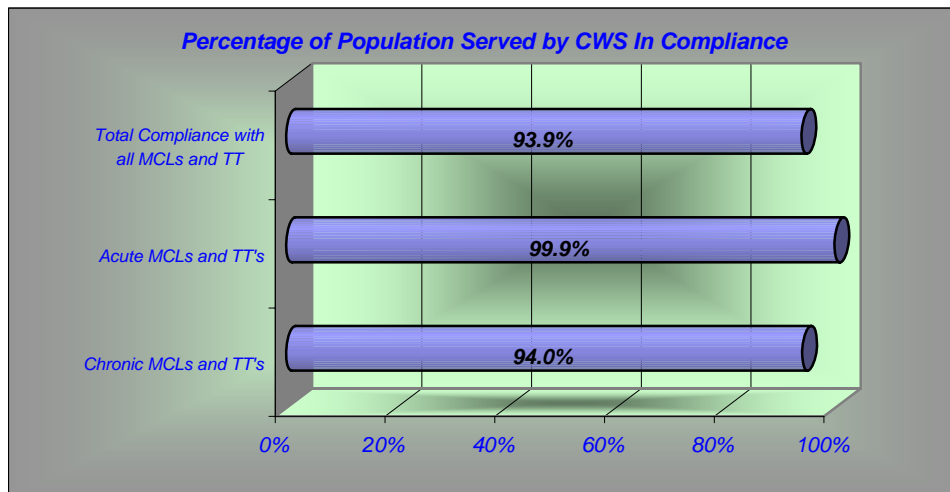

◀ Graph 2

### CWS Compliance Percentages

During calendar year 2007, the percentage of persons served by Illinois CWS that were compliant

with all health requirements was 93.9 percent. This compliance percentage represents over one-half of a percentage point improvement from calendar year 2006 and reflects continued progress toward the goal of 95 percent. It is important that safe drinking water be free of contamination that has the potential to cause either short-term or long-term health effects.

## CWS - Acute vs. Chronic Indicators


The contaminants fall into two groups according to the health effects that they cause:

ACUTE	CHRONIC
<p>Acute effects occur within hours or days of the time that a person consumes a contaminant. People can suffer acute health effects from almost any contaminant if they are exposed to extraordinarily high levels (as in the case of a spill). In drinking water, microbes, such as bacteria and viruses, are the contaminants with the greatest chance of reaching levels high enough to cause acute health effects. Most people's bodies can fight off these microbial contaminants the way they fight off germs; and these acute contaminants typically don't have permanent effects. Nonetheless, when high enough levels occur, they can make people ill, and can be dangerous or deadly for a person whose immune system is already weak due to HIV/AIDS, chemotherapy, steroid use, or another reason.</p>	<p>Chronic effects occur after people consume a contaminant at levels over EPA's safety standards for many years. USEPA develops the standards for chronic MCLs on the basis that a person may have an adverse health effect after consuming two liters of water daily over a 70-year lifetime. The drinking water contaminants that can have chronic effects are chemicals (such as disinfection by-products, solvents, and pesticides), radionuclides (such as radium), and minerals (such as arsenic). Examples of the chronic effects of drinking water contaminants are cancer, liver or kidney problems, or reproductive difficulties.</p>


**Graph 3 (below)** shows that **99.9** percent of the population served by Illinois CWS received drinking water in compliance with acute (short-term) health requirements, and **94** percent were in compliance with chronic (long-term) health requirements. It is important to note that most non-compliance was short in duration, and the potential for health risk was minimized through prompt corrective action by the water supplies. Supplies with microbial problems (bacterial or turbidity non-compliance) are required to issue boil orders when the violation occurs. Community water systems with acute MCLs were limited to five water systems.

**Acute and Chronic Requirements (2007 data)**  
**Percent of CWS Population Served Compliant with Health Records**

ACUTE

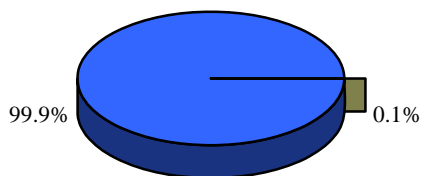

CHRONIC

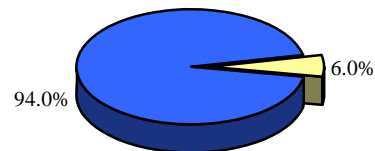

■ *Compliant*   ■ *Non-compliant*

■ *Compliant*   ■ *Non-Compliant*

## CWS - Lead And Copper Compliance

In 2007, 1,770 water supplies, or approximately **99** percent of community water supplies were below the lead action level. These water supplies serve **99.5** percent of the population. There were no treatment technique violations reported for the NTNC water systems overseen by the Illinois DPH.

### Lead and Copper Rule Compliance



Lead and copper are regulated by a Treatment Technique that requires systems to control the corrosiveness of their water. The lead action level (15 parts per billion of lead) when exceeded in more than ten percent of the water samples collected in consumers' homes, requires the water supply to implement optimal corrosion control treatment plans or procedures which would prevent anticipated adverse health effects and ensure that lead or copper is controlled in the drinking water.


During the years 2004 to 2007, a 0.5 percent net decrease in lead action level exceedances was seen in CWS. Generally, non-compliance is for a short period of time due to the fact the treatment is adjusted to the required ranges. Over *99 percent* of the population served by CWS consumed water that was compliant with lead action level during 2007.

## CWS - Consumer Awareness

Every community water supplier must provide an annual report (sometimes called a Consumer Confidence Report or CCR) to its customers. The report provides information on local drinking water quality, including the water's source, the contaminants found in the water, and how consumers can get involved in protecting drinking water. If the consumers have been looking for specific information about their drinking water, this annual report will provide them with the information they need.

In connection with each violation described in the previous sections, public notification is required to be issued. Public notification provides a means to protect public health, build trust with consumers through open and honest sharing of information, and establishes an ongoing, positive relationship with the community. Public notice can also be used to help consumers

### *Community Systems in Compliance with Consumer Notification*

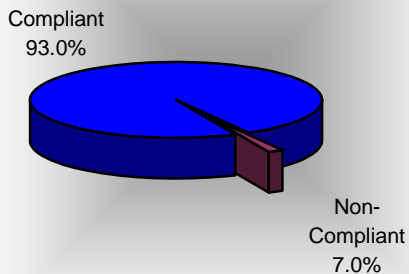

understand rate increases and support increased funding for drinking water treatment and protection. Properly done, the notices can work for the benefit of the public water supplier as well the public. In the event a problem occurs, educated consumers are more likely to understand the problem and support the actions a water utility must take. Many deadlines for public notice issuance depend upon prompt contact and discussion between the public water system and Illinois EPA. Efficient communication with prompt reporting is the cornerstone for compliance. **Graph 5 (left)** depicts the compliance rates for community water systems with regard to overall consumer notification during 2007. This includes failure to issue public notice and the CCR compliance rate.

## CWS – Monitoring and Reporting (M&R)

The USEPA has established contaminant-specific minimum testing schedules for public water systems. Water systems typically monitor for bacteria, protozoa and viruses, nitrate and nitrite, volatile organic compounds (e.g., benzene), synthetic organic compounds (e.g., pesticides), inorganics (e.g., arsenic), lead and copper, and radionuclides. Although failure to monitor does not necessarily suggest safety problems, conducting the required monitoring and reporting is critical to ensure that problems will be detected.

During 2007, 86 percent of total community supplies were compliant with monitoring and reporting requirements.



## **IEPA Enforcement Strategy**

The Illinois EPA has enforcement authority over community water systems in Illinois. Illinois EPA has a standardized protocol for all enforcement matters to ensure unilateral, consistent treatment of enforcement cases. For any violation outlined in the previous pages, a failure to take corrective action could result in the water system being considered for enforcement under Section 31 of the Illinois Environmental Protection Act. Enforcement normally begins with the identification of a significant unresolved violation by technical staff. Information about the violator/violations is forwarded to the Compliance Group (composed of Section Managers). If the Compliance Group determines a Violation Notice (VN) is warranted, the VN recommendation is sent to the Agency's Compliance Management Panel (CMP) for review. After review by the CMP, the Compliance Assurance Section prepares and issues the VN. After the VN is sent, the violator will have a set time period (45 days or 60 days depending on whether a meeting is requested) to respond in writing with a proposed Compliance Commitment Agreement (CCA). Enforcement activities are suspended if the proposed CCA is accepted by the Agency. If at a later point in time, the violator does not follow the CCA agreement, enforcement may resume.

If the proposed CCA is not accepted or the violator fails to respond to the VN, the case is brought before the Enforcement Decision Group (EDG, composed of senior Agency management). EDG will determine the next course of action such as recommending a case for formal enforcement, which consists of referring the water system to the State's Attorney General or the USEPA for filing with a court to direct corrective actions and which may include imposition of penalties or fines.

## **CWS Violation Summary Table**

The following page summarizes the percentage of community water systems in compliance with all aspects of the drinking water compliance program. Radionuclide MCLs comprise the largest number of violations, and consequently, cause the largest number of water systems to be out of compliance. As these systems conclude construction, compliance numbers will improve. Those systems not making progress on reducing radium MCL levels are proceeding through the enforcement process previously outlined.

**Violations during Calendar Year 2007  
State of Illinois  
Community Water Systems**

<b>Total Number of Regulated Systems</b>	<b>1,787</b>
<b>Total Number of Systems in Violation</b>	<b>418</b>
<b>Total Number of Violations</b>	<b>1,566</b>

**Rule Subtotal by Violation Type – Community Water Systems**

Violation Category	MCLs			Treatment Techniques			Significant Monitoring/Notification		
	Number of Violations	Number of Systems in Violation*	Compliance Rate	Number of Violations	Number of Systems in Violation*	Compliance Rate	Number of Violations	Number of Systems in Violation*	Compliance Rate
Radiological	185	48	97.4%	-	-	-	147	35	98.0%
IOCs	101	30	98.3%	-	-	-	57	34	98.0%
SOCs	1	1	99.9%	-	-	-	190	5	99.7%
VOCs	0	0	100%	-	-	-	164	4	99.7%
TCR	43	34	98.0%	-	-	-	142	99	94.4%
All SWTRs	-	-	-	102	14	99.2%	1	1	99.9%
Stage 1 DBPR	24	12	99.3%	11	5	99.7%	172	149	91.6%
Lead and Copper Rule	-	-	-	3	3	99.8%	21	19	98.9%
Consumer Awareness / Notification	-	-	-	-	-	-	202	128	92.8%
<b>Total PWSs</b>	<b>354</b>	<b>123</b>	<b>93.1%</b>	<b>116</b>	<b>21</b>	<b>98.8%</b>	<b>1,096</b>	<b>338</b>	<b>81.0%</b>

\*Note: Although a CWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF CWS IN VIOLATION, over the various violation types or contaminants, may not add up to the total.


## Non-Community Public Water Systems

As stated previously, Illinois DPH oversees the non-community water system program. Non-community systems include the **non-transient, non-community public water systems (NTNC)** that serve 25 or more of the same nonresidents at least 180 days out of the year and include facilities such as day care centers, schools and factories. Illinois DPH also supervises the **transient non-community (TNC) public water systems** that serve 25 or more different nonresidents at least 60 days out of the year and include facilities such as campgrounds and highway rest areas.

### Graph 7 ►

#### Population Distribution Amongst Non-community Systems

Graph 7 depicts how the 504,980 customers served by non-community water systems are distributed between the transient and non-transient systems. Transient supplies (campgrounds, rest areas, etc.) serve a population of 374,363 at 3,730 facilities. Non-transient systems serve 130,617 consumers at 402 systems.

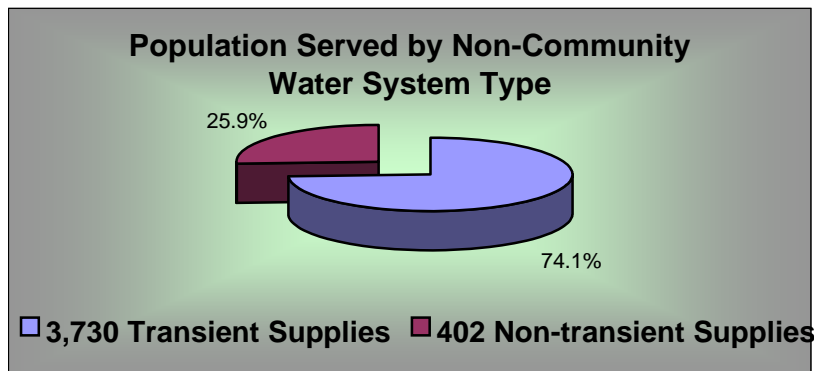

Both NTNC and TNC are required to monitor contaminants like the CWS and issue public notification if in violation. However, TNC only monitor for nitrates, coliform bacteria, and are subject to some requirements of the surface water treatment rule (if they use surface water). NTNC monitors the same contaminants as CWS, but are not required to monitor radionuclides or issue/publish a consumer confidence report.

### Non-CWS Compliance Figures

During calendar year 2007, the percentage of persons served by Illinois **non-community** water systems that were compliant with all health requirements (MCL), treatment techniques (TT), or health advisories (HA) that have been in effect for more than three years was 95.5 percent.

The following page summarizes the percentage of non-community water systems in compliance with all aspects of drinking water compliance.

**Violations during Calendar Year 2007  
State of Illinois  
Non-Community Water Systems**

<b>Total Number of Regulated TNC and NTNC Systems</b>	<b>4,132</b>
<b>Total Number of Systems in Violation</b>	<b>365</b>
<b>Total Number of Violations</b>	<b>5,110</b>

<b>Rule Subtotal by Violation Type – Non-Community Water Systems</b>									
<b>Violation Category</b>	<b>MCLs</b>			<b>Treatment Techniques</b>			<b>Significant Monitoring/Notification</b>		
	Number of Violations	Number of Systems in Violation*	Compliance Rate	Number of Violations	Number of Systems in Violation*	Compliance Rate	Number of Violations	Number of Systems in Violation*	Compliance Rate
IOCs	0	0	100%	-	-	-	336	58	85.6%
SOCs	0	0	100%	-	-	-	1956	52	87.1%
VOCs	3	3	99.3%	-	-	-	2310	65	83.8%
Nitrate / Nitrite	14	14	96.5%	-	-	-	30	13	99.7%
TCR	113	108	97.3%	-	-	-	262	144	96.1%
All SWTRs	-	-	-	3	3	80%	6	1	93.3%
Stage 1 DBPR	1	1	99.2%	-	-	-	14	7	94.0%
Lead/Copper**	-	-	-	0	0	100%	62	37	90.1%
Consumer Awareness / Notification	-	-	-	-	-	-	0	0	0**
<b>Total PWSs</b>	<b>131</b>	<b>126</b>	<b>97%</b>	<b>3</b>	<b>3</b>	<b>80%</b>	<b>4,976</b>	<b>267</b>	<b>93.5%</b>

\*Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

\*\*Public Notice for monitoring violations is not included in the compliance rate



## Common Terms & Definitions

### **<sup>1</sup>Public Water System (PWS)**

A Public Water System (PWS) is defined as a system that provides water via piping or other constructed conveyances for human consumption to at least 15 service connections or serves an average of at least 25 people for at least 60 days each year. There are three types of PWSs. PWSs can be community (such as towns), non-transient non-community (such as schools or factories), or transient non-community systems (such as rest stops or parks). For this report when the acronym “PWS” is used, it means systems of all types unless specified in greater detail.

### **<sup>2</sup>Maximum Contaminant Level (MCL)**

Under the Safe Drinking Water Act (SDWA), the EPA sets national limits on contaminant levels in drinking water to ensure that the water is safe for human consumption. These limits are known as Maximum Contaminant Levels (MCLs).

### **<sup>3</sup>Maximum Residual Disinfectant Level (MRDL)**

The EPA sets national limits on residual disinfectant levels in drinking water to reduce the risk of exposure to disinfection byproducts formed when public water systems add chemical disinfectant for either primary or residual treatment. These limits are known as Maximum Residual Disinfectant Levels (MRDLs).

### **<sup>4</sup>Treatment Techniques (TT)**

For some regulations, the EPA establishes treatment techniques (TTs) in lieu of an MCL to control unacceptable levels of certain contaminants. For example, treatment techniques have been established for viruses, some bacteria, and turbidity.

### **Return to Compliance**

As noted in the definition of monitoring violations, systems which monitor less frequently than quarterly can return to compliance. Some systems can return to compliance if they monitor for the missed contaminants or submit reports late. In this report, return to compliance rates were determined for inorganic contaminants; nitrate; nitrite; regulated volatile organic contaminants; synthetic organic contaminants; total trihalomethanes; five haloacetic acids (DBPs); and radiological contaminants, as a group.

### **<sup>5</sup>Significant Monitoring and Reporting (M/R) Violations**

A PWS is required to monitor and verify that the levels of contaminants present in the water do not exceed the MCL. If a PWS fails to have its water tested as required or fails to report test results correctly to the appropriate Agency, a monitoring violation occurs. For this report, significant monitoring violations are generally defined as any significant monitoring violation that occurred during the calendar year of the report. A significant monitoring violation, with rare exceptions, occurs when no samples were taken or no results were reported during a compliance period.

### **<sup>6</sup>Significant Consumer Notification Violations**

Every Community Water System is required to deliver to its customers a brief annual water quality report (CCR). This report is to include some educational material, and will provide information on the source water, the levels of any detected contaminants, and compliance with drinking water regulations. For this report, a significant public notification violation occurred if a community water system completely failed to provide its customers the required annual water quality report.

## **OBTAINING COPY OF 2007PUBLIC WATER SYSTEMS REPORT**

As required by the Safe Drinking Water Act, the Illinois EPA has made the 2007Public Water Systems report available to the public. Interested individuals can obtain a copy of the 2007 Annual Public Water Systems Report for Illinois by accessing:

**State Website:** <http://www.epa.state.il.us/water/compliance/drinking-water/compliance-report/index.html>

**Telephone:** (217) 785 0561

**Fax Number:** (217) 557 1407

**Address:** Illinois EPA  
Bureau of Water, Compliance Assurance Section  
1021 North Grand Ave  
PO Box 19276  
Springfield, IL 62794

**Contact Name:** Mike Crumly

## **Appendix A**

**The attached tables summarize the number of maximum contaminant level, treatment technique, and significant monitoring violations that occurred during calendar year 2007 for each contaminant regulated by the Safe Drinking Water Act (SDWA). Also identified is the number of public water supplies responsible for the violations and the number of violations that have returned to compliance.**

**Appendix A**  
**Illinois EPA 2007 Annual Compliance Report**  
**Calendar Year 2007**

**Community Water Supplies**

<b>Volatile Organic Chemicals (VOCs)</b>								
<b>Code</b>	<b>Name</b>	<b>MCL (mg/l)</b>	<b>MCLs</b>			<b>Monitoring</b>		
			<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
2977	1,1-Dichloroethylene	0.007	0	0	0	8	0	2
2981	1,1,1-Trichloroethane	0.2	0	0	0	8	0	2
2985	1,1,2-Trichloroethane	0.005	0	0	0	8	0	2
2980	1,2-Dichloroethane	0.005	0	0	0	8	0	2
2983	1,2-Dichloropropane	0.005	0	0	0	8	0	2
2378	1,2,4-Trichlorobenzene	0.07	0	0	0	8	0	2
2990	Benzene	0.005	0	0	0	8	0	2
2982	Carbon Tetrachloride	0.005	0	0	0	8	0	2
2380	Cis-1,2-Dichloroethylene	0.07	0	0	0	8	0	2
2964	Dichloromethane (Methylene Chloride)	0.005	0	0	0	8	0	2
2992	Ethylbenzene	0.7	0	0	0	8	0	2
2989	Monochlorobenzene (Chlorobenzene)	0.1	0	0	0	8	0	2
2968	o-Dichlorobenzene	0.6	0	0	0	8	0	2
2969	p-Dichlorobenzene	0.075	0	0	0	9	0	3
2996	Styrene	0.1	0	0	0	8	0	2
2987	Tetrachloroethylene	0.005	0	0	0	8	0	2
2991	Toluene	1	0	0	0	9	1	3
2979	Trans-1,2-Dichloroethylene	0.1	0	0	0	8	0	2
2984	Trichloroethylene	0.005	0	0	0	8	0	2
2955	Xylenes, Total	10	0	0	0	10	1	4
2976	Vinyl Chloride	0.002	0	0	0	0	0	0
<b>VOC Totals</b>			<b>0</b>	<b>0</b>	<b>0</b>	<b>164</b>	<b>2</b>	<b>4</b>

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.



**Appendix A**  
**Illinois EPA 2007 Annual Compliance Report**  
**Calendar Year 2007**  
**Community Water Supplies**

Synthetic Organic Chemicals (SOCs)								
Code	Name	MCL (mg/l)	MCLs			Monitoring		
			# of Violations	# of RTC Violations	# of PWSs In Violation	# of Violations	# of RTC Violations	# of PWSs In Violation
2931	1,2 Dibromo-3-Chloropropane (DBCP)	0.0002	0	0	0	6	1	3
2105	2,4-D	0.07	0	0	0	6	1	3
2063	2,3,7,8-TCDD (Dioxin)	3x10-8	0	0	0	0	0	0
2110	2,4,5-TP (Silvex)	0.05	0	0	0	6	1	3
2051	Alachlor (Lasso)	0.002	0	0	0	6	1	3
2047	Aldicarb	NA	-	-	-	6	1	3
2044	Aldicarb Sulfone	NA	-	-	-	6	1	3
2043	Aldicarb Sulfoxide	NA	-	-	-	6	1	3
2050	Atrazine	0.003	1	1	1	7	2	4
2306	Benzo (A) Pyrene	0.0002	0	0	0	6	1	3
2010	BHC-gamma (Lindane)	0.0002	0	0	0	6	1	3
2046	Carbofuran	0.04	0	0	0	6	1	3
2959	Chlordane	0.002	0	0	0	6	1	3
2031	Dalapon	0.2	0	0	0	6	1	3
2035	Di(2-Ethylhexyl) Adipate	0.4	0	0	0	6	1	3
2039	Di(2-Ethylhexyl) Phthalate	0.006	0	0	0	8	2	5
2041	Dinoseb	0.007	0	0	0	6	1	3
2032	Diquat	0.02	0	0	0	7	1	4
2033	Endothall	0.1	0	0	0	6	1	3
2005	Endrin	0.002	0	0	0	6	1	3
2946	Ethylene Dibromide (EDB)	0.00005	0	0	0	6	1	3
2034	Glyphosate	0.7	0	0	0	0	0	0
2065	Heptachlor	0.0004	0	0	0	6	1	3
2067	Heptachlor Epoxide	0.0002	0	0	0	6	1	3
2274	Hexachlorobenzene (HCB)	0.001	0	0	0	6	1	3
2042	Hexachlorocyclopentadiene	0.05	0	0	0	6	1	3
2015	Methoxychlor	0.04	0	0	0	6	1	3
2036	Oxamyl (Vydate)	0.2	0	0	0	6	1	3
2326	Pentachlorophenol	0.001	0	0	0	6	1	3
2040	Picloram	0.5	0	0	0	6	1	3

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

**Appendix A**  
**Illinois EPA 2007 Annual Compliance Report**  
**Calendar Year 2007**  
**Community Water Supplies**

SOCs continued								
Code	Name	MCL (mg/l)	MCLs			Monitoring		
			# of Violations	# of RTC Violations	# of PWSs In Violation	# of Violations	# of RTC Violations	# of PWSs In Violation
2037	Simazine	0.004	0	0	0	6	1	3
2383	Total Polychlorinated Biphenyls (PCB)	0.0005	0	0	0	6	1	3
2020	Toxaphene	0.003	0	0	0	6	1	3
<b>SOC Totals</b>			<b>1</b>	<b>1</b>	<b>1</b>	<b>190</b>	<b>34</b>	<b>5</b>

Code	Name	MCL (mg/l)	Treatment Technique			Monitoring		
			# of Violations	# of RTC Violations	# of PWSs In Violation	# of Violations	# of RTC Violations	# of PWSs In Violation
2257	Epichlorohydrin	TT	0	0	0	0	0	0
2265	Acrylamide	TT	0	0	0	0	0	0
<b>Totals</b>			<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

**Appendix A**  
**Illinois EPA 2007 Annual Compliance Report**  
**Calendar Year 2007**  
**Community Water Supplies**

Inorganic Chemicals (IOCs)								
Code	Name	MCL (mg/l)	MCLs			Monitoring		
			# of Violations	# of RTC Violations	# of PWSs In Violation	# of Violations	# of RTC Violations	# of PWSs In Violation
1074	Antimony, Total	0.006	0	0	0	2	1	2
1005	Arsenic	0.05	99	19	28	4	2	4
1010	Barium	2	1	1	1	2	1	2
1075	Beryllium, Total	0.004	0	0	0	2	1	2
1015	Cadmium	0.005	0	0	0	2	1	2
1020	Chromium	0.1	0	0	0	2	1	2
1024	Cyanide	0.2	0	0	0	2	1	2
1025	Fluoride	4	0	0	0	4	2	4
1035	Mercury	0.002	0	0	0	2	1	2
1040	Nitrate	10	0	0	0	23	19	23
1038	Total Nitrite & Nitrate	10	0	0	0	0	0	0
1041	Nitrite	1	1	1	1	8	8	8
1045	Selenium	0.05	0	0	0	2	1	2
1085	Thallium, Total	0.002	0	0	0	2	1	2
1094	Asbestos	7 MFL	0	0	0	0	0	0
<b>IOC Totals</b>			<b>101</b>	<b>21</b>	<b>30</b>	<b>57</b>	<b>30</b>	<b>34</b>

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

**Appendix A**  
**Illinois EPA 2007 Annual Compliance Report**  
**Calendar Year 2007**  
**Community Water Supplies**

<b>Radionuclide Contaminants (RAD)</b>								
<b>Code</b>	<b>Name</b>	<b>MCL</b>	<b>MCLs</b>			<b>Monitoring</b>		
			<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
4000 & 4109	Gross Alpha Adjusted Gross Alpha	15 pCi/L	29	5	9	88	78	29
4010	Radium-226 & Radium-228	5 pCi/L	156	54	48	49	44	32
4006	Uranium	30 pCi/L	0	0	0	10	10	7
4100	Gross Beta	4/mrem/yr	0	0	0	0	0	0
<b>RAD Totals</b>			<b>185</b>	<b>59</b>	<b>48</b>	<b>147</b>	<b>132</b>	<b>35</b>

<b>Coliform (TCR)</b>							
<b>Violation Type</b>	<b>Violation Name</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation*</b>			
21	MCL, Acute	3	3	3			
22	MCL, Monthly	40	40	34			
23, 25	Monitoring Routine & Repeat Major	142	118	99			
		<b>MCLs</b>			<b>Monitoring</b>		
		<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
<b>TCR Totals</b>		<b>43</b>	<b>43</b>	<b>34</b>	<b>142</b>	<b>118</b>	<b>99</b>

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.



**Appendix A**  
**Illinois EPA 2007 Annual Compliance Report**  
**Calendar Year 2007**  
**Community Water Supplies**

<b>Surface Water Treatment Rules (SWTR)</b>											
<b>Violation Type</b>	<b>Contam Code</b>	<b>Violation Name</b>	<b># of Violations</b>			<b># of RTC Violations</b>			<b># of PWSs In Violation*</b>		
41 SWTR	0200	SWTR Treatment Technique, Filtered	69			21			7		
42 SWTR	0200	SWTR Treatment Technique, Unfiltered	0			0			0		
31 and 36	0200	SWTR Major Monitoring, (M/R)	0			0			0		
03 SWTR	0100	Turbidity Monitoring/Reporting	0			0			0		
37 IESWTR	0300	IESWTR Treatment Technique Failure to Profile	0			0			0		
43, 44, and 47 IESWTR	0300	IESWTR Treatment Technique	33			33			7		
29 and 38 IESWTR	0300	IESWTR Major Monitoring	1			1			1		
09 IESWTR	0300	IESWTR Record Keeping	0			0			0		
			<b>MCLs</b>			<b>Monitoring</b>			<b>Treatment Technique</b>		
			<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
<b>SWTR/IESWTR Total</b>			<b>0</b>	<b>0</b>	<b>0</b>	<b>1</b>	<b>1</b>	<b>1</b>	<b>102</b>	<b>54</b>	<b>14</b>

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

**Appendix A**  
**Illinois EPA 2007 Annual Compliance Report**  
**Calendar Year 2007**  
**Community Water Supplies**

<b>Stage 1 Disinfectants and Disinfection Byproducts Rule (Stage 1 DBPR)</b>											
<b>Violation Type</b>	<b>Contam Code</b>	<b>Violation Name</b>				<b># of Violations*</b>	<b># of RTC Violations*</b>	<b># of PWSs In Violation*</b>			
12 and 37	0400	Qualified Operator Failure or Failure to Profile/Consult TT				0	0	0			
46	2920	Inadequate DBP Precursor Removal Treatment Technique				11	7	5			
02	1011	Bromate MCL				1	1	1			
02	1009	Chlorite MCL				0	0	0			
02	2456	Total Haloacetic Acids (HAA) MCL				8	8	4			
02	2950	Total Trihalomethanes (TTHM) MCL				15	10	8			
11	0999	Chlorine Maximum Residual Disinfectant Level (MRDL)				0	0	0			
11	1006	Chloramine MRDL				0	0	0			
11	1008	Chlorine Dioxide MRDL				0	0	0			
11	1008	Chlorine Dioxide Monitoring				0	0	0			
13	1008	Chlorine Dioxide MRDL Acute				0	0	0			
27	0400	No DBPR Monitoring Plan				0	0	0			
27	0999	Chlorine Monitoring				147	139	130			
27	1004	Bromide Monitoring				0	0	0			
27	1006	Chloramine Residual Monitoring				12	12	11			
27	1008	Chlorine Dioxide Residual Monitoring				0	0	0			
27	1009	Chlorite Monitoring				2	2	1			
27	1011	Bromate Monitoring				1	1	1			
27	2456	Total Haloacetic Acids (HAA) Monitoring				2	2	2			
27	2920	TOC Monitoring				2	2	2			
27	1927	Alkalinity				0	0	0			
27	2950	Total Trihalomethanes (TTHM) Monitoring				6	6	6			
			<b>MCLs/MRDL</b>			<b>Monitoring</b>			<b>Treatment Technique</b>		
			<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
<b>DBPR Totals</b>			<b>24</b>	<b>19</b>	<b>12</b>	<b>172</b>	<b>164</b>	<b>149</b>	<b>11</b>	<b>7</b>	<b>5</b>

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

**Appendix A**  
**Illinois EPA 2007 Annual Compliance Report**  
**Calendar Year 2007**  
**Community Water Supplies**

<b>Lead and Copper Rule (LCR)</b>							
<b>Violation Type</b>	<b>Violation Name</b>	<b># of Violations</b>		<b># of RTC Violations</b>	<b># of PWSs In Violation*</b>		
51	Monitoring, Initial Tap Sampling for Pb/Cu	1		0	1		
52	Monitoring, Follow-up & Routine Tap Sampling for Pb/Cu	20		11	18		
58	Treatment Installation	2		2	2		
65	Public Education	1		1	1		
		<b>Monitoring</b>			<b>Treatment Technique</b>		
		<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
<b>LCR Totals</b>		<b>21</b>	<b>11</b>	<b>19</b>	<b>3</b>	<b>3</b>	<b>3</b>

<b>Consumer Notification</b>						
<b>Violation Type</b>	<b>Violation Name</b>	<b># of Violations</b>		<b># of RTC Violations</b>	<b># of PWSs In Violation*</b>	
71	CCR, Significant Reporting	62		59	62	
75	Public Notice Rule Reporting	140		90	76	
<b>TOTAL</b>		<b>202</b>		<b>149</b>	<b>128</b>	

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

**Appendix A**  
**Illinois EPA 2007 Annual Compliance Report**  
**Calendar Year 2007**  
**Non - Community Water Supplies**

Volatile Organic Chemicals (VOCs)								
Code	Name	MCL (mg/l)	MCLs			Monitoring		
			# of Violations	# of RTC Violations	# of PWSs In Violation	# of Violations	# of RTC Violations	# of PWSs In Violation
2977	1,1-Dichloroethylene	0.007	0	0	0	110	67	65
2981	1,1,1-Trichloroethane	0.2	0	0	0	110	67	65
2985	1,1,2-Trichloroethane	0.005	0	0	0	110	67	65
2980	1,2-Dichloroethane	0.005	0	0	0	110	67	65
2983	1,2-Dichloropropane	0.005	0	0	0	110	67	65
2378	1,2,4-Trichlorobenzene	0.07	0	0	0	110	67	65
2990	Benzene	0.005	0	0	0	110	67	65
2982	Carbon Tetrachloride	0.005	0	0	0	110	67	65
2380	Cis-1,2-Dichloroethylene	0.07	0	0	0	110	67	65
2964	Dichloromethane (Methylene Chloride)	0.005	0	0	0	110	67	65
2992	Ethylbenzene	0.7	0	0	0	110	67	65
2989	Monochlorobenzene (Chlorobenzene)	0.1	0	0	0	110	67	65
2968	o-Dichlorobenzene	0.6	0	0	0	110	67	65
2969	p-Dichlorobenzene	0.075	0	0	0	110	67	65
2996	Styrene	0.1	0	0	0	110	67	65
2987	Tetrachloroethylene	0.005	0	0	0	110	67	65
2991	Toluene	1	0	0	0	110	67	65
2979	Trans-1,2-Dichloroethylene	0.1	0	0	0	110	67	65
2984	Trichloroethylene	0.005	1	0	1	110	67	65
2955	Xylenes, Total	10	0	0	0	110	67	65
2976	Vinyl Chloride	0.002	2	2	2	110	67	65
<b>VOC Totals</b>			<b>3</b>	<b>2</b>	<b>3</b>	<b>2,310</b>	<b>1,408</b>	<b>65</b>

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

**Appendix A**  
**Illinois EPA 2007 Annual Compliance Report**  
**Calendar Year 2007**  
**Non - Community Water Supplies**

Synthetic Organic Chemicals (SOCs)								
Code	Name	MCL (mg/l)	MCLs			Monitoring		
			# of Violations	# of RTC Violations	# of PWSs In Violation	# of Violations	# of RTC Violations	# of PWSs In Violation
2931	1,2 Dibromo-3-Chloropropane (DBCP)	0.0002	0	0	0	94	44	52
2105	2,4-D	0.07	0	0	0	96	46	53
2063	2,3,7,8-TCDD (Dioxin)	3x10-8	0	0	0	0	0	0
2110	2,4,5-TP (Silvex)	0.05	0	0	0	94	44	52
2051	Alachlor (Lasso)	0.002	0	0	0	94	44	52
2047	Aldicarb	NA	-	-	-	0	0	0
2044	Aldicarb Sulfone	NA	-	-	-	0	0	0
2043	Aldicarb Sulfoxide	NA	-	-	-	0	0	0
2050	Atrazine	0.003	0	0	0	98	47	53
2306	Benzo (A) Pyrene	0.0002	0	0	0	29	17	20
2010	BHC-gamma (Lindane)	0.0002	0	0	0	94	44	52
2046	Carbofuran	0.04	0	0	0	94	44	52
2959	Chlordane	0.002	0	0	0	94	44	52
2031	Dalapon	0.2	0	0	0	29	17	20
2035	Di(2-Ethylhexyl) Adipate	0.4	0	0	0	29	17	20
2039	Di(2-Ethylhexyl) Phthalate	0.006	0	0	0	29	17	20
2041	Dinoseb	0.007	0	0	0	29	17	20
2032	Diquat	0.02	0	0	0	51	21	42
2033	Endothall	0.1	0	0	0	51	21	42
2005	Endrin	0.002	0	0	0	29	17	20
2946	Ethylene Dibromide (EDB)	0.00005	0	0	0	94	44	52
2034	Glyphosate	0.7	0	0	0	52	21	42
2065	Heptachlor	0.0004	0	0	0	94	44	52
2067	Heptachlor Epoxide	0.0002	0	0	0	94	44	52
2274	Hexachlorobenzene (HCB)	0.001	0	0	0	29	17	20
2042	Hexachlorocyclopentadiene	0.05	0	0	0	29	17	20
2015	Methoxychlor	0.04	0	0	0	94	44	52
2036	Oxamyl (Vydate)	0.2	0	0	0	51	21	42
2326	Pentachlorophenol	0.001	0	0	0	94	44	52
2040	Picloram	0.5	0	0	0	51	21	42

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

**Appendix A**  
**Illinois EPA 2007 Annual Compliance Report**  
**Calendar Year 2007**  
**Non - Community Water Supplies**

SOCs continued								
Code	Name	MCL (mg/l)	MCLs			Monitoring		
			# of Violations	# of RTC Violations	# of PWSs In Violation	# of Violations	# of RTC Violations	# of PWSs In Violation
2037	Simazine	0.004	0	0	0	51	21	42
2383	Total Polychlorinated Biphenyls (PCB)	0.0005	0	0	0	95	44	52
2020	Toxaphene	0.003	0	0	0	94	44	52
<b>SOC Totals</b>			<b>0</b>	<b>0</b>	<b>0</b>	<b>1,956</b>	<b>927</b>	<b>53</b>

Code	Name	MCL (mg/l)	Treatment Technique			Monitoring		
			# of Violations	# of RTC Violations	# of PWSs In Violation	# of Violations	# of RTC Violations	# of PWSs In Violation
2257	Epichlorohydrin	TT	0	0	0	0	0	0
2265	Acrylamide	TT	0	0	0	0	0	0
<b>Totals</b>			<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

**Appendix A**  
**Illinois EPA 2007 Annual Compliance Report**  
**Calendar Year 2007**  
**Non - Community Water Supplies**

<b>Inorganic Chemicals (IOCs)</b>								
<b>Code</b>	<b>Name</b>	<b>MCL (mg/l)</b>	<b>MCLs</b>			<b>Monitoring</b>		
			<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
1074	Antimony, Total	0.006	0	0	0	30	8	30
1005	Arsenic	0.05	0	0	0	63	24	58
1010	Barium	2	0	0	0	30	8	30
1075	Beryllium, Total	0.004	0	0	0	30	8	30
1015	Cadmium	0.005	0	0	0	33	10	30
1020	Chromium	0.1	0	0	0	30	8	30
1024	Cyanide	0.2	0	0	0	30	8	30
1025	Fluoride	4	0	0	0	0	0	0
1035	Mercury	0.002	0	0	0	30	8	30
1040	Nitrate	10	14	2	14	30	1	13
1038	Total Nitrite & Nitrate	10	0	0	0	0	0	0
1041	Nitrite	1	0	0	0	0	0	0
1045	Selenium	0.05	0	0	0	30	8	30
1085	Thallium, Total	0.002	0	0	0	30	8	30
1094	Asbestos	7 MFL	0	0	0	0	0	0
<b>IOC Totals</b>			<b>14</b>	<b>2</b>	<b>14</b>	<b>366</b>	<b>99</b>	<b>58</b>

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.



**Appendix A**  
**Illinois EPA 2007 Annual Compliance Report**  
**Calendar Year 2007**  
**Non - Community Water Supplies**

<b>Coliform (TCR)</b>							
<b>Violation Type</b>	<b>Violation Name</b>	<b># of Violations</b>		<b># of RTC Violations</b>	<b># of PWSs In Violation*</b>		
21	MCL, Acute	21		8	19		
22	MCL, Monthly	92		72	89		
23, 25	Monitoring Routine & Repeat Major	262		174	144		
		<b>MCLs</b>			<b>Monitoring</b>		
		<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
<b>TCR Totals</b>		<b>113</b>	<b>80</b>	<b>108</b>	<b>262</b>	<b>174</b>	<b>144</b>

<b>Lead and Copper Rule (LCR)</b>							
<b>Violation Type</b>	<b>Violation Name</b>	<b># of Violations</b>		<b># of RTC Violations</b>	<b># of PWSs In Violation*</b>		
51	Monitoring, Initial Tap Sampling for Pb/Cu	38		18	37		
52	Monitoring, Follow-up & Routine Tap Sampling for Pb/Cu	24		8	24		
58	Treatment Installation	0		0	0		
65	Public Education	0		0	0		
		<b>Monitoring</b>			<b>Treatment Technique</b>		
		<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
<b>LCR Totals</b>		<b>62</b>	<b>26</b>	<b>37</b>	<b>0</b>	<b>0</b>	<b>0</b>

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.



**Appendix A**  
**Illinois EPA 2007 Annual Compliance Report**  
**Calendar Year 2007**  
**Non - Community Water Supplies**

Stage 1 Disinfectants and Disinfection Byproducts Rule (Stage 1 DBPR)										
Violation Type	Contam Code	Violation Name	# of Violations	# of RTC Violations	# of PWSs In Violation*					
12 and 37	0400	Qualified Operator Failure or Failure to Profile/Consult TT	0	0	0					
46	2920	Inadequate DBP Precursor Removal Treatment Technique	0	0	0					
02	1011	Bromate MCL	0	0	0					
02	1009	Chlorite MCL	0	0	0					
02	2456	Total Haloacetic Acids (HAA) MCL	1	0	1					
02	2950	Total Trihalomethanes (TTHM) MCL	0	0	0					
11	0999	Chlorine Maximum Residual Disinfectant Level (MRDL)	0	0	0					
11	1006	Chloramine MRDL	0	0	0					
11	1008	Chlorine Dioxide MRDL	0	0	0					
11	1008	Chlorine Dioxide Monitoring	0	0	0					
13	1008	Chlorine Dioxide MRDL Acute	0	0	0					
27	0400	No DBPR Monitoring Plan	0	0	0					
27	0999	Chlorine Monitoring	0	0	0					
27	1004	Bromide Monitoring	0	0	0					
27	1006	Chloramine Residual Monitoring	0	0	0					
27	1008	Chlorine Dioxide Residual Monitoring	0	0	0					
27	1009	Chlorite Monitoring	0	0	0					
27	1011	Bromate Monitoring	0	0	0					
27	2456	Total Haloacetic Acids (HAA) Monitoring	7	5	7					
27	2920	TOC Monitoring	0	0	0					
27	2950	Total Trihalomethanes (TTHM) Monitoring	7	5	7					
		<b>MCLs/MRDL</b>			<b>Monitoring</b>			<b>Treatment Technique</b>		
		# of Violations	# of RTC Violations	# of PWSs In Violation	# of Violations	# of RTC Violations	# of PWSs In Violation	# of Violations	# of RTC Violations	# of PWSs In Violation
<b>Stage 1 DBPR Totals</b>		<b>1</b>	<b>0</b>	<b>1</b>	<b>14</b>	<b>10</b>	<b>7</b>	<b>0</b>	<b>0</b>	<b>0</b>

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

**Appendix A**  
**Illinois EPA 2007 Annual Compliance Report**  
**Calendar Year 2007**  
**Community Water Supplies**

<b>2007 State Summary – Community Water Supplies (CWS)</b>										
<b>Rule Group</b>	<b>Chemical Sub-Group</b>	<b>MCLs</b>			<b>Monitoring/Notification</b>			<b>Treatment Technique</b>		
		<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
CHEM	VOC	0	0	0	164	2	4			
	SOC	1	1	1	190	34	5			
	IOC	101	21	30	57	30	34			
	RAD	185	59	48	147	132	35			
<b>CHEM Subtotal</b>		287	80	78	558	198	67			
<b>TCR Subtotal</b>		43	43	34	142	118	99			
<b>Stage 1 DBPR Subtotal</b>		24	19	12	172	164	149	11	7	5
<b>All SWTRs Subtotal</b>					1	1	1	102	54	14
<b>LCR Subtotal</b>					21	11	19	3	3	3
<b>Consumer Notification Subtotal</b>					202	149	128			
<b>TOTAL</b>		<b>354</b>	<b>142</b>	<b>123</b>	<b>1,096</b>	<b>641</b>	<b>338</b>	<b>116</b>	<b>64</b>	<b>21</b>
<b>Total Number of CWSs</b>				<b>Grand Total Number CWS Violations (MCL, Monitoring, and Treatment Technique)</b>				<b>Grand Total of CWSs in Violation (MCL, Monitoring, and Treatment Technique)</b>		
<b>1,787</b>				<b>1,566</b>				<b>418</b>		

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

**Appendix A**  
**Illinois EPA 2007 Annual Compliance Report**  
**Calendar Year 2007**  
**Non - Community Water Supplies**

<b>2007 State Summary – Non-Community Water Supplies (CWS)</b>										
<b>Rule Group</b>	<b>Chemical Sub-Group</b>	<b>MCLs</b>			<b>Monitoring/Notification</b>			<b>Treatment Technique</b>		
		<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>	<b># of Violations</b>	<b># of RTC Violations</b>	<b># of PWSs In Violation</b>
CHEM	VOC	3	2	3	2310	1408	65			
	SOC	0	0	0	1956	927	53			
	IOC	14	2	14	336	99	58			
<b>CHEM Subtotal</b>		17	4	17	4632	2434	176			
<b>TCR Subtotal</b>		113	80	108	262	174	144			
<b>Stage 1 DBPR Subtotal</b>		1	0	1	14	10	7	0	0	0
<b>All SWTRs Subtotal</b>					6	6	1	3	3	3
<b>LCR Subtotal</b>					62	26	37	0	0	0
<b>Consumer Notification Subtotal</b>					0	0	0			
<b>TOTAL</b>		<b>131</b>	<b>84</b>	<b>126</b>	<b>4976</b>	<b>2650</b>	<b>365</b>	<b>3</b>	<b>3</b>	<b>3</b>
<b>Total Number of CWSs</b>				<b>Grand Total Number CWS Violations (MCL, Monitoring, and Treatment Technique)</b>				<b>Grand Total of CWSs in Violation (MCL, Monitoring, and Treatment Technique)</b>		
<b>4,132</b>				<b>5,110</b>				<b>365</b>		

Note: Although a PWS may be out of compliance with more than one contaminant or violation type, when calculating totals, it's counted no more than once within the population being totaled. So, the sum of NUMBER OF PWSs IN VIOLATION, over the various violation types or contaminants, may not add up to the total.

## **Appendix B**

**The attached report identifies all public water supplies with maximum contaminant level and treatment technique violations in contaminant order.**

# ***Appendix B***

## *Illinois EPA 2007 Annual Compliance*

### *Maximum Contaminant Level and Treatment Technique Violations*

#### *Listing by Contaminant*

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1830050 ALVAN	<b>Arsenic MCL</b>	Returned to Compliance
IL0750050 ASHKUM	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0755150 BELMONT ACRES MWC	<b>Arsenic MCL</b>	Enforcement in Process
IL1015300 BIRDS PINKSTAFF WATER DISTRICT	<b>Arsenic MCL</b>	Enforcement in process
IL0450100 CHRISMAN	<b>Arsenic MCL</b>	Returned to Compliance
IL1130400 COOKSVILLE	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0195865 COUNTRY TYME ESTATES	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL1130450 DANVERS	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL1130450 DANVERS	<b>Arsenic MCL</b>	Returned to Compliance
IL0390100 DE WITT	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0195945 FOUNTAIN VALLEY MHP	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0735600 GENESEO HILLS SUBDIVISION	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0990200 GRAND RIDGE	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0390200 KENNEY	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0735280 LYNWOOD 3RD ADDITION	<b>Arsenic MCL</b>	Returned to Compliance
IL1250350 MASON CITY	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL1795345 MORTON MOBILE HOME PARK	<b>Arsenic MCL</b>	Enforcement in process
IL0110800 OHIO	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0590300 RIDGWAY	<b>Arsenic MCL</b>	Returned to Compliance



# *Appendix B*

## *Illinois EPA 2007 Annual Compliance*

### *Maximum Contaminant Level and Treatment Technique Violations*

#### *Listing by Contaminant*

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1830800 ROSSVILLE	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0735500 RUSTIC ACRES WATER ASSOCIATION	<b>Arsenic MCL</b>	Enforcement in Process
IL0115525 THE GROVE MHP	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL2035225 TIMBERLINE MHP	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0991150 TONICA	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0195925 TRIANGLE MHP	<b>Arsenic MCL</b>	Returned to Compliance
IL0370600 WATERMAN	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0750900 WATSEKA	<b>Arsenic MCL</b>	Returned to Compliance
IL0390300 WAYNESVILLE	<b>Arsenic MCL</b>	Under compliance commitment agreement/schedule
IL0735120 WOLF RIDGE WELL CORPORATION	<b>Arsenic MCL</b>	Returned to Compliance
IL1570250 EVANSVILLE	<b>Atrazine MCL</b>	Returned to Compliance
IL0314120 BARTLETT	<b>Barium MCL</b>	Returned to Compliance
IL1730100 FINDLAY	<b>Bromate MCL</b>	Returned to Compliance
IL3009415 ALLENS CORNER	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL3021824 ARGYLE LAKE STATE PARK (21824)	<b>Coliform (Acute) MCL</b>	Enforcement in Process
IL3076265 AROMA PARK AMERICAN LEGION	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL0910250 BUCKINGHAM	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL3097790 CAMP ONE WAY	<b>Coliform (Acute) MCL</b>	Enforcement in Process
IL3123802 CHUBBYS CORNER	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL3022376 CRAZY HORSE BIG INDIAN CAMPGRN	<b>Coliform (Acute) MCL</b>	Enforcement in Process
IL1975105 CRISWELL COURT MHP	<b>Coliform (Acute) MCL</b>	Returned to Compliance

# ***Appendix B***

## *Illinois EPA 2007 Annual Compliance*

### *Maximum Contaminant Level and Treatment Technique Violations*

#### *Listing by Contaminant*

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3100727 FAMILY PICNIC AREA 3116	<b>Coliform (Acute) MCL</b>	Enforcement in Process
IL3118232 FRANKLY YOURS	<b>Coliform (Acute) MCL</b>	Enforcement in Process
IL3150300 LAKE CARROLL POOL	<b>Coliform (Acute) MCL</b>	Enforcement in Process
IL3070813 LAKESIDE CAMPING RESORT (70813)	<b>Coliform (Acute) MCL</b>	Enforcement in Process
IL3119776 LUNDEENS LANDING CAMPGROUND	<b>Coliform (Acute) MCL</b>	Enforcement in Process
IL3006940 MARSHALL CO SPORTSMENS CLUB (6940)	<b>Coliform (Acute) MCL</b>	Enforcement in Process
IL3022657 MOBIL GAS FOOD MART #18	<b>Coliform (Acute) MCL</b>	Enforcement in Process
IL3026799 MOBIL STORE #42	<b>Coliform (Acute) MCL</b>	Enforcement in Process
IL3096081 OKAW VALLEY KAMPGROUND (IL3096081)	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL3066399 OLD STARKS TAVERN	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL3137018 PLEASANT VALLEY LAKES/RDHOUSE	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL0312550 RICHTON PARK	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL3024786 RIVER RESTAURANT	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL3004242 THE PALACE	<b>Coliform (Acute) MCL</b>	Returned to Compliance
IL0015350 ABS WATER COOP	<b>Coliform MCL</b>	Returned to Compliance
IL3009415 ALLENS CORNER	<b>Coliform MCL</b>	Returned to Compliance
IL3002030 ANCIENT OAKS YOUTH CAMP	<b>Coliform MCL</b>	Enforcement in Process
IL3146043 APPLE BLOSSOM FARM (146043)	<b>Coliform MCL</b>	Returned to Compliance
IL3076265 AROMA PARK AMERICAN LEGION	<b>Coliform MCL</b>	Returned to Compliance
IL3137547 BIG BASIN MARINA	<b>Coliform MCL</b>	Returned to Compliance
IL3115618 BIG RIVER STATE FOREST OFFICE	<b>Coliform MCL</b>	Enforcement in Process
IL3048801 BLACK HAWK SCHOOL SKIP PROGRAM	<b>Coliform MCL</b>	Returned to Compliance

# *Appendix B*

## *Illinois EPA 2007 Annual Compliance*

### *Maximum Contaminant Level and Treatment Technique Violations*

#### *Listing by Contaminant*

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3150359 BOONDOCKS	<b>Coliform MCL</b>	Returned to Compliance
IL3135525 BRIGHTWOOD INN	<b>Coliform MCL</b>	Returned to Compliance
IL3142570 BRIMFIELD EVANGELICAL FREE CHURCH	<b>Coliform MCL</b>	Returned to Compliance
IL3138859 BRISTOL TAP	<b>Coliform MCL</b>	Returned to Compliance
IL0190050 BROADLANDS	<b>Coliform MCL</b>	Returned to Compliance
IL0910250 BUCKINGHAM	<b>Coliform MCL</b>	Returned to Compliance
IL3151266 CABIN FEVER CAMPGROUND	<b>Coliform MCL</b>	Enforcement in Process
IL3003921 CAMP GRESHIEM CHRISTIAN RETREA	<b>Coliform MCL</b>	Enforcement in Process
IL1610120 CANDLE LIGHT COMMUNITY MHP	<b>Coliform MCL</b>	Returned to Compliance
IL3016246 CHALET CHATEAU	<b>Coliform MCL</b>	Returned to Compliance
IL3120600 CHEBANSE RECREATION AREA MAIN	<b>Coliform MCL</b>	Enforcement in Process
IL3148536 CHRIST ALIVE COMMUNITY CHURCH (148536)	<b>Coliform MCL</b>	Returned to Compliance
IL3115386 CLARK CPD MILL CREEK CAMPGROUN	<b>Coliform MCL</b>	Enforcement in Process
IL0735345 COLONA PARK LLC - FORMERLY KERSHAW MHP	<b>Coliform MCL</b>	Returned to Compliance
IL3147512 COMMUNITY BIBLE CHURCH	<b>Coliform MCL</b>	Returned to Compliance
IL3097584 COUNTRYSIDE BAR & GRILL	<b>Coliform MCL</b>	Returned to Compliance
IL1975105 CRISWELL COURT MHP	<b>Coliform MCL</b>	Returned to Compliance
IL3109876 CUSTERS KEG	<b>Coliform MCL</b>	Returned to Compliance
IL3096115 DIMMICK CONSOL COMM SCHOOL 175	<b>Coliform MCL</b>	Returned to Compliance
IL3020552 EDWARDS TAP	<b>Coliform MCL</b>	Returned to Compliance
IL3114843 ELIZA KOUNTRY KAFE	<b>Coliform MCL</b>	Enforcement in Process
IL3040493 EPWORTH CHURCH PRESCHOOL	<b>Coliform MCL</b>	Returned to Compliance

# *Appendix B*

## *Illinois EPA 2007 Annual Compliance*

### *Maximum Contaminant Level and Treatment Technique Violations*

#### *Listing by Contaminant*

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3015446 FABYAN FOREST PRESERVE	<b>Coliform MCL</b>	Returned to Compliance
IL3122804 FAIRVIEW UNITED METHODIST CH	<b>Coliform MCL</b>	Returned to Compliance
IL3019687 FIRST UNITED METHODIST CH CAMP	<b>Coliform MCL</b>	Returned to Compliance
IL3068817 GENEVA MOTEL	<b>Coliform MCL</b>	Enforcement in Process
IL3140822 GRACE FELLOWSHIP CHURCH	<b>Coliform MCL</b>	Enforcement in Process
IL1035165 GREEN ACRES MHP	<b>Coliform MCL</b>	Returned to Compliance
IL1790250 GREEN VALLEY	<b>Coliform MCL</b>	Returned to Compliance
IL3026963 GREENSHIRE GOLF COURSE	<b>Coliform MCL</b>	Enforcement in Process
IL0130200 HARDIN	<b>Coliform MCL</b>	Returned to Compliance
IL3138941 HARDYS REINDEER RANCH	<b>Coliform MCL</b>	Returned to Compliance
IL3062588 HARRISON ELEMENTARY SCHOOL	<b>Coliform MCL</b>	Returned to Compliance
IL1795450 HARVARD HILLS WATER CORPORATION	<b>Coliform MCL</b>	Returned to Compliance
IL3003665 HENNEPIN CANAL PKWY ST PK (3665)	<b>Coliform MCL</b>	Returned to Compliance
IL1795495 HIATTS HIDEAWAY MHP	<b>Coliform MCL</b>	Returned to Compliance
IL0735329 HILLCREST HOME	<b>Coliform MCL</b>	Returned to Compliance
IL3009498 HILLS COUNTRY STORE	<b>Coliform MCL</b>	Returned to Compliance
IL3131763 HORSE FAIR PARK	<b>Coliform MCL</b>	Returned to Compliance
IL3129080 I AM I CAN	<b>Coliform MCL</b>	Returned to Compliance
IL0430552 IL AMERICAN-DUPAGE UTILITY	<b>Coliform MCL</b>	Returned to Compliance
IL1974151 IL AMERICAN-WEST SUBURBAN	<b>Coliform MCL</b>	Returned to Compliance
IL3001115 INDIAN BLUFF FOREST PRESERVE	<b>Coliform MCL</b>	Returned to Compliance
IL3049296 ISLAND MARINA	<b>Coliform MCL</b>	Returned to Compliance

# *Appendix B*

## *Illinois EPA 2007 Annual Compliance*

### *Maximum Contaminant Level and Treatment Technique Violations*

#### *Listing by Contaminant*

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3150078 JEHOVAHS WITNESSES	<b>Coliform MCL</b>	Returned to Compliance
IL0830250 JERSEYVILLE	<b>Coliform MCL</b>	Returned to Compliance
IL3014506 KAMP KOMFORT C/O CLIFF OCKER	<b>Coliform MCL</b>	Returned to Compliance
IL3126540 KARBANS KNOTTY PINES	<b>Coliform MCL</b>	Returned to Compliance
IL3007658 KELLYS MERNA TAP	<b>Coliform MCL</b>	Returned to Compliance
IL0950300 KNOXVILLE	<b>Coliform MCL</b>	Returned to Compliance
IL3149286 LAKE BRACKEN CC GOLF COURSE BATH ROOM	<b>Coliform MCL</b>	Enforcement in Process
IL3111070 LAKEPOINT CLUB % GEORGE KAPPOS	<b>Coliform MCL</b>	Enforcement in Process
IL0315880 LEYDEN TWSP WATER DISTRICT	<b>Coliform MCL</b>	Returned to Compliance
IL3085902 LOUD THUNDER FOREST PRESERVE B	<b>Coliform MCL</b>	Returned to Compliance
IL3148684 LUCIANAS RURAL OAKS	<b>Coliform MCL</b>	Returned to Compliance
IL3063263 LUCKYS PORT GRILL	<b>Coliform MCL</b>	Enforcement in Process
IL1150300 MAROA	<b>Coliform MCL</b>	Returned to Compliance
IL3150391 MAXEY CHAPEL UNITED METHODIST CHURCH	<b>Coliform MCL</b>	Returned to Compliance
IL3151118 MCCD PLEASANT VALLEY CONSERVATION AREA	<b>Coliform MCL</b>	Returned to Compliance
IL3095380 MCGRAW WILDLIFE FOUNDATION (95380)	<b>Coliform MCL</b>	Returned to Compliance
IL1415165 MERIDIAN MHP	<b>Coliform MCL</b>	Returned to Compliance
IL1610400 MILAN	<b>Coliform MCL</b>	Returned to Compliance
IL3128561 MILLERS AQUATICS	<b>Coliform MCL</b>	Returned to Compliance
IL3073049 MONTESSORI ACADEMY	<b>Coliform MCL</b>	Returned to Compliance
IL3108951 MORAIN VIEW SP	<b>Coliform MCL</b>	Returned to Compliance
IL3057703 MUSTANG SALLYS BAR & BOWL	<b>Coliform MCL</b>	Returned to Compliance

# *Appendix B*

## *Illinois EPA 2007 Annual Compliance*

### *Maximum Contaminant Level and Treatment Technique Violations*

#### *Listing by Contaminant*

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3009324 NIKOS LODGE BAR & GRILL	<b>Coliform MCL</b>	Enforcement in Process
IL3124685 NORTH DANVERS MENNONITE CHURCH	<b>Coliform MCL</b>	Returned to Compliance
IL3123695 NORWAY STORE	<b>Coliform MCL</b>	Returned to Compliance
IL2035300 OAK RIDGE SD	<b>Coliform MCL</b>	Returned to Compliance
IL0430010 OBT SERVICE CORPORATION	<b>Coliform MCL</b>	Returned to Compliance
IL3002709 OKAW VALLEY CAMPGROUND (IL3002709)	<b>Coliform MCL</b>	Returned to Compliance
IL3096081 OKAW VALLEY KAMPGROUND (IL3096081)	<b>Coliform MCL</b>	Enforcement in Process
IL3122192 PARK HILLS GOLF COURSE (122192) HOUSE	<b>Coliform MCL</b>	Enforcement in Process
IL3127761 PETER RABBIT DAY CARE SCHOOL	<b>Coliform MCL</b>	Returned to Compliance
IL3019455 PILGRIM PARK CAMP #1 MAIN WELL	<b>Coliform MCL</b>	Returned to Compliance
IL1490750 PITTSFIELD	<b>Coliform MCL</b>	Returned to Compliance
IL3137018 PLEASANT VALLEY LAKES/RDHOUSE	<b>Coliform MCL</b>	Returned to Compliance
IL3062398 PRAIRIE GROVE SCHOOL	<b>Coliform MCL</b>	Returned to Compliance
IL3005256 PRAIRIEVIEW JR. HIGH SCHOOL	<b>Coliform MCL</b>	Returned to Compliance
IL1615580 RAINBOW RIDGE	<b>Coliform MCL</b>	Returned to Compliance
IL3025841 RENDEZVOUS	<b>Coliform MCL</b>	Returned to Compliance
IL0312550 RICHTON PARK	<b>Coliform MCL</b>	Returned to Compliance
IL3007609 ROBERT ALLERTON PARK	<b>Coliform MCL</b>	Returned to Compliance
IL1410500 ROCHELLE	<b>Coliform MCL</b>	Returned to Compliance
IL3125310 ROCK ISLAND TRAIL STATE PARK T	<b>Coliform MCL</b>	Returned to Compliance
IL3125088 RP LUMBER	<b>Coliform MCL</b>	Returned to Compliance
IL3097477 RUTLAND SCHOOL DIST 230	<b>Coliform MCL</b>	Returned to Compliance

# *Appendix B*

## *Illinois EPA 2007 Annual Compliance*

### *Maximum Contaminant Level and Treatment Technique Violations*

#### *Listing by Contaminant*

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1210500 SANDOVAL	<b>Coliform MCL</b>	Returned to Compliance
IL0195150 SANGAMON VALLEY PWD	<b>Coliform MCL</b>	Returned to Compliance
IL3137091 SHALLOWBROOK FARM RETREAT CTR	<b>Coliform MCL</b>	Returned to Compliance
IL3017947 SHAW-WAW-NA-SEE 4H CAMP #2	<b>Coliform MCL</b>	Returned to Compliance
IL1615750 SILVIS HEIGHTS WATER CORP	<b>Coliform MCL</b>	Returned to Compliance
IL3096180 SPRING BROOK MARINA INC	<b>Coliform MCL</b>	Returned to Compliance
IL3050856 ST PAULS	<b>Coliform MCL</b>	Returned to Compliance
IL0275250 ST ROSE PWD	<b>Coliform MCL</b>	Returned to Compliance
IL3094227 STARVED ROCK STATE PARK (94227)	<b>Coliform MCL</b>	Enforcement in Process
IL3142224 STERLING STEEL BALL	<b>Coliform MCL</b>	Returned to Compliance
IL1390300 SULLIVAN	<b>Coliform MCL</b>	Returned to Compliance
IL3062893 SUNRISE GROCERY (62893)	<b>Coliform MCL</b>	Returned to Compliance
IL3009613 SUTTERS COUNTRY KITCHEN	<b>Coliform MCL</b>	Returned to Compliance
IL3049163 SYCAMORE BAPTIST CHURCH	<b>Coliform MCL</b>	Returned to Compliance
IL3136275 THE SCOTTS COMPANY	<b>Coliform MCL</b>	Enforcement in Process
IL1790700 TREMONT	<b>Coliform MCL</b>	Returned to Compliance
IL3104000 USFS JOHNSON CREEK RECREATION AREA	<b>Coliform MCL</b>	Returned to Compliance
IL3111179 USFS PINERIDGE CAMPGROUND LOOP 4	<b>Coliform MCL</b>	Returned to Compliance
IL3104703 USFS TOWER ROCK CAMPGROUND	<b>Coliform MCL</b>	Enforcement in Process
IL3064782 VALLEY VIEW SCHOOL	<b>Coliform MCL</b>	Returned to Compliance
IL3005777 VICTORY BAPTIST CHURCH	<b>Coliform MCL</b>	Returned to Compliance
IL3139139 WELDON SPRINGS SP SHWRHSE	<b>Coliform MCL</b>	Returned to Compliance



# Appendix B

## Illinois EPA 2007 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Contaminant

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3149229 WESTERN ILLINOIS NATURE GROUP	<b>Coliform MCL</b>	Returned to Compliance
IL1770550 WINSLOW	<b>Coliform MCL</b>	Returned to Compliance
IL0971950 WINTHROP HARBOR	<b>Coliform MCL</b>	Returned to Compliance
IL3014282 WOLFCREEK COUNTRY CLUB	<b>Coliform MCL</b>	Returned to Compliance
IL1977210 AQUA ILLINOIS-OAKVIEW	<b>Combined Radium MCL</b>	Returned to Compliance
IL0314120 BARTLETT	<b>Combined Radium MCL</b>	Returned to Compliance
IL0710050 BIGGSVILLE	<b>Combined Radium MCL</b>	Enforcement in Process
IL0570200 BRYANT	<b>Combined Radium MCL</b>	Returned to Compliance
IL1610100 CARBON CLIFF	<b>Combined Radium MCL</b>	Returned to Compliance
IL1970070 CHANNAHON EAST	<b>Combined Radium MCL</b>	Returned to Compliance
IL0370051 CORTLAND	<b>Combined Radium MCL</b>	Returned to Compliance
IL1030200 DIXON	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL1435150 EDELSTEIN WATER COOP	<b>Combined Radium MCL</b>	Enforcement in process
IL0975736 ELM OAK MUTUAL WATER SYSTEM	<b>Combined Radium MCL</b>	Enforcement in Process
IL1971150 FOSSIL ROCK RECREATION AREA	<b>Combined Radium MCL</b>	CWS is Inactive
IL0990060 FOUR STAR CAMPGROUND	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL2015495 GEM SUBURBAN MHP	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL0890350 GENEVA	<b>Combined Radium MCL</b>	Returned to Compliance
IL1430350 GLASFORD	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL1030300 HARMON	<b>Combined Radium MCL</b>	Returned to Compliance
IL0370200 HINCKLEY	<b>Combined Radium MCL</b>	Returned to Compliance
IL1110350 HUNTLEY	<b>Combined Radium MCL</b>	Returned to Compliance

# *Appendix B*

## *Illinois EPA 2007 Annual Compliance*

### *Maximum Contaminant Level and Treatment Technique Violations*

#### *Listing by Contaminant*

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL0995300 IL PRAIRIE ESTATE SBDV WATER ASSOCIATION	<b>Combined Radium MCL</b>	Returned to Compliance
IL1115080 JOHNSBURG NO.2	<b>Combined Radium MCL</b>	Returned to Compliance
IL1970450 JOLIET	<b>Combined Radium MCL</b>	Returned to Compliance
IL1430450 KINGSTON MINES	<b>Combined Radium MCL</b>	Enforcement in process
IL0630450 KINSMAN	<b>Combined Radium MCL</b>	Returned to Compliance
IL1870050 KIRKWOOD	<b>Combined Radium MCL</b>	Enforcement in Process
IL0970850 LAKE ZURICH	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL0310370 LINDENTREE TOWNHOMES	<b>Combined Radium MCL</b>	Returned to Compliance
IL0995336 LYNNWOOD WATER CORPORATION	<b>Combined Radium MCL</b>	Enforcement in process
IL1970550 MANHATTAN	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL0990550 MENDOTA	<b>Combined Radium MCL</b>	Enforcement in Process
IL0935140 MORGAN CREEK	<b>Combined Radium MCL</b>	Returned to Compliance
IL1410350 MOUNT MORRIS	<b>Combined Radium MCL</b>	Enforcement in Process
IL0990600 NAPLATE	<b>Combined Radium MCL</b>	Enforcement in process
IL0110700 NEPONSET	<b>Combined Radium MCL</b>	Enforcement in process
IL0890600 NORTH AURORA	<b>Combined Radium MCL</b>	Returned to Compliance
IL0990650 NORTH UTICA	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL0317080 PLUM CREEK CONDOS	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL0990900 RANSOM	<b>Combined Radium MCL</b>	Enforcement in process
IL0914780 REDDICK	<b>Combined Radium MCL</b>	Enforcement in process
IL1970850 ROCKDALE	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL2010300 ROCKFORD	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule

# Appendix B

## Illinois EPA 2007 Annual Compliance Maximum Contaminant Level and Treatment Technique Violations

### Listing by Contaminant

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL2010350 ROCKTON	<b>Combined Radium MCL</b>	Returned to Compliance
IL0890040 SILVER GLEN ESTS	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL1550300 STANDARD	<b>Combined Radium MCL</b>	Returned to Compliance
IL0370550 SYCAMORE	<b>Combined Radium MCL</b>	Enforcement in Process
IL2015160 UTL INC-COVENTRY CREEK SUBDIVISION	<b>Combined Radium MCL</b>	Under compliance commitment agreement/schedule
IL0855050 UTL INC-GALENA TERRITORY UTILITES	<b>Combined Radium MCL</b>	Returned to Compliance
IL0995425 WILDLIFE MHP	<b>Combined Radium MCL</b>	Enforcement in process
IL0970080 WYNSTONE WATER COMPANY	<b>Combined Radium MCL</b>	Returned to Compliance
IL1070300 LATHAM	<b>Failure to install OCCT</b>	Returned to Compliance
IL0735850 NORTH HAZELWOOD SBDV	<b>Failure to install OCCT</b>	Returned to Compliance
IL0710050 BIGGSVILLE	<b>Gross Alpha MCL</b>	Enforcement in Process
IL1435150 EDELSTEIN WATER COOP	<b>Gross Alpha MCL</b>	Enforcement in process
IL1971150 FOSSIL ROCK RECREATION AREA	<b>Gross Alpha MCL</b>	CWS is Inactive
IL0990060 FOUR STAR CAMPGROUND	<b>Gross Alpha MCL</b>	Under compliance commitment agreement/schedule
IL0890350 GENEVA	<b>Gross Alpha MCL</b>	Returned to Compliance
IL1430350 GLASFORD	<b>Gross Alpha MCL</b>	Under compliance commitment agreement/schedule
IL1430450 KINGSTON MINES	<b>Gross Alpha MCL</b>	Enforcement in process
IL0110700 NEPONSET	<b>Gross Alpha MCL</b>	Enforcement in process
IL1550300 STANDARD	<b>Gross Alpha MCL</b>	Returned to Compliance
IL1090100 BLANDINSVILLE	<b>Inadequate DBP Precursor Removal TT</b>	Under compliance commitment agreement/schedule
IL1170150 CARLINVILLE	<b>Inadequate DBP Precursor Removal TT</b>	Returned to Compliance

# *Appendix B*

## *Illinois EPA 2007 Annual Compliance*

### *Maximum Contaminant Level and Treatment Technique Violations*

#### *Listing by Contaminant*

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL0670450 LA HARPE	<b>Inadequate DBP Precursor Removal TT</b>	Returned to Compliance
IL1170700 MOUNT OLIVE	<b>Inadequate DBP Precursor Removal TT</b>	Returned to Compliance
IL1590200 OLNEY	<b>Inadequate DBP Precursor Removal TT</b>	Returned to Compliance
IL1370040 APPLE CREEK WATER COOP	<b>Insufficient Inactivation TT</b>	Returned to Compliance
IL1170700 MOUNT OLIVE	<b>Insufficient Inactivation TT</b>	Under compliance commitment agreement/schedule
IL0350150 NEOGA	<b>Insufficient Inactivation TT</b>	Under compliance commitment agreement/schedule
IL1670800 NEW BERLIN	<b>Insufficient Inactivation TT</b>	Returned to Compliance
IL1175250 STAUNTON RESIDENTIAL ROAD WATER COOP	<b>Insufficient Inactivation TT</b>	Purchase Water
IL1370450 WAVERLY	<b>Insufficient Inactivation TT</b>	Returned to Compliance
IL1171150 WHITE CITY	<b>Insufficient Inactivation TT</b>	Purchase Water
IL0530350 ROBERTS	<b>Lead Public Education TT</b>	Returned to Compliance
IL1090050 BARDOLPH	<b>Monthly Combined Filter Effluent TT</b>	Returned to Compliance
IL1090200 COLCHESTER	<b>Monthly Combined Filter Effluent TT</b>	Returned to Compliance
IL0910020 LAKE SHANNON	<b>Monthly Combined Filter Effluent TT</b>	Returned to Compliance
IL1090350 MACOMB	<b>Monthly Combined Filter Effluent TT</b>	Returned to Compliance
IL1171050 STAUNTON	<b>Monthly Combined Filter Effluent TT</b>	Returned to Compliance
IL1095510 WESTERN ILLINOIS UNIVERSITY	<b>Monthly Combined Filter Effluent TT</b>	Returned to Compliance
IL1191100 WILLIAMSON	<b>Monthly Combined Filter Effluent TT</b>	Returned to Compliance
IL3151563 ALFANOS PIZZA PONY EXPRESS	<b>Nitrate MCL</b>	Enforcement in Process

# Appendix B

## Illinois EPA 2007 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Contaminant

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3044180 FARMERS CAFE	<b>Nitrate MCL</b>	Enforcement in Process
IL3141390 FIN AND FEATHER CAMPING RESORT (141390)	<b>Nitrate MCL</b>	Enforcement in Process
IL3017657 FIN AND FEATHER CAMPING RESORT (17657)	<b>Nitrate MCL</b>	Enforcement in Process
IL3010280 GILBERT BLACKTOP INN	<b>Nitrate MCL</b>	Enforcement in Process
IL3001164 PEORIA SPORTSMENS CLUB	<b>Nitrate MCL</b>	Returned to Compliance
IL3014134 RIVERVIEW STORE & TAP	<b>Nitrate MCL</b>	Enforcement in Process
IL3131698 SC2 SERVICES- WELL A-WEST	<b>Nitrate MCL</b>	Enforcement in Process
IL3133769 SPRING CREEK GOLF COURSE	<b>Nitrate MCL</b>	Enforcement in Process
IL3010199 SPRING LAKE CONSOL SCHOOL	<b>Nitrate MCL</b>	Returned to Compliance
IL3136309 ST JOHNS LUTHERAN CHURCH	<b>Nitrate MCL</b>	Enforcement in Process
IL3033928 THE BRICK TAVERN	<b>Nitrate MCL</b>	Enforcement in Process
IL3044438 THE MAPLE CLUB	<b>Nitrate MCL</b>	Enforcement in Process
IL3055756 TOBIN NANNING-MARINE CORPS	<b>Nitrate MCL</b>	Enforcement in Process
IL0751000 WOODLAND	<b>Nitrite MCL</b>	Returned to Compliance
IL1090050 BARDOLPH	<b>Single Combined Filter Effluent TT</b>	Returned to Compliance
IL1090200 COLCHESTER	<b>Single Combined Filter Effluent TT</b>	Returned to Compliance
IL1090350 MACOMB	<b>Single Combined Filter Effluent TT</b>	Returned to Compliance
IL1095510 WESTERN ILLINOIS UNIVERSITY	<b>Single Combined Filter Effluent TT</b>	Returned to Compliance
IL0270050 ALBERS	<b>Total Haloacetic Acids MCL</b>	Returned to Compliance
IL1815150 ALTO PASS WATER DISTRICT	<b>Total Haloacetic Acids MCL</b>	Returned to Compliance
IL0110800 OHIO	<b>Total Haloacetic Acids MCL</b>	Returned to Compliance

# ***Appendix B***

## *Illinois EPA 2007 Annual Compliance*

### *Maximum Contaminant Level and Treatment Technique Violations*

#### *Listing by Contaminant*

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL0515500 VANDALIA CORRECTIONAL CENTER	<b>Total Haloacetic Acids MCL</b>	Returned to Compliance
IL0490050 ALTAMONT	<b>Total Trihalomethane MCL</b>	Under compliance commitment agreement/schedule
IL3112201 AMERGEN ENERGY COMPANY	<b>Total Trihalomethane MCL</b>	Enforcement in Process
IL0050050 GREENVILLE	<b>Total Trihalomethane MCL</b>	Under compliance commitment agreement/schedule
IL0730650 KEWANEE	<b>Total Trihalomethane MCL</b>	Returned to Compliance
IL1090350 MACOMB	<b>Total Trihalomethane MCL</b>	Returned to Compliance
IL1890400 OKAWVILLE	<b>Total Trihalomethane MCL</b>	Returned to Compliance
IL0054720 PANAMA	<b>Total Trihalomethane MCL</b>	Under compliance commitment agreement/schedule
IL1215100 RACCOON WATER COMPANY	<b>Total Trihalomethane MCL</b>	Returned to Compliance
IL0515500 VANDALIA CORRECTIONAL CENTER	<b>Total Trihalomethane MCL</b>	Returned to Compliance
IL3138776 MATHEWS COMPANY	<b>Trichloroethylene MCL</b>	Enforcement in Process
IL3132076 HERITAGE ENVIRONMENTAL	<b>Vinyl Chloride MCL</b>	Returned to Compliance
IL3073049 MONTESSORI ACADEMY	<b>Vinyl Chloride MCL</b>	Returned to Compliance

## **Appendix C**

**The attached report identifies all public water supplies with maximum contaminant level and treatment technique violations in system name alpha order.**





# Appendix C

## Illinois EPA 2007 Annual Compliance Maximum Contaminant Level and Treatment Technique Violations Listing by Water

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL0015350 <b>ABS WATER COOP</b>	Coliform MCL	Returned to Compliance
IL0270050 <b>ALBERS</b>	Total Haloacetic Acids MCL	Returned to Compliance
IL3151563 <b>ALFANOS PIZZA PONY EXPRESS</b>	Nitrate MCL	Enforcement in Process
IL3009415 <b>ALLENS CORNER</b>	Coliform (Acute) MCL	Returned to Compliance
IL3009415 <b>ALLENS CORNER</b>	Coliform MCL	Returned to Compliance
IL0490050 <b>ALTAMONT</b>	Total Trihalomethane MCL	Under compliance commitment agreement/schedule
IL1815150 <b>ALTO PASS WATER DISTRICT</b>	Total Haloacetic Acids MCL	Returned to Compliance
IL1830050 <b>ALVAN</b>	Arsenic MCL	Returned to Compliance
IL3112201 <b>AMERGEN ENERGY COMPANY</b>	Total Trihalomethane MCL	Enforcement in Process
IL3002030 <b>ANCIENT OAKS YOUTH CAMP</b>	Coliform MCL	Enforcement in Process
IL3146043 <b>APPLE BLOSSOM FARM (146043)</b>	Coliform MCL	Returned to Compliance
IL1370040 <b>APPLE CREEK WATER COOP</b>	Insufficient Inactivation TT	Returned to Compliance
IL1977210 <b>AQUA ILLINOIS-OAKVIEW</b>	Combined Radium MCL	Returned to Compliance
IL3021824 <b>ARGYLE LAKE STATE PARK (21824)</b>	Coliform (Acute) MCL	Enforcement in Process
IL3076265 <b>AROMA PARK AMERICAN LEGION</b>	Coliform (Acute) MCL	Returned to Compliance
IL3076265 <b>AROMA PARK AMERICAN LEGION</b>	Coliform MCL	Returned to Compliance
IL0750050 <b>ASHKUM</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL1090050 <b>BARDOLPH</b>	Monthly Combined Filter Effluent TT	Returned to Compliance
IL1090050 <b>BARDOLPH</b>	Single Combined Filter Effluent TT	Returned to Compliance
IL0314120 <b>BARTLETT</b>	Barium MCL	Returned to Compliance

# Appendix C

## Illinois EPA 2007 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Water

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL0314120 <b>BARTLETT</b>	Combined Radium MCL	Returned to Compliance
IL0755150 <b>BELMONT ACRES MWC</b>	Arsenic MCL	Enforcement in Process
IL3137547 <b>BIG BASIN MARINA</b>	Coliform MCL	Returned to Compliance
IL3115618 <b>BIG RIVER STATE FOREST OFFICE</b>	Coliform MCL	Enforcement in Process
IL0710050 <b>BIGGSVILLE</b>	Combined Radium MCL	Enforcement in Process
IL0710050 <b>BIGGSVILLE</b>	Gross Alpha MCL	Enforcement in Process
IL1015300 <b>BIRDS PINKSTAFF WATER DISTRICT</b>	Arsenic MCL	Enforcement in process
IL3048801 <b>BLACK HAWK SCHOOL SKIP PROGRAM</b>	Coliform MCL	Returned to Compliance
IL1090100 <b>BLANDINSVILLE</b>	Inadequate DBP Precursor Removal TT	Under compliance commitment agreement/schedule
IL3150359 <b>BOONDOCKS</b>	Coliform MCL	Returned to Compliance
IL3135525 <b>BRIGHTWOOD INN</b>	Coliform MCL	Returned to Compliance
IL3142570 <b>BRIMFIELD EVANGELICAL FREE CHURCH</b>	Coliform MCL	Returned to Compliance
IL3138859 <b>BRISTOL TAP</b>	Coliform MCL	Returned to Compliance
IL0190050 <b>BROADLANDS</b>	Coliform MCL	Returned to Compliance
IL0570200 <b>BRYANT</b>	Combined Radium MCL	Returned to Compliance
IL0910250 <b>BUCKINGHAM</b>	Coliform (Acute) MCL	Returned to Compliance
IL0910250 <b>BUCKINGHAM</b>	Coliform MCL	Returned to Compliance
IL3151266 <b>CABIN FEVER CAMPGROUND</b>	Coliform MCL	Enforcement in Process
IL3003921 <b>CAMP GRESHIEM CHRISTIAN RETREA</b>	Coliform MCL	Enforcement in Process
IL3097790 <b>CAMP ONE WAY</b>	Coliform (Acute) MCL	Enforcement in Process
IL1610120 <b>CANDLE LIGHT COMMUNITY MHP</b>	Coliform MCL	Returned to Compliance

# Appendix C

## Illinois EPA 2007 Annual Compliance Maximum Contaminant Level and Treatment Technique Violations

### Listing by Water

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1610100 <b>CARBON CLIFF</b>	Combined Radium MCL	Returned to Compliance
IL1170150 <b>CARLINVILLE</b>	Inadequate DBP Precursor Removal TT	Returned to Compliance
IL3016246 <b>CHALET CHATEAU</b>	Coliform MCL	Returned to Compliance
IL1970070 <b>CHANNAHON EAST</b>	Combined Radium MCL	Returned to Compliance
IL3120600 <b>CHEBANSE RECREATION AREA MAIN</b>	Coliform MCL	Enforcement in Process
IL0450100 <b>CHRISMAN</b>	Arsenic MCL	Returned to Compliance
IL3148536 <b>CHRIST ALIVE COMMUNITY CHURCH (148536)</b>	Coliform MCL	Returned to Compliance
IL3123802 <b>CHUBBYS CORNER</b>	Coliform (Acute) MCL	Returned to Compliance
IL3115386 <b>CLARK CPD MILL CREEK CAMPGROUN</b>	Coliform MCL	Enforcement in Process
IL1090200 <b>COLCHESTER</b>	Monthly Combined Filter Effluent TT	Returned to Compliance
IL1090200 <b>COLCHESTER</b>	Single Combined Filter Effluent TT	Returned to Compliance
IL0735345 <b>COLONA PARK LLC - FORMERLY KERSHAW MHP</b>	Coliform MCL	Returned to Compliance
IL3147512 <b>COMMUNITY BIBLE CHURCH</b>	Coliform MCL	Returned to Compliance
IL1130400 <b>COOKSVILLE</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL0370051 <b>CORTLAND</b>	Combined Radium MCL	Returned to Compliance
IL0195865 <b>COUNTRY TYME ESTATES</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL3097584 <b>COUNTRYSIDE BAR &amp; GRILL</b>	Coliform MCL	Returned to Compliance
IL3022376 <b>CRAZY HORSE BIG INDIAN CAMPGRN</b>	Coliform (Acute) MCL	Enforcement in Process
IL1975105 <b>CRISWELL COURT MHP</b>	Coliform (Acute) MCL	Returned to Compliance
IL1975105 <b>CRISWELL COURT MHP</b>	Coliform MCL	Returned to Compliance

# Appendix C

## Illinois EPA 2007 Annual Compliance Maximum Contaminant Level and Treatment Technique Violations

### Listing by Water

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3109876 <b>CUSTERS KEG</b>	Coliform MCL	Returned to Compliance
IL1130450 <b>DANVERS</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL1130450 <b>DANVERS</b>	Arsenic MCL	Returned to Compliance
IL0390100 <b>DE WITT</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL3096115 <b>DIMMICK CONSOL COMM SCHOOL 175</b>	Coliform MCL	Returned to Compliance
IL1030200 <b>DIXON</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL1435150 <b>EDELSTEIN WATER COOP</b>	Combined Radium MCL	Enforcement in process
IL1435150 <b>EDELSTEIN WATER COOP</b>	Gross Alpha MCL	Enforcement in process
IL3020552 <b>EDWARDS TAP</b>	Coliform MCL	Returned to Compliance
IL3114843 <b>ELIZA KOUNTRY KAFE</b>	Coliform MCL	Enforcement in Process
IL0975736 <b>ELM OAK MUTUAL WATER SYSTEM</b>	Combined Radium MCL	Enforcement in Process
IL3040493 <b>EPWORTH CHURCH PRESCHOOL</b>	Coliform MCL	Returned to Compliance
IL1570250 <b>EVANSVILLE</b>	Atrazine MCL	Returned to Compliance
IL3015446 <b>FABYAN FOREST PRESERVE</b>	Coliform MCL	Returned to Compliance
IL3122804 <b>FAIRVIEW UNITED METHODIST CH</b>	Coliform MCL	Returned to Compliance
IL3100727 <b>FAMILY PICNIC AREA</b> 3116	Coliform (Acute) MCL	Enforcement in Process
IL3044180 <b>FARMERS CAFE</b>	Nitrate MCL	Enforcement in Process
IL3141390 <b>FIN AND FEATHER CAMPING RESORT (141390)</b>	Nitrate MCL	Enforcement in Process
IL3017657 <b>FIN AND FEATHER CAMPING RESORT (17657)</b>	Nitrate MCL	Enforcement in Process
IL1730100 <b>FINDLAY</b>	Bromate MCL	Returned to Compliance

# Appendix C

## Illinois EPA 2007 Annual Compliance Maximum Contaminant Level and Treatment Technique Violations

### Listing by Water

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3019687 <b>FIRST UNITED METHODIST CH CAMP</b>	Coliform MCL	Returned to Compliance
IL1971150 <b>FOSSIL ROCK RECREATION AREA</b>	Combined Radium MCL	CWS is Inactive
IL1971150 <b>FOSSIL ROCK RECREATION AREA</b>	Gross Alpha MCL	CWS is Inactive
IL0195945 <b>FOUNTAIN VALLEY MHP</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL0990060 <b>FOUR STAR CAMPGROUND</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL0990060 <b>FOUR STAR CAMPGROUND</b>	Gross Alpha MCL	Under compliance commitment agreement/schedule
IL3118232 <b>FRANKLY YOURS</b>	Coliform (Acute) MCL	Enforcement in Process
IL2015495 <b>GEM SUBURBAN MHP</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL0735600 <b>GENESEO HILLS SUBDIVISION</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL0890350 <b>GENEVA</b>	Combined Radium MCL	Returned to Compliance
IL0890350 <b>GENEVA</b>	Gross Alpha MCL	Returned to Compliance
IL3068817 <b>GENEVA MOTEL</b>	Coliform MCL	Enforcement in Process
IL3010280 <b>GILBERT BLACKTOP INN</b>	Nitrate MCL	Enforcement in Process
IL1430350 <b>GLASFORD</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL1430350 <b>GLASFORD</b>	Gross Alpha MCL	Under compliance commitment agreement/schedule
IL3140822 <b>GRACE FELLOWSHIP CHURCH</b>	Coliform MCL	Enforcement in Process
IL0990200 <b>GRAND RIDGE</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL1035165 <b>GREEN ACRES MHP</b>	Coliform MCL	Returned to Compliance
IL1790250 <b>GREEN VALLEY</b>	Coliform MCL	Returned to Compliance

# Appendix C

## Illinois EPA 2007 Annual Compliance Maximum Contaminant Level and Treatment Technique Violations

### Listing by Water

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3026963 <b>GREENSHIRE GOLF COURSE</b>	Coliform MCL	Enforcement in Process
IL0050050 <b>GREENVILLE</b>	Total Trihalomethane MCL	Under compliance commitment agreement/schedule
IL0130200 <b>HARDIN</b>	Coliform MCL	Returned to Compliance
IL3138941 <b>HARDYS REINDEER RANCH</b>	Coliform MCL	Returned to Compliance
IL1030300 <b>HARMON</b>	Combined Radium MCL	Returned to Compliance
IL3062588 <b>HARRISON ELEMENTARY SCHOOL</b>	Coliform MCL	Returned to Compliance
IL1795450 <b>HARVARD HILLS WATER CORPORATION</b>	Coliform MCL	Returned to Compliance
IL3003665 <b>HENNEPIN CANAL PKWY ST PK (3665)</b>	Coliform MCL	Returned to Compliance
IL3132076 <b>HERITAGE ENVIRONMENTAL</b>	Vinyl Chloride MCL	Returned to Compliance
IL1795495 <b>HIATTS HIDEAWAY MHP</b>	Coliform MCL	Returned to Compliance
IL0735329 <b>HILLCREST HOME</b>	Coliform MCL	Returned to Compliance
IL3009498 <b>HILLS COUNTRY STORE</b>	Coliform MCL	Returned to Compliance
IL0370200 <b>HINCKLEY</b>	Combined Radium MCL	Returned to Compliance
IL3131763 <b>HORSE FAIR PARK</b>	Coliform MCL	Returned to Compliance
IL1110350 <b>HUNTLEY</b>	Combined Radium MCL	Returned to Compliance
IL3129080 <b>I AM I CAN</b>	Coliform MCL	Returned to Compliance
IL0430552 <b>IL AMERICAN-DUPAGE UTILITY</b>	Coliform MCL	Returned to Compliance
IL1974151 <b>IL AMERICAN-WEST SUBURBAN</b>	Coliform MCL	Returned to Compliance
IL0995300 <b>IL PRAIRIE ESTATE SBDV WATER ASSOCIATION</b>	Combined Radium MCL	Returned to Compliance
IL3001115 <b>INDIAN BLUFF FOREST PRESERVE</b>	Coliform MCL	Returned to Compliance

# Appendix C

## Illinois EPA 2007 Annual Compliance Maximum Contaminant Level and Treatment Technique Violations

### Listing by Water

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3049296 <b>ISLAND MARINA</b>	Coliform MCL	Returned to Compliance
IL3150078 <b>JEHOVAHS WITNESSES</b>	Coliform MCL	Returned to Compliance
IL0830250 <b>JERSEYVILLE</b>	Coliform MCL	Returned to Compliance
IL1115080 <b>JOHNSBURG NO.2</b>	Combined Radium MCL	Returned to Compliance
IL1970450 <b>JOLIET</b>	Combined Radium MCL	Returned to Compliance
IL3014506 <b>KAMP KOMFORT C/O CLIFF OCKER</b>	Coliform MCL	Returned to Compliance
IL3126540 <b>KARBANS KNOTTY PINES</b>	Coliform MCL	Returned to Compliance
IL3007658 <b>KELLYS MERNA TAP</b>	Coliform MCL	Returned to Compliance
IL0390200 <b>KENNEY</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL0730650 <b>KEWANEE</b>	Total Trihalomethane MCL	Returned to Compliance
IL1430450 <b>KINGSTON MINES</b>	Combined Radium MCL	Enforcement in process
IL1430450 <b>KINGSTON MINES</b>	Gross Alpha MCL	Enforcement in process
IL0630450 <b>KINSMAN</b>	Combined Radium MCL	Returned to Compliance
IL1870050 <b>KIRKWOOD</b>	Combined Radium MCL	Enforcement in Process
IL0950300 <b>KNOXVILLE</b>	Coliform MCL	Returned to Compliance
IL0670450 <b>LA HARPE</b>	Inadequate DBP Precursor Removal TT	Returned to Compliance
IL3149286 <b>LAKE BRACKEN CC GOLF COURSE BATH ROOM</b>	Coliform MCL	Enforcement in Process
IL3150300 <b>LAKE CARROLL POOL</b>	Coliform (Acute) MCL	Enforcement in Process
IL0910020 <b>LAKE SHANNON</b>	Monthly Combined Filter Effluent TT	Returned to Compliance
IL0970850 <b>LAKE ZURICH</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL3111070 <b>LAKEPOINT CLUB % GEORGE KAPPOS</b>	Coliform MCL	Enforcement in Process



# Appendix C

## Illinois EPA 2007 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Water

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3070813 <b>LAKESIDE CAMPING RESORT (70813)</b>	Coliform (Acute) MCL	Enforcement in Process
IL1070300 <b>LATHAM</b>	Failure to install OCCT	Returned to Compliance
IL0315880 <b>LEYDEN TWSP WATER DISTRICT</b>	Coliform MCL	Returned to Compliance
IL0310370 <b>LINDENTREE TOWNHOMES</b>	Combined Radium MCL	Returned to Compliance
IL3085902 <b>LOUD THUNDER FOREST PRESERVE B</b>	Coliform MCL	Returned to Compliance
IL3148684 <b>LUCIANAS RURAL OAKS</b>	Coliform MCL	Returned to Compliance
IL3063263 <b>LUCKYS PORT GRILL</b>	Coliform MCL	Enforcement in Process
IL3119776 <b>LUNDEENS LANDING CAMPGROUND</b>	Coliform (Acute) MCL	Enforcement in Process
IL0995336 <b>LYNNWOOD WATER CORPORATION</b>	Combined Radium MCL	Enforcement in process
IL0735280 <b>LYNWOOD 3RD ADDITION</b>	Arsenic MCL	Returned to Compliance
IL1090350 <b>MACOMB</b>	Monthly Combined Filter Effluent TT	Returned to Compliance
IL1090350 <b>MACOMB</b>	Single Combined Filter Effluent TT	Returned to Compliance
IL1090350 <b>MACOMB</b>	Total Trihalomethane MCL	Returned to Compliance
IL1970550 <b>MANHATTAN</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL1150300 <b>MAROA</b>	Coliform MCL	Returned to Compliance
IL3006940 <b>MARSHALL CO SPORTSMENS CLUB (6940)</b>	Coliform (Acute) MCL	Enforcement in Process
IL1250350 <b>MASON CITY</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL3138776 <b>MATHEWS COMPANY</b>	Trichloroethylene MCL	Enforcement in Process
IL3150391 <b>MAXEY CHAPEL UNITED METHODIST CHURCH</b>	Coliform MCL	Returned to Compliance

# Appendix C

## Illinois EPA 2007 Annual Compliance Maximum Contaminant Level and Treatment Technique Violations

### Listing by Water

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3151118 <b>MCCD PLEASANT VALLEY CONSERVATION AREA</b>	Coliform MCL	Returned to Compliance
IL3095380 <b>MCGRAW WILDLIFE FOUNDATION (95380)</b>	Coliform MCL	Returned to Compliance
IL0990550 <b>MENDOTA</b>	Combined Radium MCL	Enforcement in Process
IL1415165 <b>MERIDIAN MHP</b>	Coliform MCL	Returned to Compliance
IL1610400 <b>MILAN</b>	Coliform MCL	Returned to Compliance
IL3128561 <b>MILLERS AQUATICS</b>	Coliform MCL	Returned to Compliance
IL3022657 <b>MOBIL GAS FOOD MART #18</b>	Coliform (Acute) MCL	Enforcement in Process
IL3026799 <b>MOBIL STORE #42</b>	Coliform (Acute) MCL	Enforcement in Process
IL3073049 <b>MONTESSORI ACADEMY</b>	Coliform MCL	Returned to Compliance
IL3073049 <b>MONTESSORI ACADEMY</b>	Vinyl Chloride MCL	Returned to Compliance
IL3108951 <b>MORAIN VIEW SP</b>	Coliform MCL	Returned to Compliance
IL0935140 <b>MORGAN CREEK</b>	Combined Radium MCL	Returned to Compliance
IL1795345 <b>MORTON MOBILE HOME PARK</b>	Arsenic MCL	Enforcement in process
IL1410350 <b>MOUNT MORRIS</b>	Combined Radium MCL	Enforcement in Process
IL1170700 <b>MOUNT OLIVE</b>	Inadequate DBP Precursor Removal TT	Returned to Compliance
IL1170700 <b>MOUNT OLIVE</b>	Insufficient Inactivation TT	Under compliance commitment agreement/schedule
IL3057703 <b>MUSTANG SALLYS BAR &amp; BOWL</b>	Coliform MCL	Returned to Compliance
IL0990600 <b>NAPLATE</b>	Combined Radium MCL	Enforcement in process
IL0350150 <b>NEOGA</b>	Insufficient Inactivation TT	Under compliance commitment agreement/schedule
IL0110700 <b>NEPONSET</b>	Combined Radium MCL	Enforcement in process
IL0110700 <b>NEPONSET</b>	Gross Alpha MCL	Enforcement in process

# Appendix C

## Illinois EPA 2007 Annual Compliance Maximum Contaminant Level and Treatment Technique Violations

### Listing by Water

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1670800 <b>NEW BERLIN</b>	Insufficient Inactivation TT	Returned to Compliance
IL3009324 <b>NIKOS LODGE BAR &amp; GRILL</b>	Coliform MCL	Enforcement in Process
IL0890600 <b>NORTH AURORA</b>	Combined Radium MCL	Returned to Compliance
IL3124685 <b>NORTH DANVERS MENNONITE CHURCH</b>	Coliform MCL	Returned to Compliance
IL0735850 <b>NORTH HAZELWOOD SBDV</b>	Failure to install OCCT	Returned to Compliance
IL0990650 <b>NORTH UTICA</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL3123695 <b>NORWAY STORE</b>	Coliform MCL	Returned to Compliance
IL2035300 <b>OAK RIDGE SD</b>	Coliform MCL	Returned to Compliance
IL0430010 <b>OBT SERVICE CORPORATION</b>	Coliform MCL	Returned to Compliance
IL0110800 <b>OHIO</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL0110800 <b>OHIO</b>	Total Haloacetic Acids MCL	Returned to Compliance
IL3002709 <b>OKAW VALLEY CAMPGROUND (IL3002709)</b>	Coliform MCL	Returned to Compliance
IL3096081 <b>OKAW VALLEY KAMPGROUND (IL3096081)</b>	Coliform (Acute) MCL	Returned to Compliance
IL3096081 <b>OKAW VALLEY KAMPGROUND (IL3096081)</b>	Coliform MCL	Enforcement in Process
IL1890400 <b>OKAWVILLE</b>	Total Trihalomethane MCL	Returned to Compliance
IL3066399 <b>OLD STARKS TAVERN</b>	Coliform (Acute) MCL	Returned to Compliance
IL1590200 <b>OLNEY</b>	Inadequate DBP Precursor Removal TT	Returned to Compliance
IL0054720 <b>PANAMA</b>	Total Trihalomethane MCL	Under compliance commitment agreement/schedule
IL3122192 <b>PARK HILLS GOLF COURSE (122192) HOUSE</b>	Coliform MCL	Enforcement in Process
IL3001164 <b>PEORIA SPORTSMENS CLUB</b>	Nitrate MCL	Returned to Compliance

# Appendix C

## Illinois EPA 2007 Annual Compliance Maximum Contaminant Level and Treatment Technique Violations

### Listing by Water

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3127761 <b>PETER RABBIT DAY CARE SCHOOL</b>	Coliform MCL	Returned to Compliance
IL3019455 <b>PILGRIM PARK CAMP #1 MAIN WELL</b>	Coliform MCL	Returned to Compliance
IL1490750 <b>PITTSFIELD</b>	Coliform MCL	Returned to Compliance
IL3137018 <b>PLEASANT VALLEY LAKES/RDHOUSE</b>	Coliform (Acute) MCL	Returned to Compliance
IL3137018 <b>PLEASANT VALLEY LAKES/RDHOUSE</b>	Coliform MCL	Returned to Compliance
IL0317080 <b>PLUM CREEK CONDOS</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL3062398 <b>PRAIRIE GROVE SCHOOL</b>	Coliform MCL	Returned to Compliance
IL3005256 <b>PRAIRIEVIEW JR. HIGH SCHOOL</b>	Coliform MCL	Returned to Compliance
IL1215100 <b>RACCOON WATER COMPANY</b>	Total Trihalomethane MCL	Returned to Compliance
IL1615580 <b>RAINBOW RIDGE</b>	Coliform MCL	Returned to Compliance
IL0990900 <b>RANSOM</b>	Combined Radium MCL	Enforcement in process
IL0914780 <b>REDDICK</b>	Combined Radium MCL	Enforcement in process
IL3025841 <b>RENDEZVOUS</b>	Coliform MCL	Returned to Compliance
IL0312550 <b>RIGHTON PARK</b>	Coliform (Acute) MCL	Returned to Compliance
IL0312550 <b>RIGHTON PARK</b>	Coliform MCL	Returned to Compliance
IL0590300 <b>RIDGWAY</b>	Arsenic MCL	Returned to Compliance
IL3024786 <b>RIVER RESTAURANT</b>	Coliform (Acute) MCL	Returned to Compliance
IL3014134 <b>RIVERVIEW STORE &amp; TAP</b>	Nitrate MCL	Enforcement in Process
IL3007609 <b>ROBERT ALLERTON PARK</b>	Coliform MCL	Returned to Compliance
IL0530350 <b>ROBERTS</b>	Lead Public Education TT	Returned to Compliance
IL1410500 <b>ROCHELLE</b>	Coliform MCL	Returned to Compliance

# Appendix C

## Illinois EPA 2007 Annual Compliance

### Maximum Contaminant Level and Treatment Technique Violations

#### Listing by Water

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3125310 <b>ROCK ISLAND TRAIL STATE PARK T</b>	Coliform MCL	Returned to Compliance
IL1970850 <b>ROCKDALE</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL2010300 <b>ROCKFORD</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL2010350 <b>ROCKTON</b>	Combined Radium MCL	Returned to Compliance
IL1830800 <b>ROSSVILLE</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL3125088 <b>RP LUMBER</b>	Coliform MCL	Returned to Compliance
IL0735500 <b>RUSTIC ACRES WATER ASSOCIATION</b>	Arsenic MCL	Enforcement in Process
IL3097477 <b>RUTLAND SCHOOL DIST 230</b>	Coliform MCL	Returned to Compliance
IL1210500 <b>SANDOVAL</b>	Coliform MCL	Returned to Compliance
IL0195150 <b>SANGAMON VALLEY PWD</b>	Coliform MCL	Returned to Compliance
IL3131698 <b>SC2 SERVICES- WELL A-WEST</b>	Nitrate MCL	Enforcement in Process
IL3137091 <b>SHALLOWBROOK FARM RETREAT CTR</b>	Coliform MCL	Returned to Compliance
IL3017947 <b>SHAW-WAW-NA-SEE 4H CAMP #2</b>	Coliform MCL	Returned to Compliance
IL0890040 <b>SILVER GLEN ESTS</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL1615750 <b>SILVIS HEIGHTS WATER CORP</b>	Coliform MCL	Returned to Compliance
IL3096180 <b>SPRING BROOK MARINA INC</b>	Coliform MCL	Returned to Compliance
IL3133769 <b>SPRING CREEK GOLF COURSE</b>	Nitrate MCL	Enforcement in Process
IL3010199 <b>SPRING LAKE CONSOL SCHOOL</b>	Nitrate MCL	Returned to Compliance
IL3136309 <b>ST JOHNS LUTHERAN CHURCH</b>	Nitrate MCL	Enforcement in Process

# Appendix C

## Illinois EPA 2007 Annual Compliance Maximum Contaminant Level and Treatment Technique Violations

### Listing by Water

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL3050856 <b>ST PAULS</b>	Coliform MCL	Returned to Compliance
IL0275250 <b>ST ROSE PWD</b>	Coliform MCL	Returned to Compliance
IL1550300 <b>STANDARD</b>	Combined Radium MCL	Returned to Compliance
IL1550300 <b>STANDARD</b>	Gross Alpha MCL	Returned to Compliance
IL3094227 <b>STARVED ROCK STATE PARK (94227)</b>	Coliform MCL	Enforcement in Process
IL1171050 <b>STAUNTON</b>	Monthly Combined Filter Effluent TT	Returned to Compliance
IL1175250 <b>STAUNTON RESIDENTIAL ROAD WATER COOP</b>	Insufficient Inactivation TT	Purchase Water
IL3142224 <b>STERLING STEEL BALL</b>	Coliform MCL	Returned to Compliance
IL1390300 <b>SULLIVAN</b>	Coliform MCL	Returned to Compliance
IL3062893 <b>SUNRISE GROCERY (62893)</b>	Coliform MCL	Returned to Compliance
IL3009613 <b>SUTTERS COUNTRY KITCHEN</b>	Coliform MCL	Returned to Compliance
IL0370550 <b>SYCAMORE</b>	Combined Radium MCL	Enforcement in Process
IL3049163 <b>SYCAMORE BAPTIST CHURCH</b>	Coliform MCL	Returned to Compliance
IL3033928 <b>THE BRICK TAVERN</b>	Nitrate MCL	Enforcement in Process
IL0115525 <b>THE GROVE MHP</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL3044438 <b>THE MAPLE CLUB</b>	Nitrate MCL	Enforcement in Process
IL3004242 <b>THE PALACE</b>	Coliform (Acute) MCL	Returned to Compliance
IL3136275 <b>THE SCOTTS COMPANY</b>	Coliform MCL	Enforcement in Process
IL2035225 <b>TIMBERLINE MHP</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL3055756 <b>TOBIN NANNING-MARINE CORPS</b>	Nitrate MCL	Enforcement in Process
IL0991150 <b>TONICA</b>	Arsenic MCL	Under compliance commitment agreement/schedule

# Appendix C

## Illinois EPA 2007 Annual Compliance Maximum Contaminant Level and Treatment Technique Violations

### Listing by Water

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1790700 <b>TREMONT</b>	Coliform MCL	Returned to Compliance
IL0195925 <b>TRIANGLE MHP</b>	Arsenic MCL	Returned to Compliance
IL3104000 <b>USFS JOHNSON CREEK RECREATION AREA</b>	Coliform MCL	Returned to Compliance
IL3111179 <b>USFS PINERIDGE CAMPGROUND LOOP 4</b>	Coliform MCL	Returned to Compliance
IL3104703 <b>USFS TOWER ROCK CAMPGROUND</b>	Coliform MCL	Enforcement in Process
IL2015160 <b>UTL INC-COVENTRY CREEK SUBDIVISION</b>	Combined Radium MCL	Under compliance commitment agreement/schedule
IL0855050 <b>UTL INC-GALENA TERRITORY UTILITES</b>	Combined Radium MCL	Returned to Compliance
IL3064782 <b>VALLEY VIEW SCHOOL</b>	Coliform MCL	Returned to Compliance
IL0515500 <b>VANDALIA CORRECTIONAL CENTER</b>	Total Haloacetic Acids MCL	Returned to Compliance
IL0515500 <b>VANDALIA CORRECTIONAL CENTER</b>	Total Trihalomethane MCL	Returned to Compliance
IL3005777 <b>VICTORY BAPTIST CHURCH</b>	Coliform MCL	Returned to Compliance
IL0370600 <b>WATERMAN</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL0750900 <b>WATSEKA</b>	Arsenic MCL	Returned to Compliance
IL1370450 <b>WAVERLY</b>	Insufficient Inactivation TT	Returned to Compliance
IL0390300 <b>WAYNESVILLE</b>	Arsenic MCL	Under compliance commitment agreement/schedule
IL3139139 <b>WELDON SPRINGS SP SHWRHSE</b>	Coliform MCL	Returned to Compliance
IL3149229 <b>WESTERN ILLINOIS NATURE GROUP</b>	Coliform MCL	Returned to Compliance
IL1095510 <b>WESTERN ILLINOIS UNIVERSITY</b>	Monthly Combined Filter Effluent TT	Returned to Compliance
IL1095510 <b>WESTERN ILLINOIS UNIVERSITY</b>	Single Combined Filter Effluent TT	Returned to Compliance

# *Appendix C*

## *Illinois EPA 2007 Annual Compliance*

### *Maximum Contaminant Level and Treatment Technique Violations*

#### *Listing by Water*

<u>Facility Number and Name</u>	<u>Contaminant</u>	<u>Comments</u>
IL1171150 <b>WHITE CITY</b>	Insufficient Inactivation TT	Purchase Water
IL0995425 <b>WILDLIFE MHP</b>	Combined Radium MCL	Enforcement in process
IL1191100 <b>WILLIAMSON</b>	Monthly Combined Filter Effluent TT	Returned to Compliance
IL1770550 <b>WINSLOW</b>	Coliform MCL	Returned to Compliance
IL0971950 <b>WINTHROP HARBOR</b>	Coliform MCL	Returned to Compliance
IL0735120 <b>WOLF RIDGE WELL CORPORATION</b>	Arsenic MCL	Returned to Compliance
IL3014282 <b>WOLFCREEK COUNTRY CLUB</b>	Coliform MCL	Returned to Compliance
IL0751000 <b>WOODLAND</b>	Nitrite MCL	Returned to Compliance
IL0970080 <b>WYNSTONE WATER COMPANY</b>	Combined Radium MCL	Returned to Compliance